



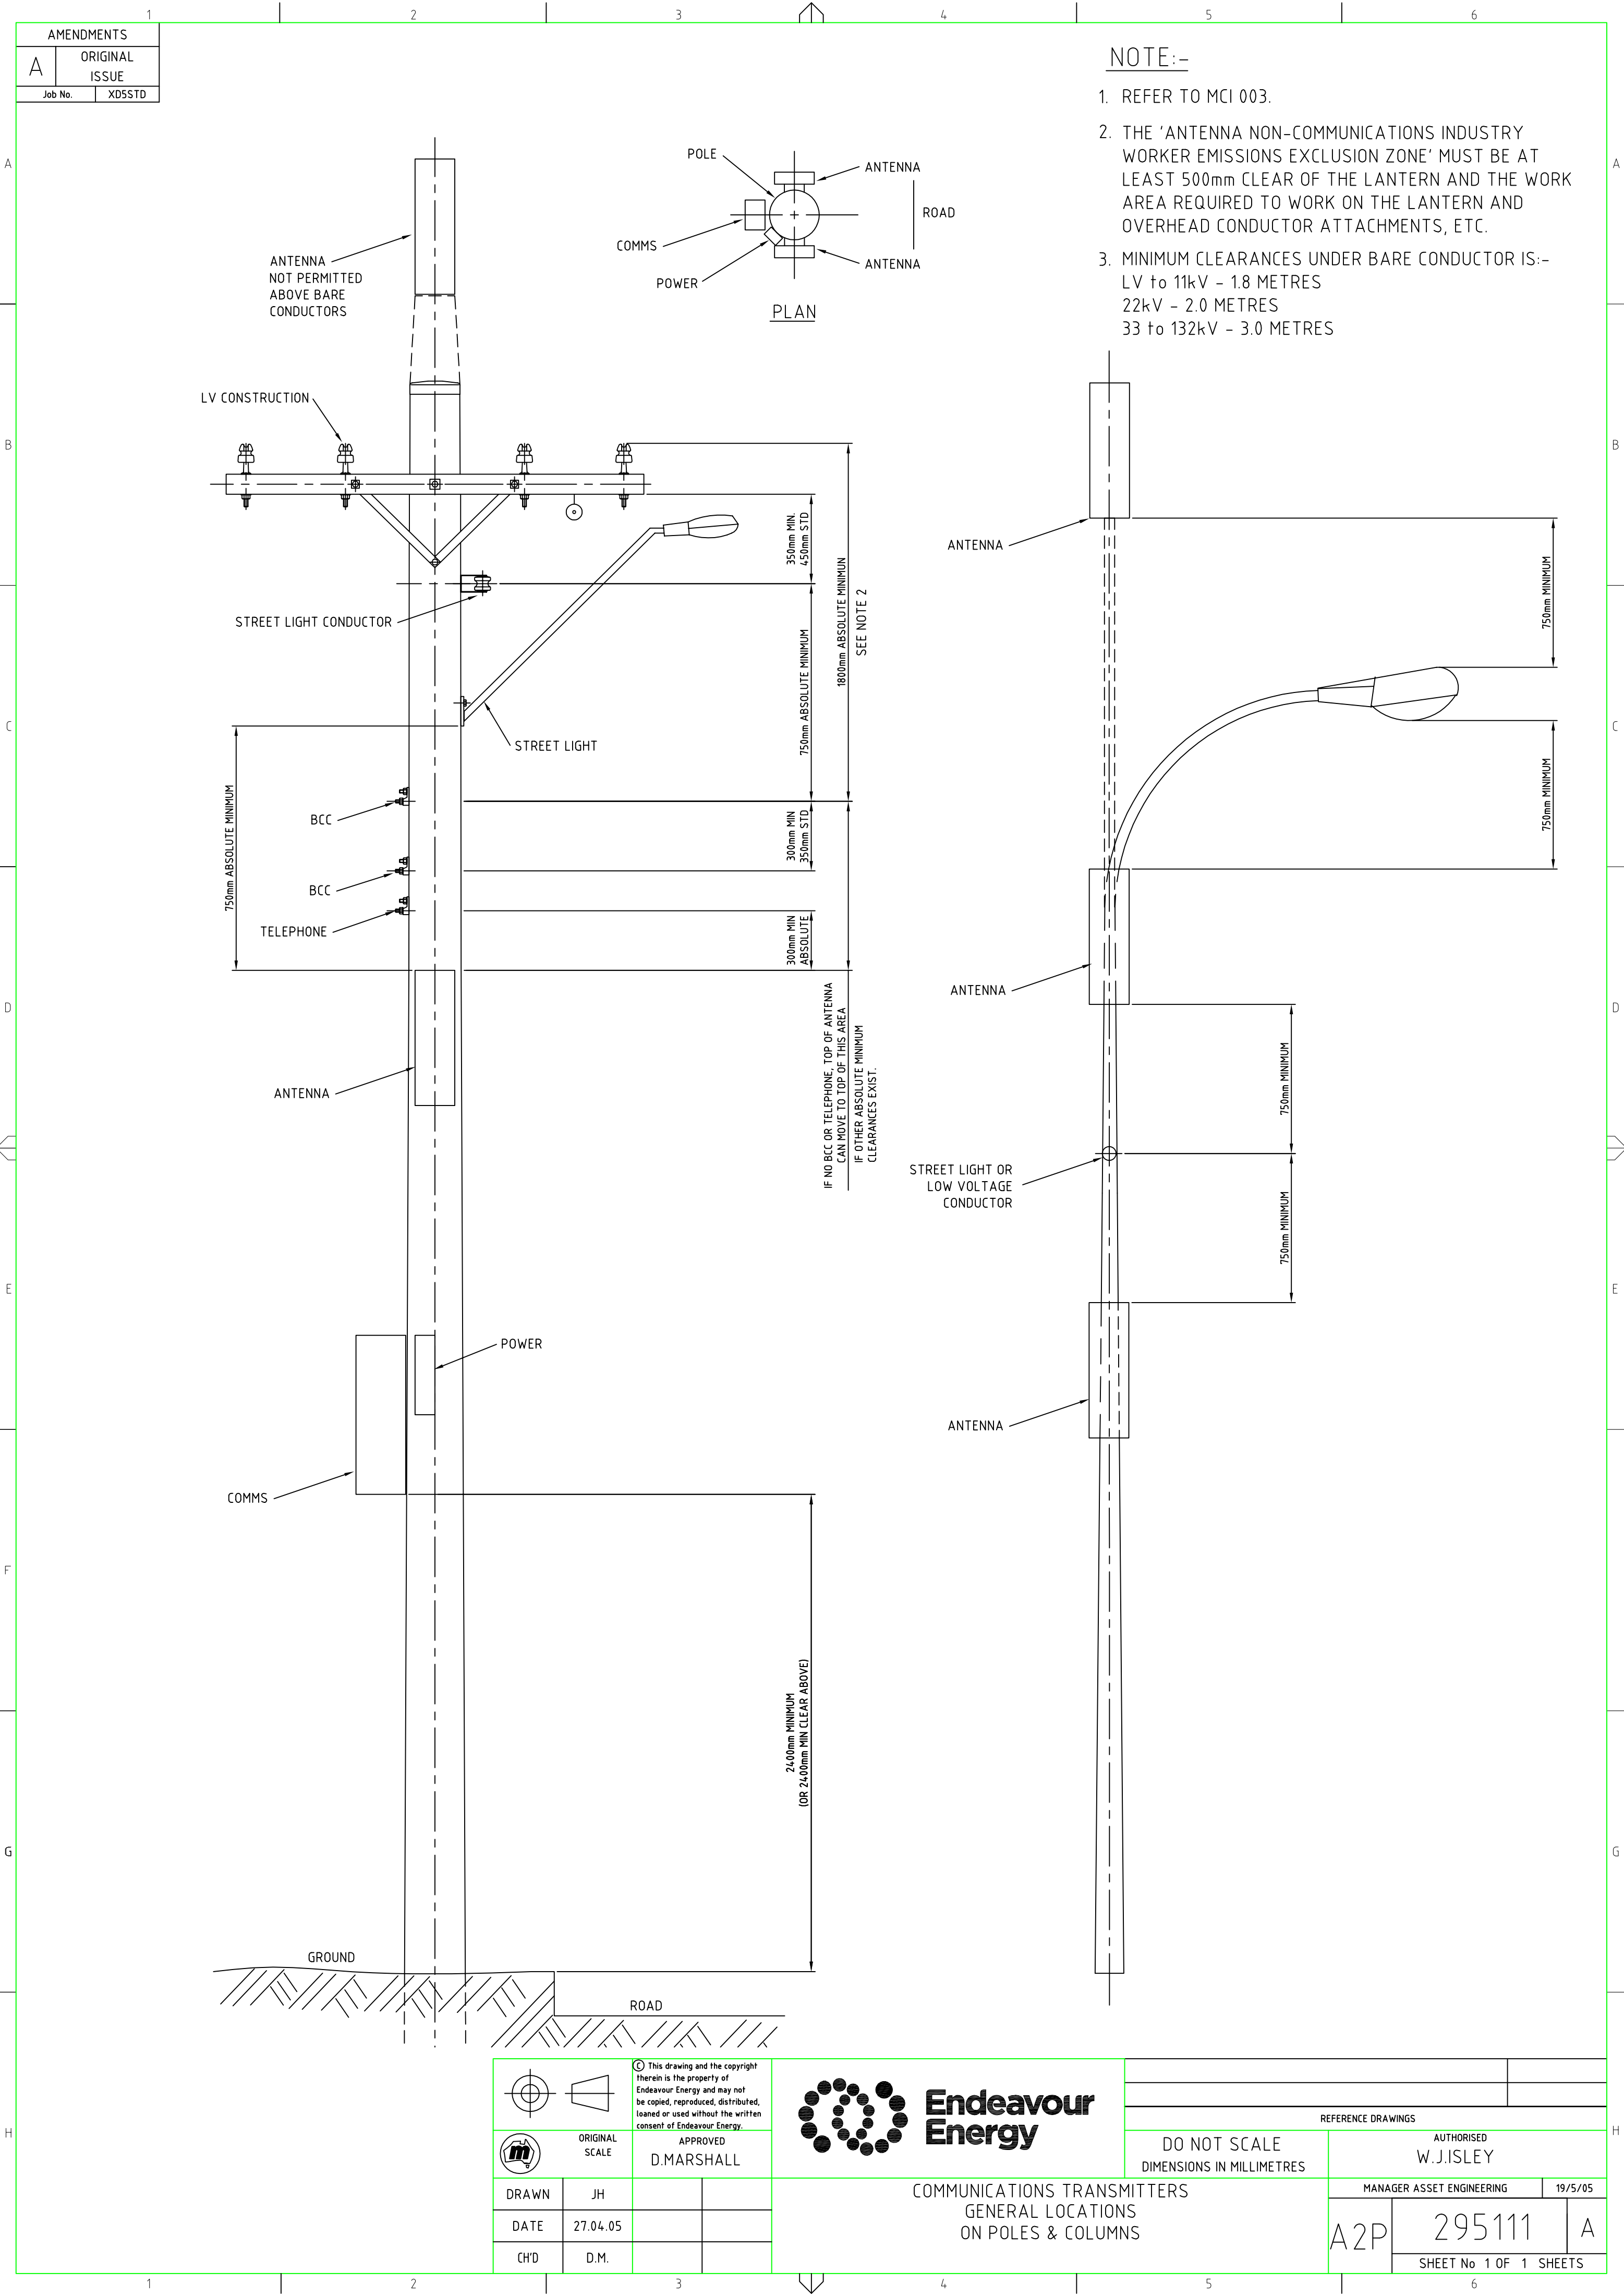

NOTE:-

- 1. REFER TO MCI 003.
- 2. THE 'ANTENNA NON-COMMUNICATIONS INDUSTRY WORKER EMISSIONS EXCLUSION ZONE' MUST BE AT LEAST 500mm CLEAR OF THE LANTERN AND THE WORK AREA REQUIRED TO WORK ON THE LANTERN AND OVERHEAD CONDUCTOR ATTACHMENTS, ETC.
- 3. MINIMUM CLEARANCES UNDER BARE CONDUCTOR IS:-
 - LV to 11kV - 1.8 METRES
 - 22kV - 2.0 METRES
 - 33 to 132kV - 3.0 METRES




This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.



ORIGINAL SCALE

APPROVED
D.MARSHALL



Endeavour Energy

DRAWN	JH		
DATE	27.04.05		
CH'D	D.M.		

COMMUNICATIONS TRANSMITTERS
GENERAL LOCATIONS
ON POLES & COLUMNS

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

REFERENCE DRAWINGS		AUTHORISED W.J.ISLEY	
MANAGER ASSET ENGINEERING		19/5/05	
A2P	295111		A
	SHEET No 1 OF 1 SHEETS		