



AMENDMENTS	ORIGINAL
A	ISSUE



NOTE

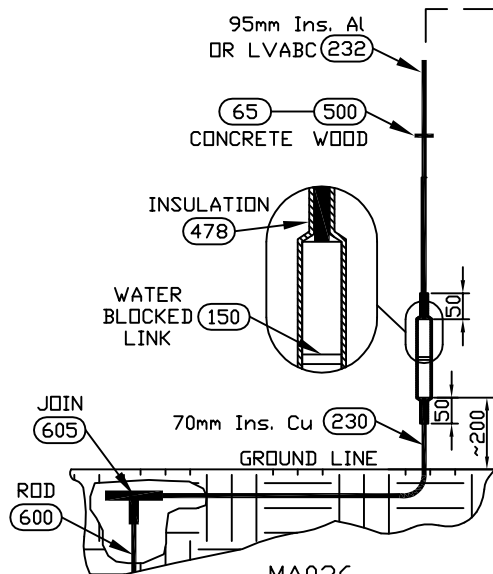


MA036
(OH TO UG EARTHING
INSULATED BI-METAL JOINT)
REFER ALSO TO SDI 100

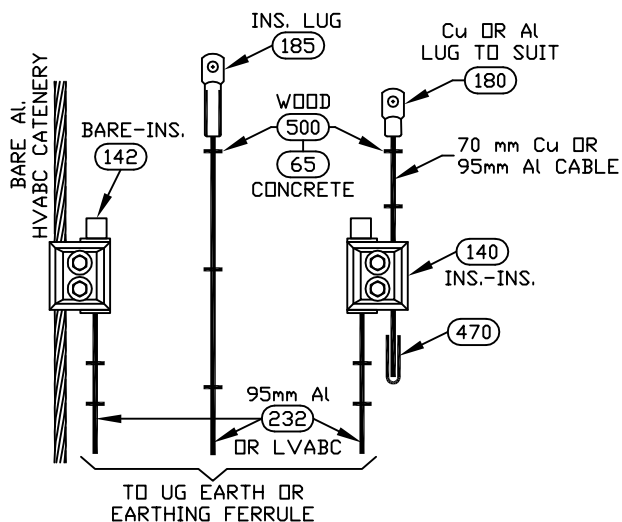


MA037
-B=BARE, -L=LUG, -I=INS.
OH EARTHING CONNECTIONS
REFER ALSO TO SDI 100

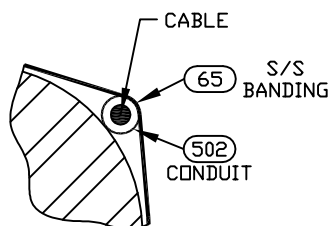

MA038
(CABLE SADDLE/SUPPORT + INS)
FOR WOOD POLES USE SADDLES
FOR CONCRETE POLES USE S/S BANDING

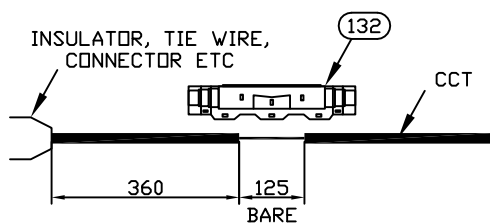

MA050
(CCT EARTH POINT)

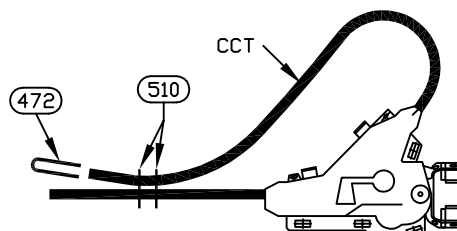

MA052
(CCT TIE-OFF)

	© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or sold without the written consent of Endeavour Energy.
ORIGINAL SCALE	APPROVED
DRAWN G. Ford	G. Ford
DATE 22/04/09	
CHKD G. Ford	REF F003P



Endeavour
Energy

STANDARD ASSEMBLIES
MISCELLANEOUS ITEMS
BRACKETS - CONNECTORS

REFERENCE DRAWINGS	
DO NOT SCALE DIMENSIONS IN MILLIMETRES	AUTHORISED W. Isley
MANAGER ASSET ENGINEERING	22/04/09
A4	332002
SHEET No 2 OF 5 SHEETS	