


AMENDMENTS			
A			
J R No.	NA		
SUPERCEDES			
DWG	079461		
DRN	CR		
CHD	GA		
DATE	11/7/15		
JR No			
NOTE AND PT. JOINT ADDED			

NOTES

- 1). The insulation depth must be as determined by the earthing design.
- 2). Separation between electrodes of the same electrode system is typically the uninsulated electrode length. Minimum separation between electrodes of HV earth and LV earth to be determined in earthing design but must not be less than 4m.
- 3). For connection of earthing cable to pole installations ref drg 332002. For ground mount installations ref drg 348248.
- 4). Bare cables, joints, and electrodes associated with the HV earth installation to be separated from equipment bonded to LV (MEN) earth such as street light columns, LV pillar earths, water and sewerage metallic pipes etc. by a minimum distance as determined by the earthing design.
- 5). Earthing construction must comply with EDI-100 and EDI-0006.

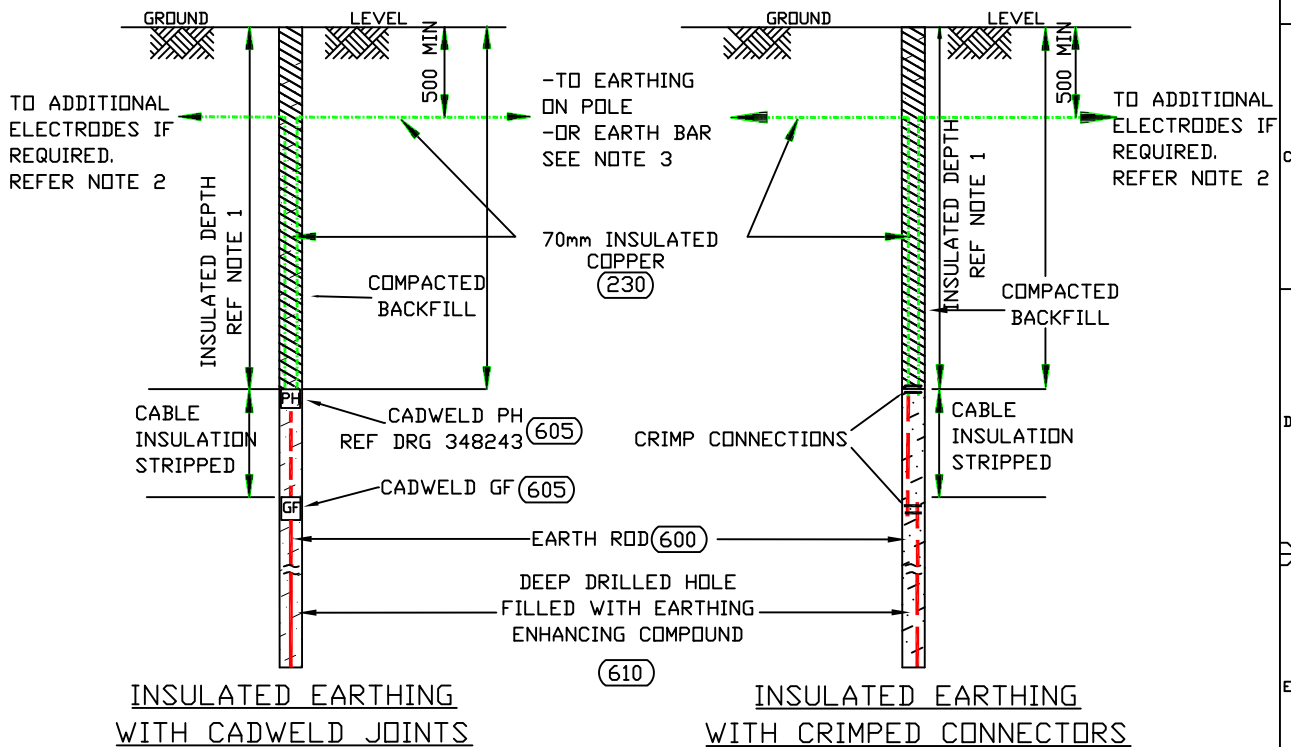

REFER TO PARTS AND ACCESSORY LIST IN MCI-0005


EARTH BAR&ELECTRODE CONNECTIONS	348248	
STANDARD ASSEMBLY	332002	
DRIVEN ROD EARTHING	348247	
CADWELD JOINT DETAIL	348243	
REFERENCE DRAWINGS	DRG. NO.	THIS ISSUE PAGE NO

DO NOT SCALE DIMENSIONS IN MILLIMETRES	J. Perera	ISSUE IDENTIFICATION	EDI-0006
MANAGER PRIMARY SYSTEMS	26-02-14	THIS ISSUE	
SUB	348246 B	PAGE NO.	
SHEET No 1 OF 1 SHEETS	INDEX REF		



THIS DRAWING AND THE COPYRIGHT HEREIN ARE THE PROPERTY OF ENDEAVOUR ENERGY AND MAY NOT BE COPIED, REPRODUCED, EITHER WHOLLY OR IN PART, WITHOUT THE WRITTEN CONSENT OF ENDEAVOUR ENERGY.

APPROVED C.CRISAFULLI



ORIGINAL SCALE NONE

DRAWN	D.C.
DATE	26-02-14
CHD	T.M.N.

DEEP DRILLED EARTHING SYSTEM
11/22kV INSULATED EARTHING
ARRANGEMENT