


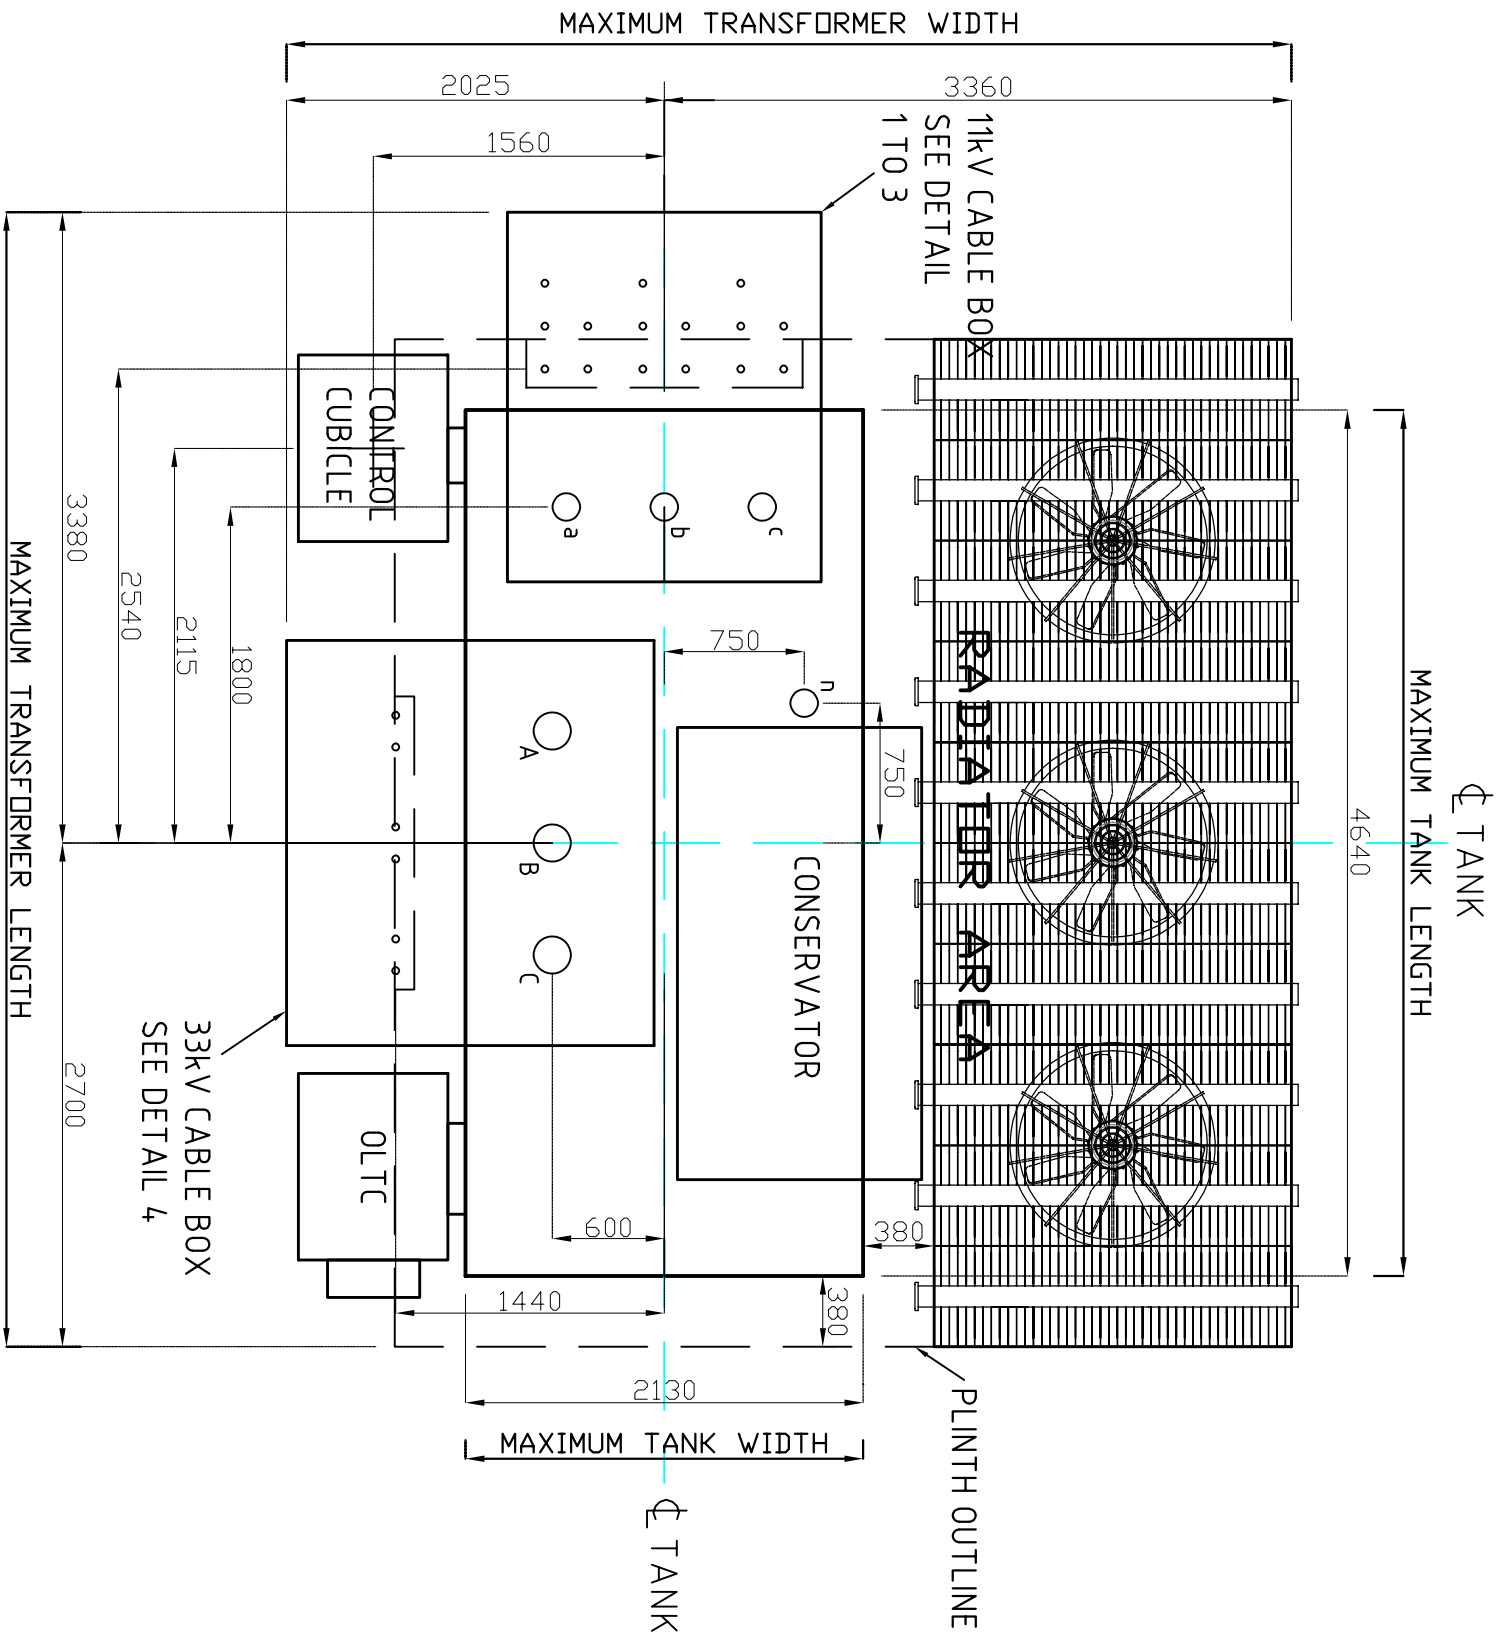


NOTES:


THE FOLLOWING CRITERIA ARE MANDATORY:

- 1) A - BUSHING LOCATIONS
 - 2) TANK SIZE
 - 3) RADIATORS TO REMAIN WITHIN RADIATOR AREA
- B - CABLE LOCATIONS AND QUANTITY
- C - GENERAL LOCATIONS OF CONTROL CUBICLE AND OLTTC


DETAIL 1: 11kV CABLE BOX 15MVA

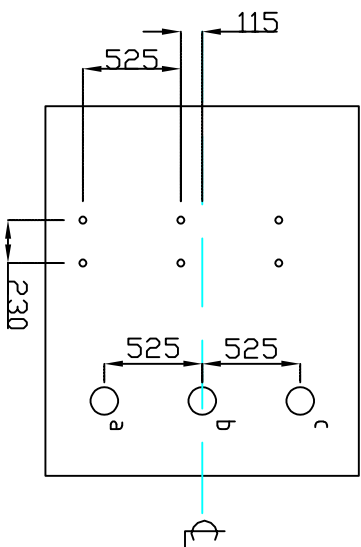


DETAIL 2: 11kV CABLE BOX 25MVA

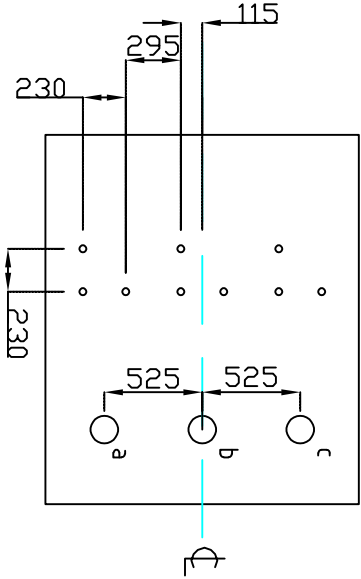

DETAIL 3: 11kV CABLE BOX 35MVA

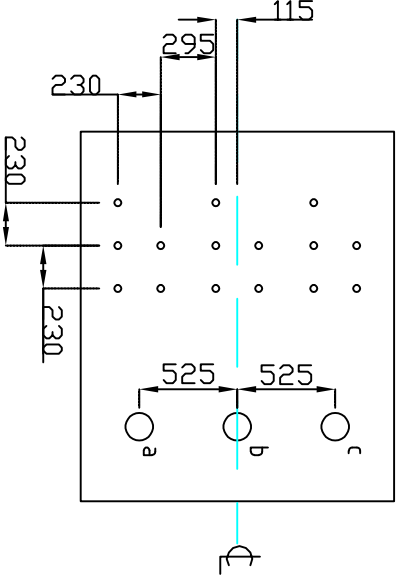

DETAIL 4: 33kV CABLE BOX (OPTIONAL)

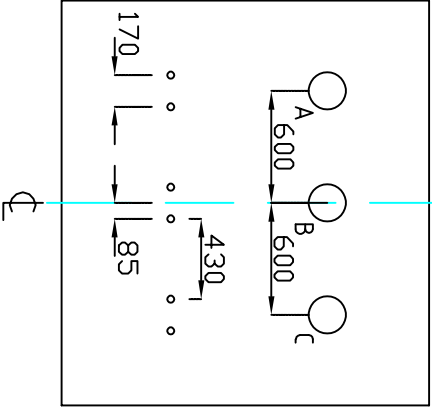

AMENDMENTS	
ORIGINAL ISSUE	
Job No.	
REVISION B	
DRAWING RE-DRAWN TO SCALE. SOME DIMENSIONS UPDATED. PLINTH OUTLINE CLEARLY DEFINED. DWG357328 and DWG357329 COMBINED WITH 33kV CABLE BOX MENTIONED AS OPTIONAL.	

	ORIGINAL SCALE	APPROVED
	APPROVED	
DRAWN	DBAJIC	
DATE	24-02-25	
CHD		



TENDER BASE DESIGN

TRANSFORMER 33/11kV 15MVA, 25MVA, 35MVA

HV CABLE/BUSHING & LV CABLE

GENERAL ARRANGEMENT

DO NOT SCALE		REFERENCE DRAWINGS	
DIMENSIONS IN MILLIMETRES		AUTHORISED	
A2		357328	
SHEET No 1 OF 1 SHEETS		Rev. B	