
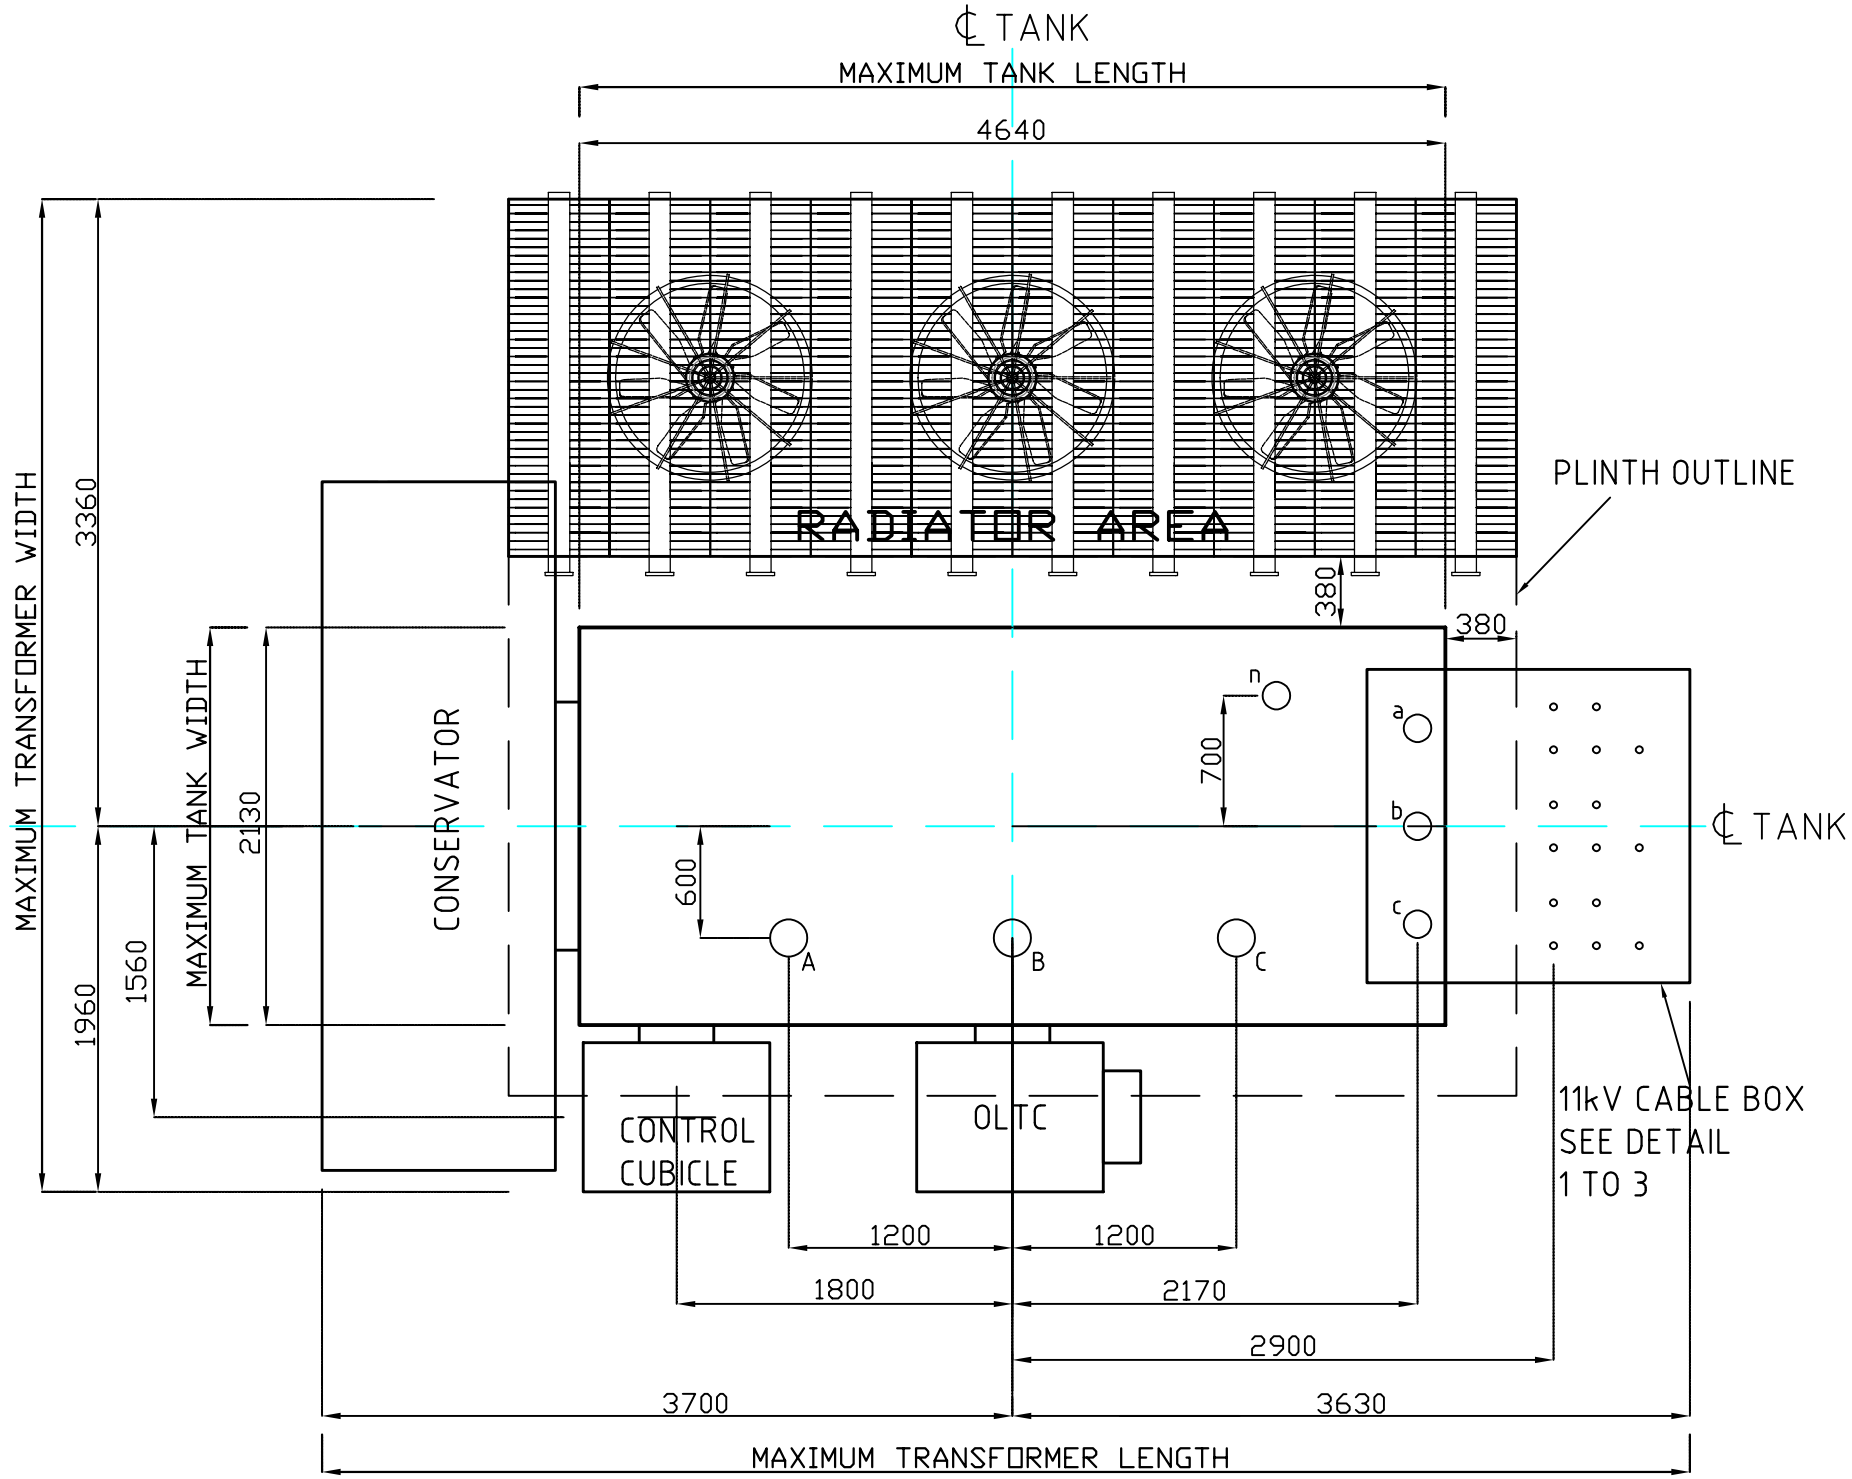


NOTES:


THE FOLLOWING CRITERIA ARE MANDATORY:

1) A- BUSHING LOCATIONS
   B- CABLE LOCATIONS AND QUANTITY
   C- GENERAL LOCATIONS OF CONTROL CUBICLE AND OLTC
2) TANK SIZE
3) RADIATORS TO REMAIN WITHIN RADIATOR AREA


DETAIL 1: 11kV CABLE BOX 15MVA

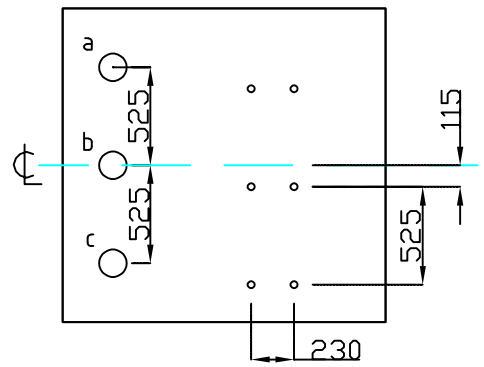

DETAIL 2: 11kV CABLE BOX 25MVA

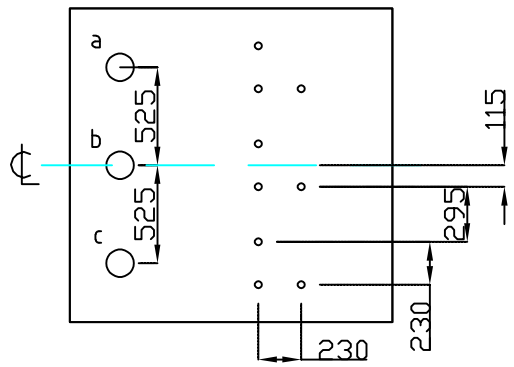

DETAIL 3: 11kV CABLE BOX 35MVA

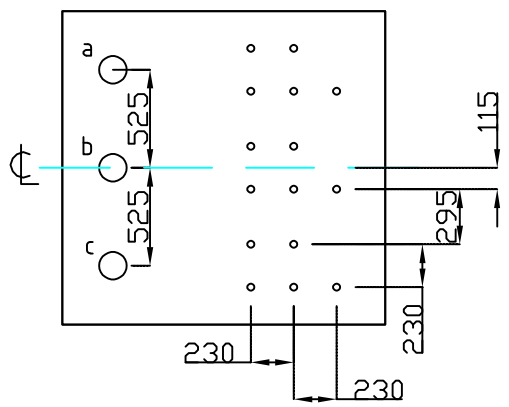

AMENDMENTS

		Job No.
A	ORIGINAL ISSUE	
REVISION B	DRAWING RE-DRAWN TO SCALE. SOME DIMENSIONS UPDATED. PLINTH OUTLINE CLEARLY DEFINED. 11kV BUSHINGS ORIENTATION CHANGED FROM HORIZONTAL TO VERTICAL.	

© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

ORIGINAL SCALE

APPROVED

DRAWN	D.BAJIC		
DATE	25-02-25		
CH'D			

Endeavour Energy

REFERENCE DRAWINGS

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

AUTHORISED

TENDER BASE DESIGN
TRANSFORMER 66/11kV 15MVA, 25MVA, 35MVA
HV BUSHING & LV CABLE
GENERAL ARRANGEMENT

A2 | 357331 | Rev. B

SHEET No 1 OF 1 SHEETS

FRAME_A2.DWG_v1.0