

NOTES:

1- THE FOLLOWING CRITERIA ARE MANDATORY:

A- BUSHING LOCATIONS

B- CABLE LOCATIONS AND QUANTITY

C- GENERAL LOCATIONS OF CONTROL CUBICLE AND OLTC

2- TANK SIZE TO REMAIN WITHIN DOTTED PLINTH LINE

3- RADIATORS TO REMAIN WITHIN RADIATOR AREA

11KV CABLE BOX

TRANSFORMER AREA


RADIATOR AREA

TANK

RADIATOR


PLINTH AREA

TANK

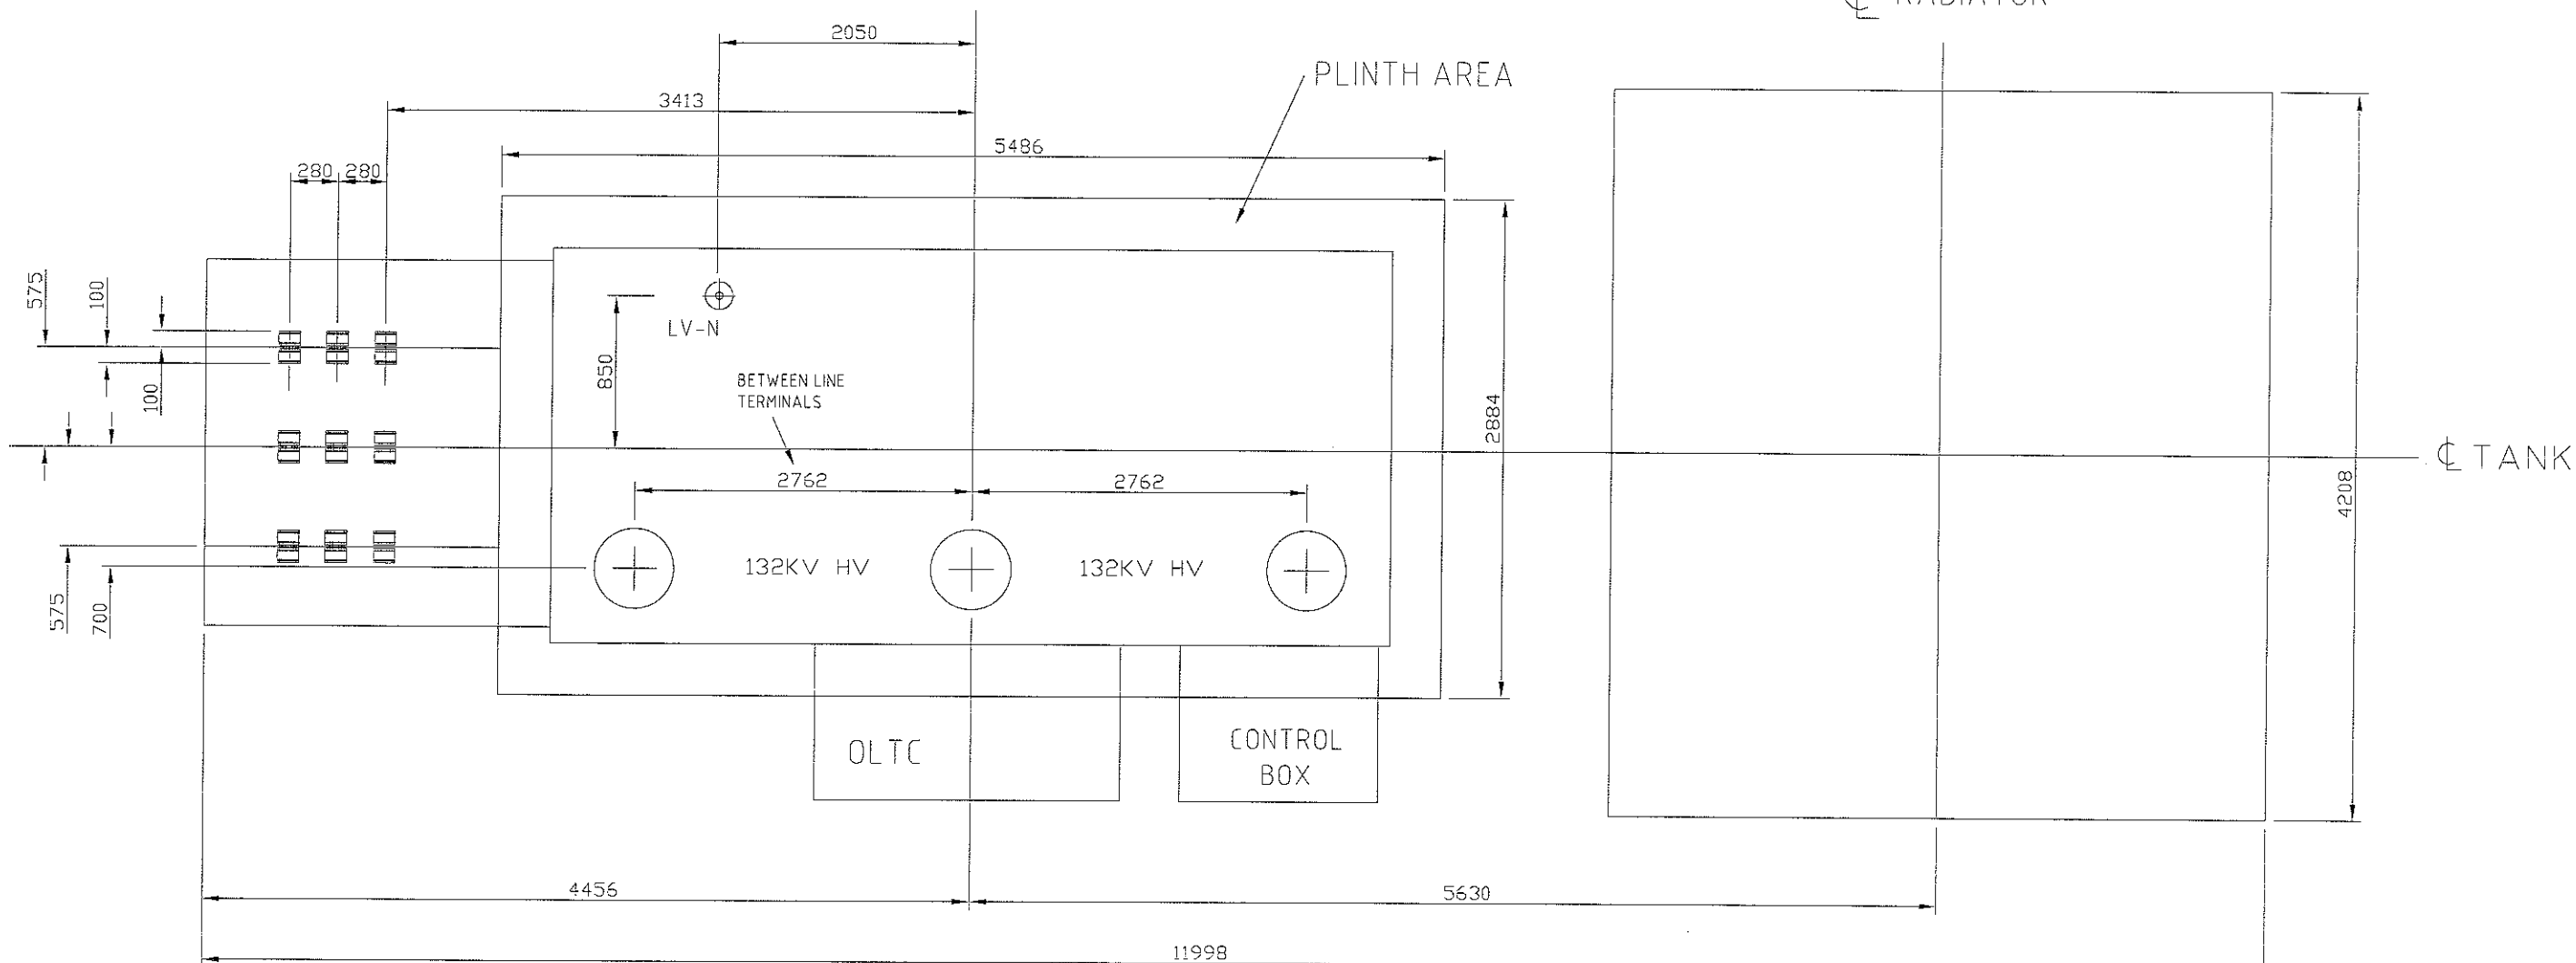

AMENDMENTS	ORIGINAL	ISSUE
A		

	ORIGINAL SCALE	APPROVED
DRAWN	PLC	
DATE	19-10-11	
CH'D	PN	



TENDER BASE DESIGN
132/11KV TRANSFORMER 45MVA
HV BUSHING & LV CABLE
GENERAL ARRANGEMENT

REFERENCE DRAWINGS

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

AUTHORISED

MGR TRANSMISSION PROJECT DEVELOPMENT 26.10.11

A2 365350 A

SHEET No 1 OF 1 SHEETS