

NOTES:


1- THE FOLLOWING CRITERIA ARE MANDATORY:

- A- BUSHING LOCATIONS
- B- CABLE LOCATIONS AND QUANTITY
- C- GENERAL LOCATIONS OF CONTROL CUBICLE AND OLTC

2- TANK SIZE TO REMAIN WITHIN DOTTED PLINTH LINE

3- RADIATORS TO REMAIN WITHIN RADIATOR AREA

This area to remain free for soundwalls and bund walls to be installed. Bund wall is min 900mm height. holes will be provided in sound wall for radiator pipework as required.

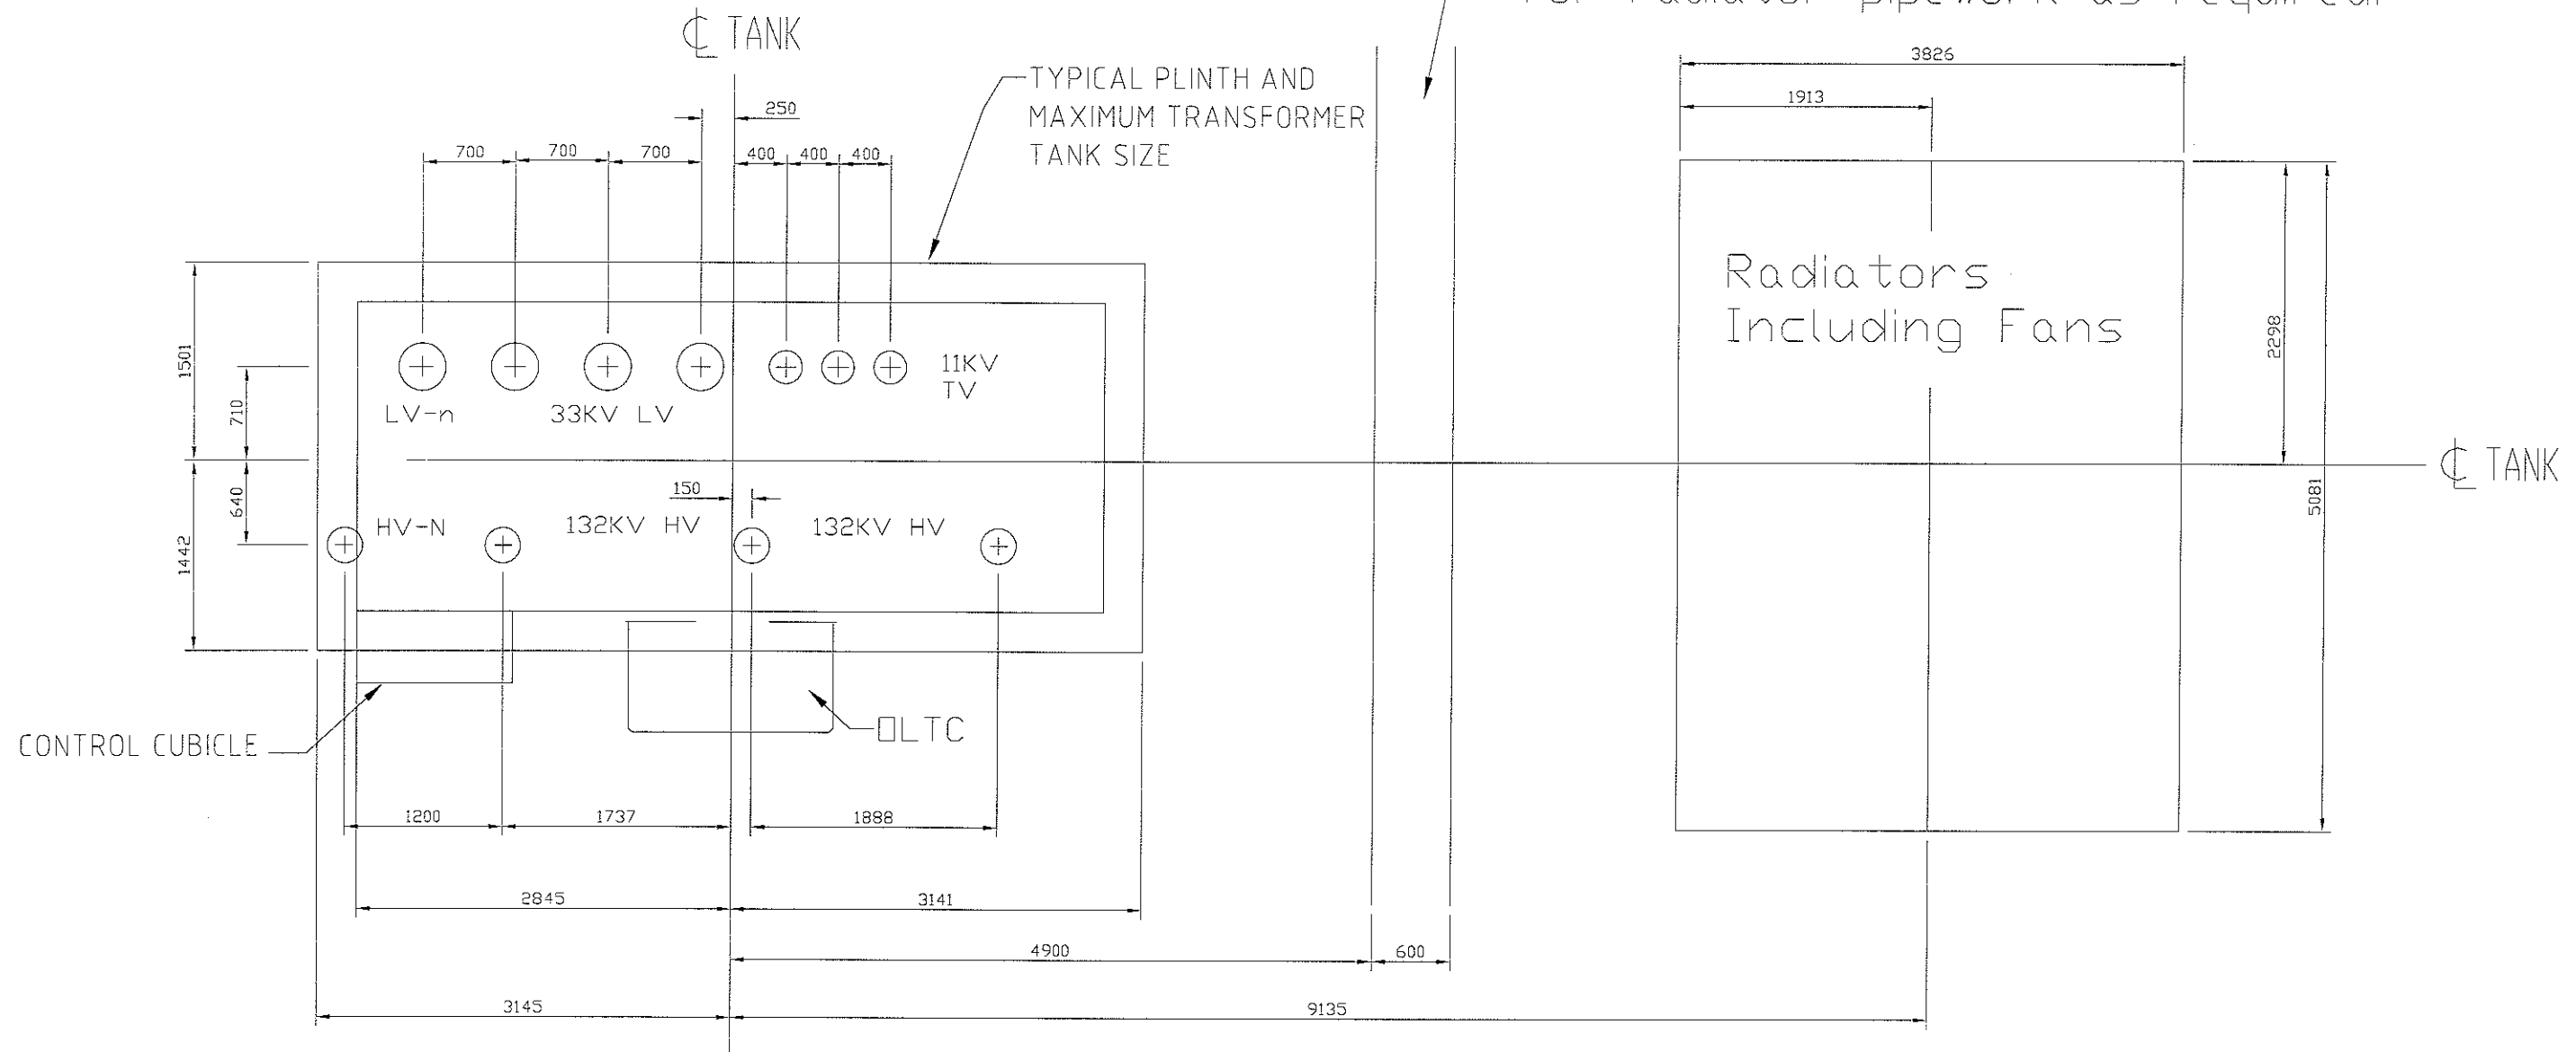

AMENDMENTS	ORIGINAL	ISSUE
A		

FRAME_A2.DWG_v1.0

	© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.
ORIGINAL SCALE	APPROVED
DRAWN	PLE
DATE	13-10-11
CH'D	PN



TENDER BASE DESIGN
132/33/11KV TRANSFORMER 60MVA, HV BUSHING, LV BUSHING
WITH DE-ATTACHED RADIATOR AND CABLE BUSHING
GENERAL ARRANGEMENT

REFERENCE DRAWINGS	
DO NOT SCALE DIMENSIONS IN MILLIMETRES	AUTHORISED
MGR TRANSMISSION PROJECT DEVELOPMENT 26.10.11	Rev. A
A2	365354
SHEET No 1 OF 1 SHEETS	