

NOTES:

1- THE FOLLOWING CRITERIA ARE MANDATORY:

A- BUSHING LOCATIONS


B- CABLE LOCATIONS AND QUANTITY

C- GENERAL LOCATIONS OF CONTROL CUBICLE AND OLTC

2- TANK SIZE TO REMAIN WITHIN DOTTED PLINTH LINE


3- RADIATORS TO REMAIN WITHIN RADIATOR AREA

This area to remain free for soundwalls and bund walls to be installed. Bund wall is min 900mm height. holes will be provided in sound wall for radiator pipework as required.

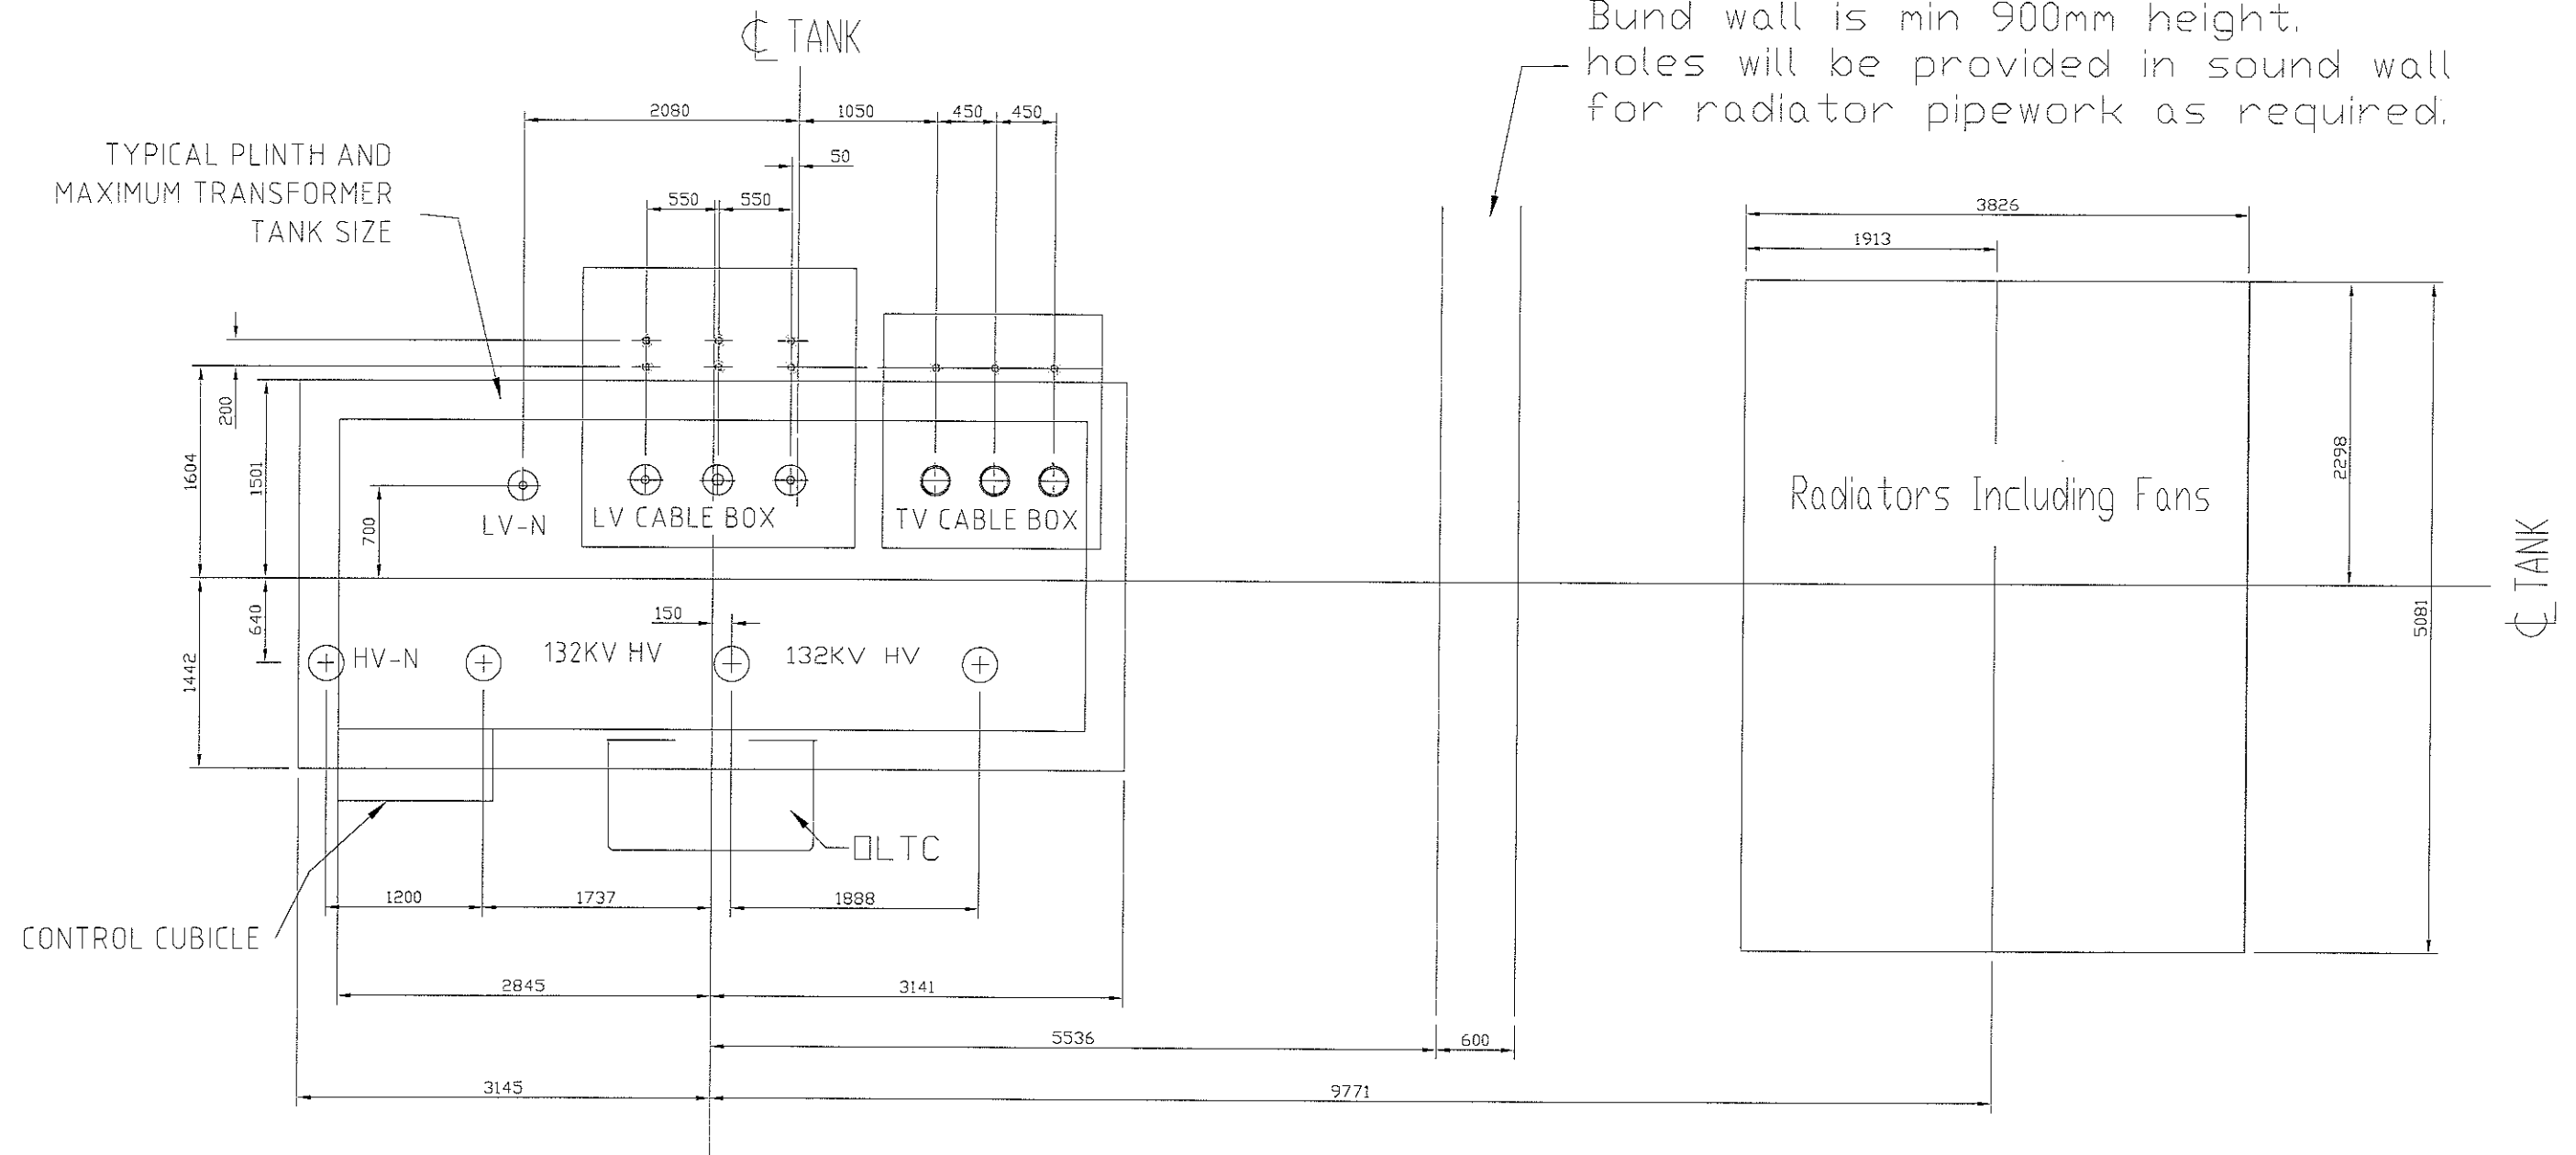

AMENDMENTS	ORIGINAL	ISSUE
A		

	ORIGINAL SCALE	APPROVED
DRAWN	PLE	
DATE	13-10-11	
CH'D	PN	



TENDER BASE DESIGN
132/33/11KV TRANSFORMER 60MVA
HV BUSHING & LV CABLE BOX
GENERAL ARRANGEMENT

REFERENCE DRAWINGS		AUTHORISED	
DO NOT SCALE	DIMENSIONS IN MILLIMETRES		DAW
A2	365356	Rev.	A
SHEET No 1 OF 1 SHEETS			