

NOTES:

1- THE FOLLOWING CRITERIA ARE MANDATORY:

A- BUSHING LOCATIONS


B- CABLE LOCATIONS AND QUANTITY

C- GENERAL LOCATIONS OF CONTROL CUBICLE AND OLTC

2- TANK SIZE TO REMAIN WITHIN DOTTED PLINTH LINE


3- RADIATORS TO REMAIN WITHIN RADIATOR AREA

This area to remain free for soundwalls and bund walls to be installed. Bund wall is min 900mm height. holes will be provided in sound wall for radiator pipework as required.

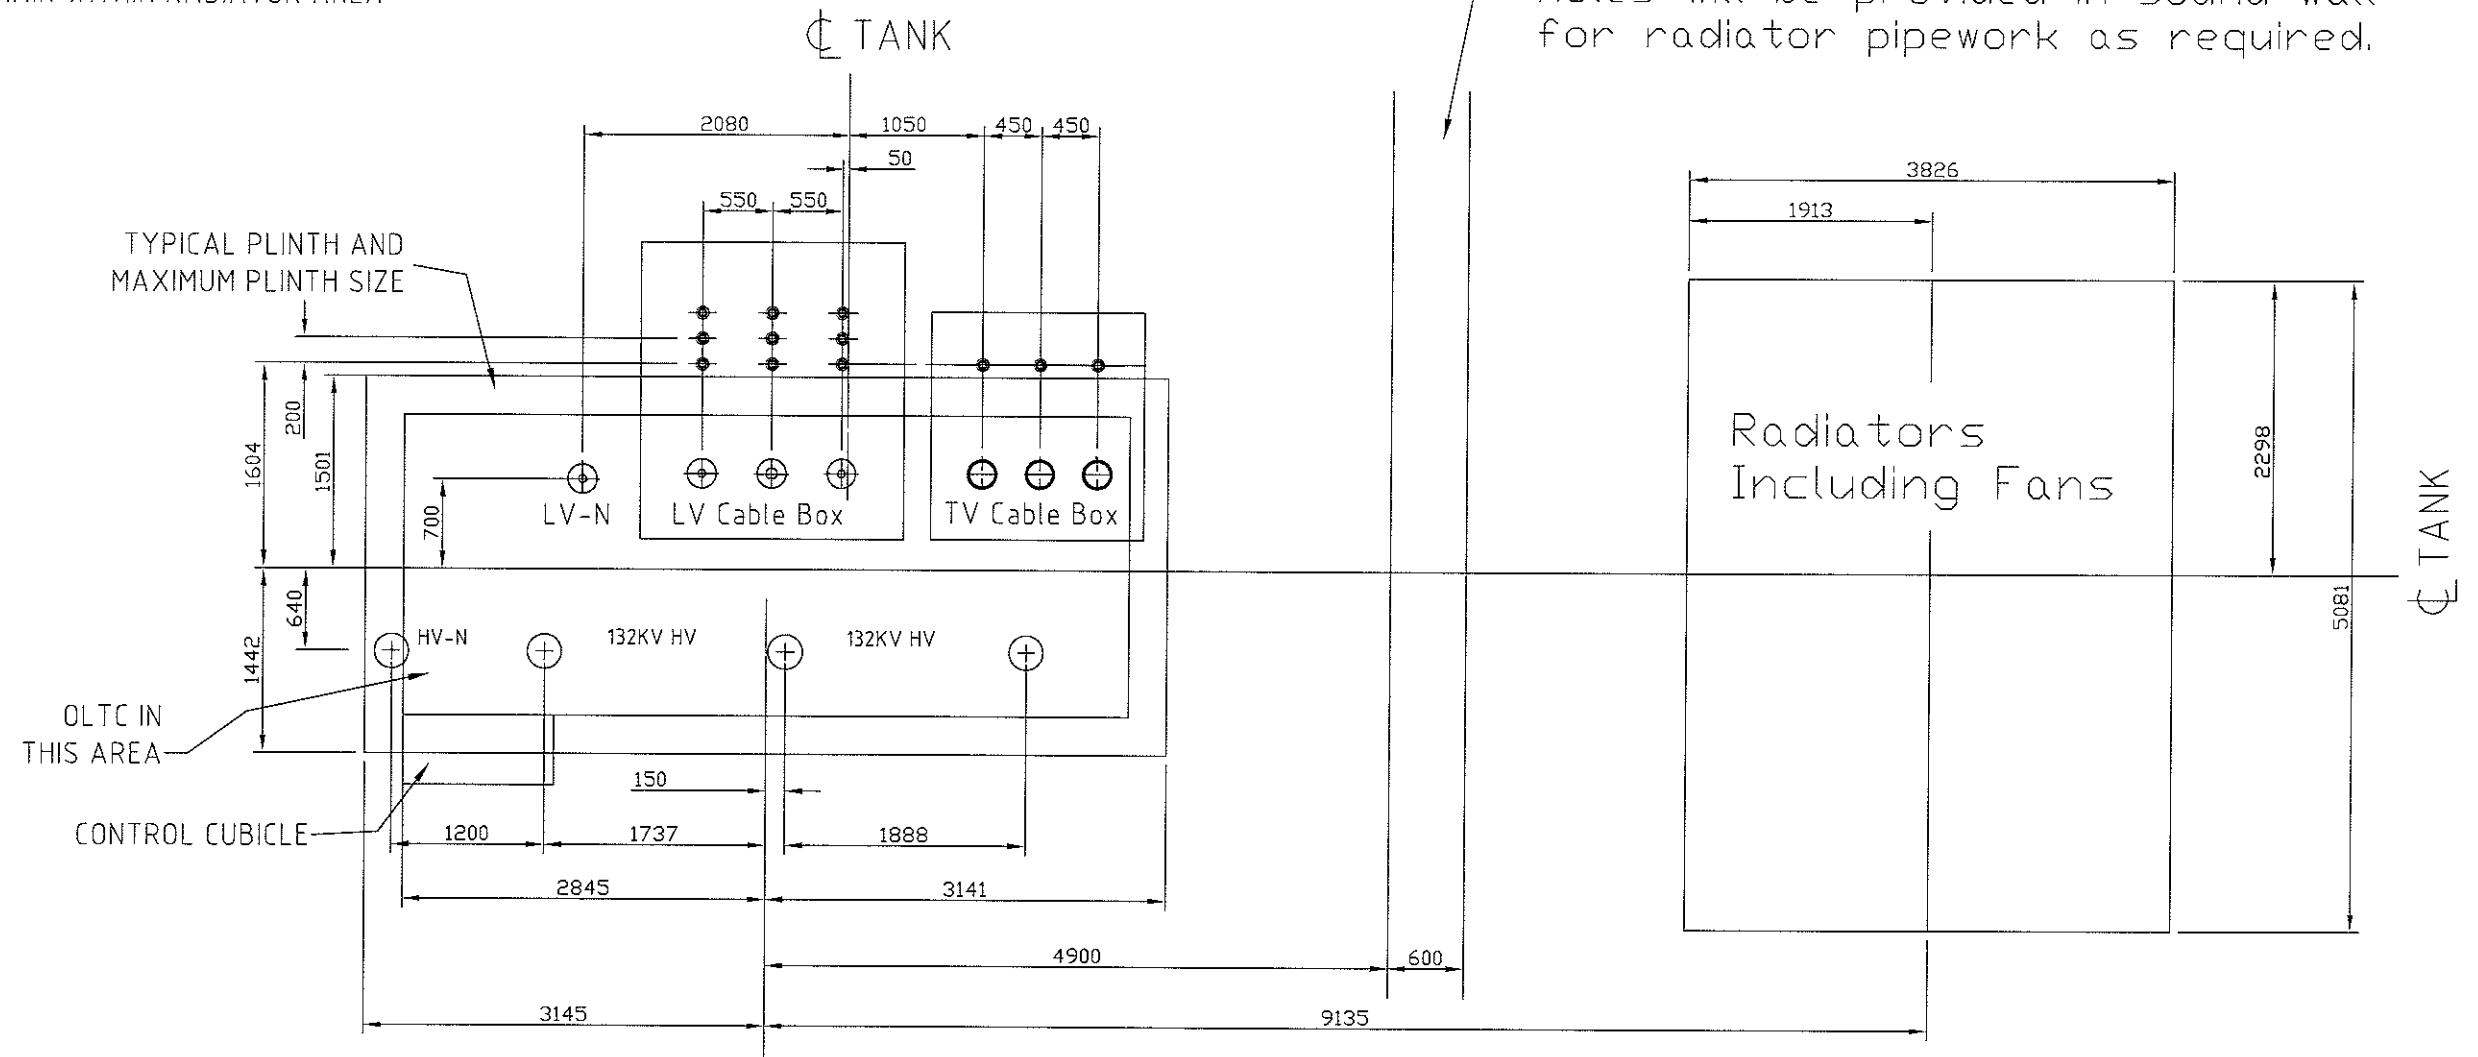

AMENDMENTS	ORIGINAL	ISSUE
A		

	ORIGINAL SCALE	APPROVED
DRAWN	PLE	<i>Glen Perry</i>
DATE	19-10-11	
CH'D	PN	

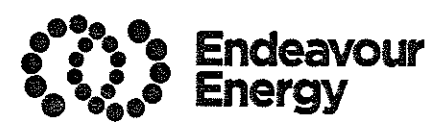

TENDER BASE DESIGN
132/33/11KV TRANSFORMER 120MVA
HV BUSHING & LV CABLE BOX
GENERAL ARRANGEMENT

REFERENCE DRAWINGS	
DO NOT SCALE DIMENSIONS IN MILLIMETRES	AUTHORISED <i>D. Anant</i>
MGR TRANSMISSION PROJECT DEVELOPMENT	Rev. 10.11
A2	365358
SHEET No 1 OF 1 SHEETS	