

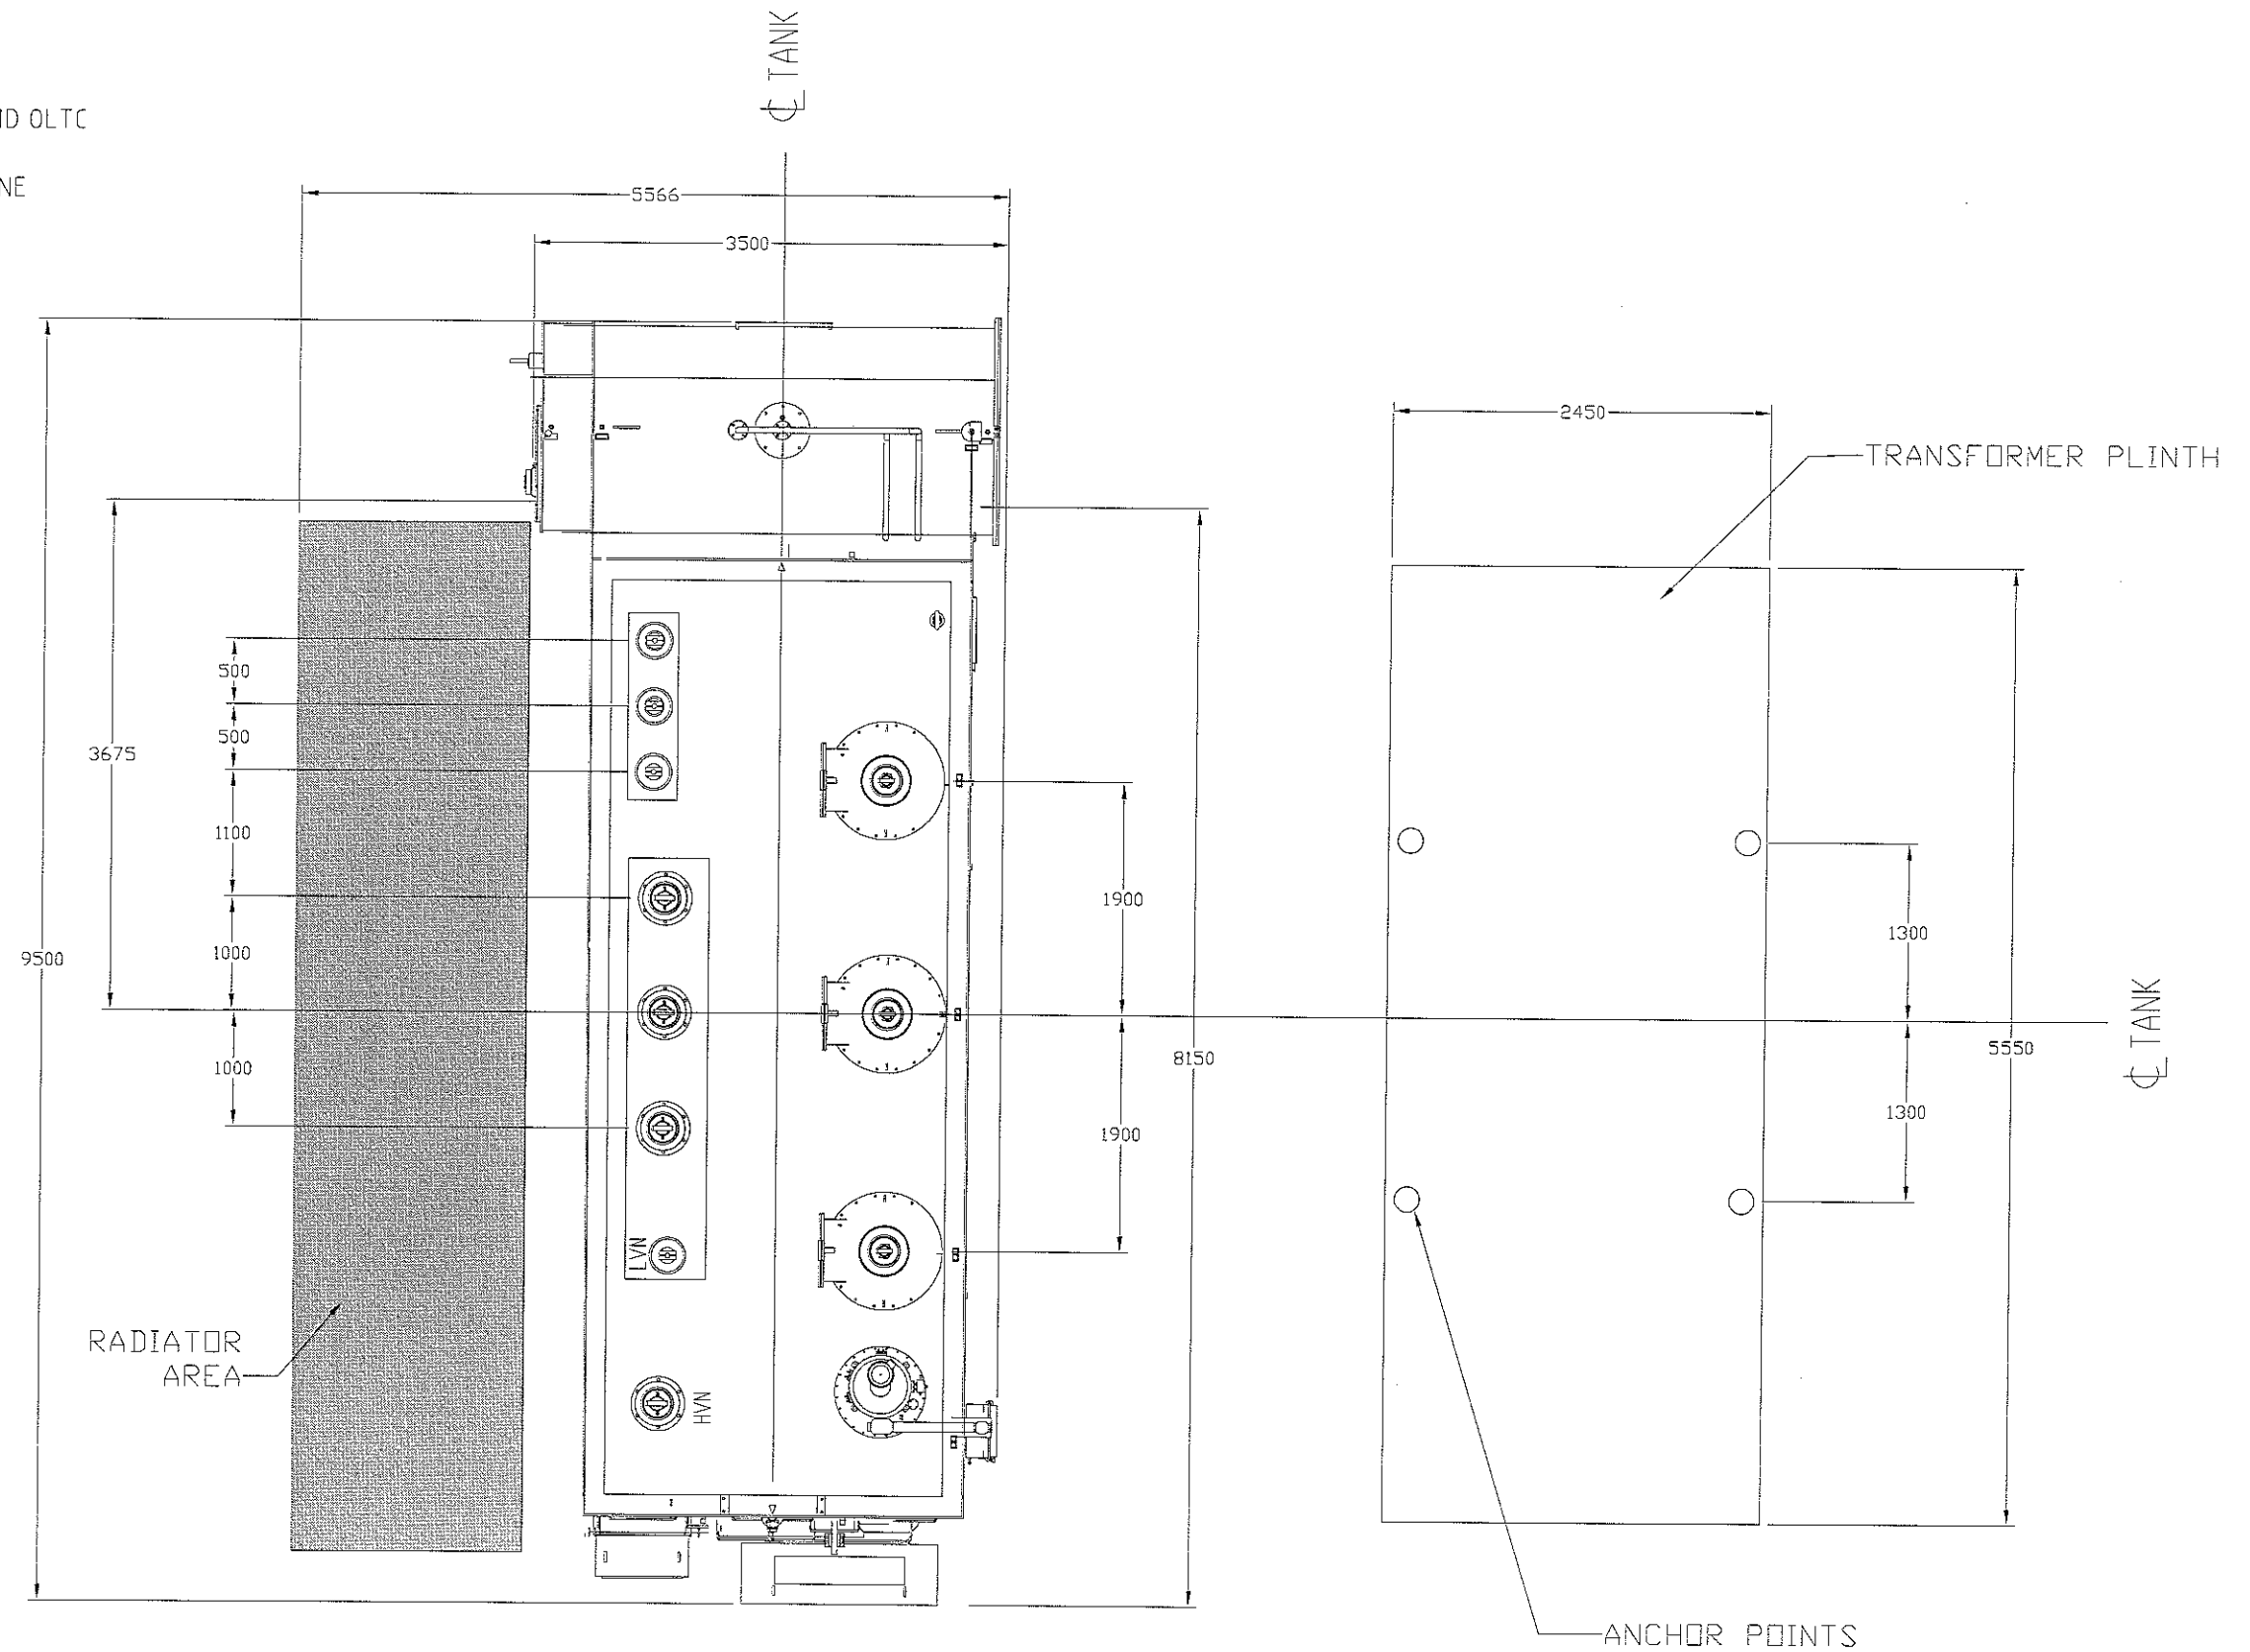


NOTES:


- THE FOLLOWING CRITERIA ARE MANDATORY:
 - BUSHING LOCATIONS
 - CABLE LOCATIONS AND QUANTITY
 - GENERAL LOCATIONS OF CONTROL CUBICLE AND OLTC
- TANK SIZE TO REMAIN WITHIN DOTTED PLINTH LINE
- RADIATORS TO REMAIN WITHIN RADIATOR AREA



		This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.	
	ORIGINAL SCALE	APPROVED	
DRAWN	PLE		
DATE	20-10-11		
CH'D	PN		



TENDER BASE DESIGN
132/66/11KV TRANSFORMER 60MVA & 120MVA
HV BUSHING & LV BUSHING
GENERAL ARRANGEMENT

REFERENCE DRAWINGS			
DO NOT SCALE DIMENSIONS IN MILLIMETRES		AUTHORIZED 	
MGR TRANSMISSION PROJECT DEVELOPMENT		26.10.11	
A2	365360	Rev.	A
SHEET No 1 OF 1 SHEETS			