

NOTES:

THE FOLLOWING CRITERIA ARE MANDATORY:

1) A- BUSHING LOCATIONS
   B- CABLE LOCATIONS AND QUANTITY
   C- GENERAL LOCATIONS OF CONTROL CUBICLE AND OLTC
2) TANK SIZE
3) RADIATORS TO REMAIN WITHIN RADIATOR AREA

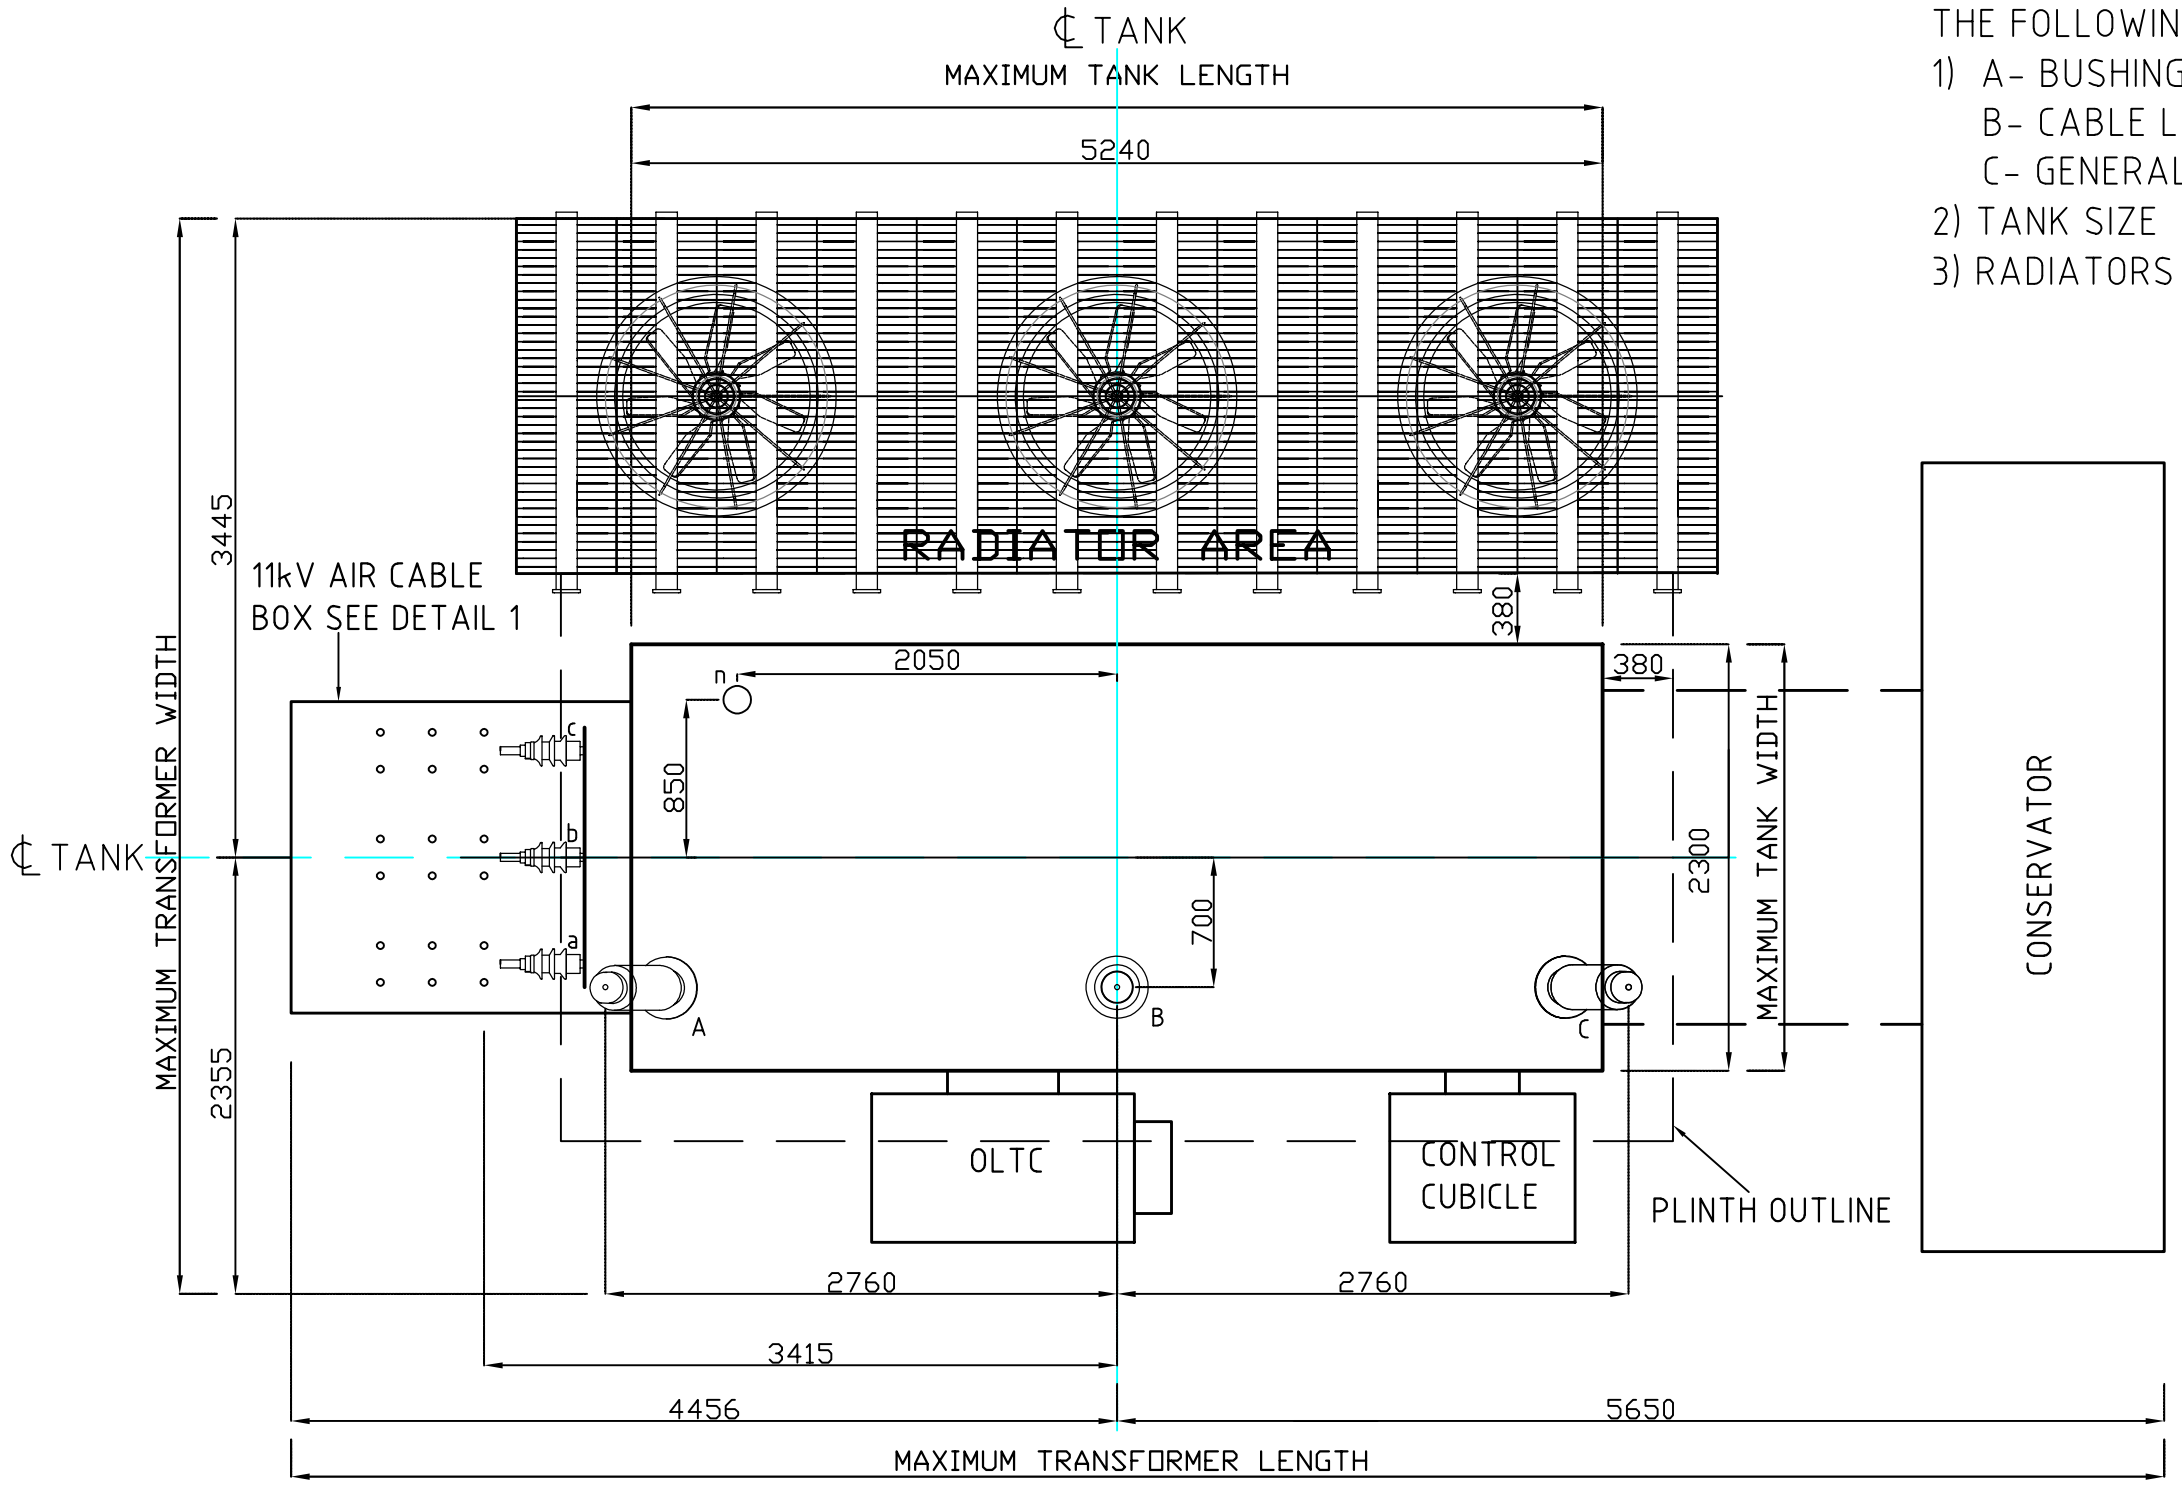

DETAIL 1: 11kV AIR CABLE BOX

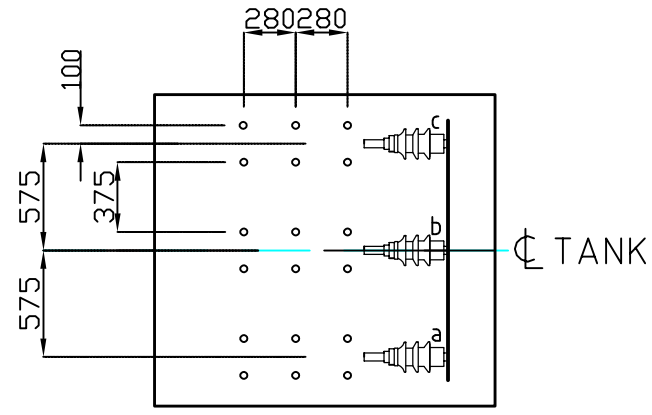

© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

ORIGINAL SCALE	
APPROVED	P.RAMSAY
DRAWN	D.BAJIC
DATE	26-02-25
CH'D	

Endeavour Energy

REFERENCE DRAWINGS

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

AUTHORISED

TENDER BASE DESIGN
TRANSFORMER 132/11kV 45MVA
HV BUSHING & LV CABLE ATTACHED RADIATOR
GENERAL ARRANGEMENT

A2 | 536523 | Rev. A

SHEET No 1 OF 1 SHEETS

AMENDMENTS: A ORIGINAL ISSUE — Job No.

FRAME_A2.DWG_v1.0