


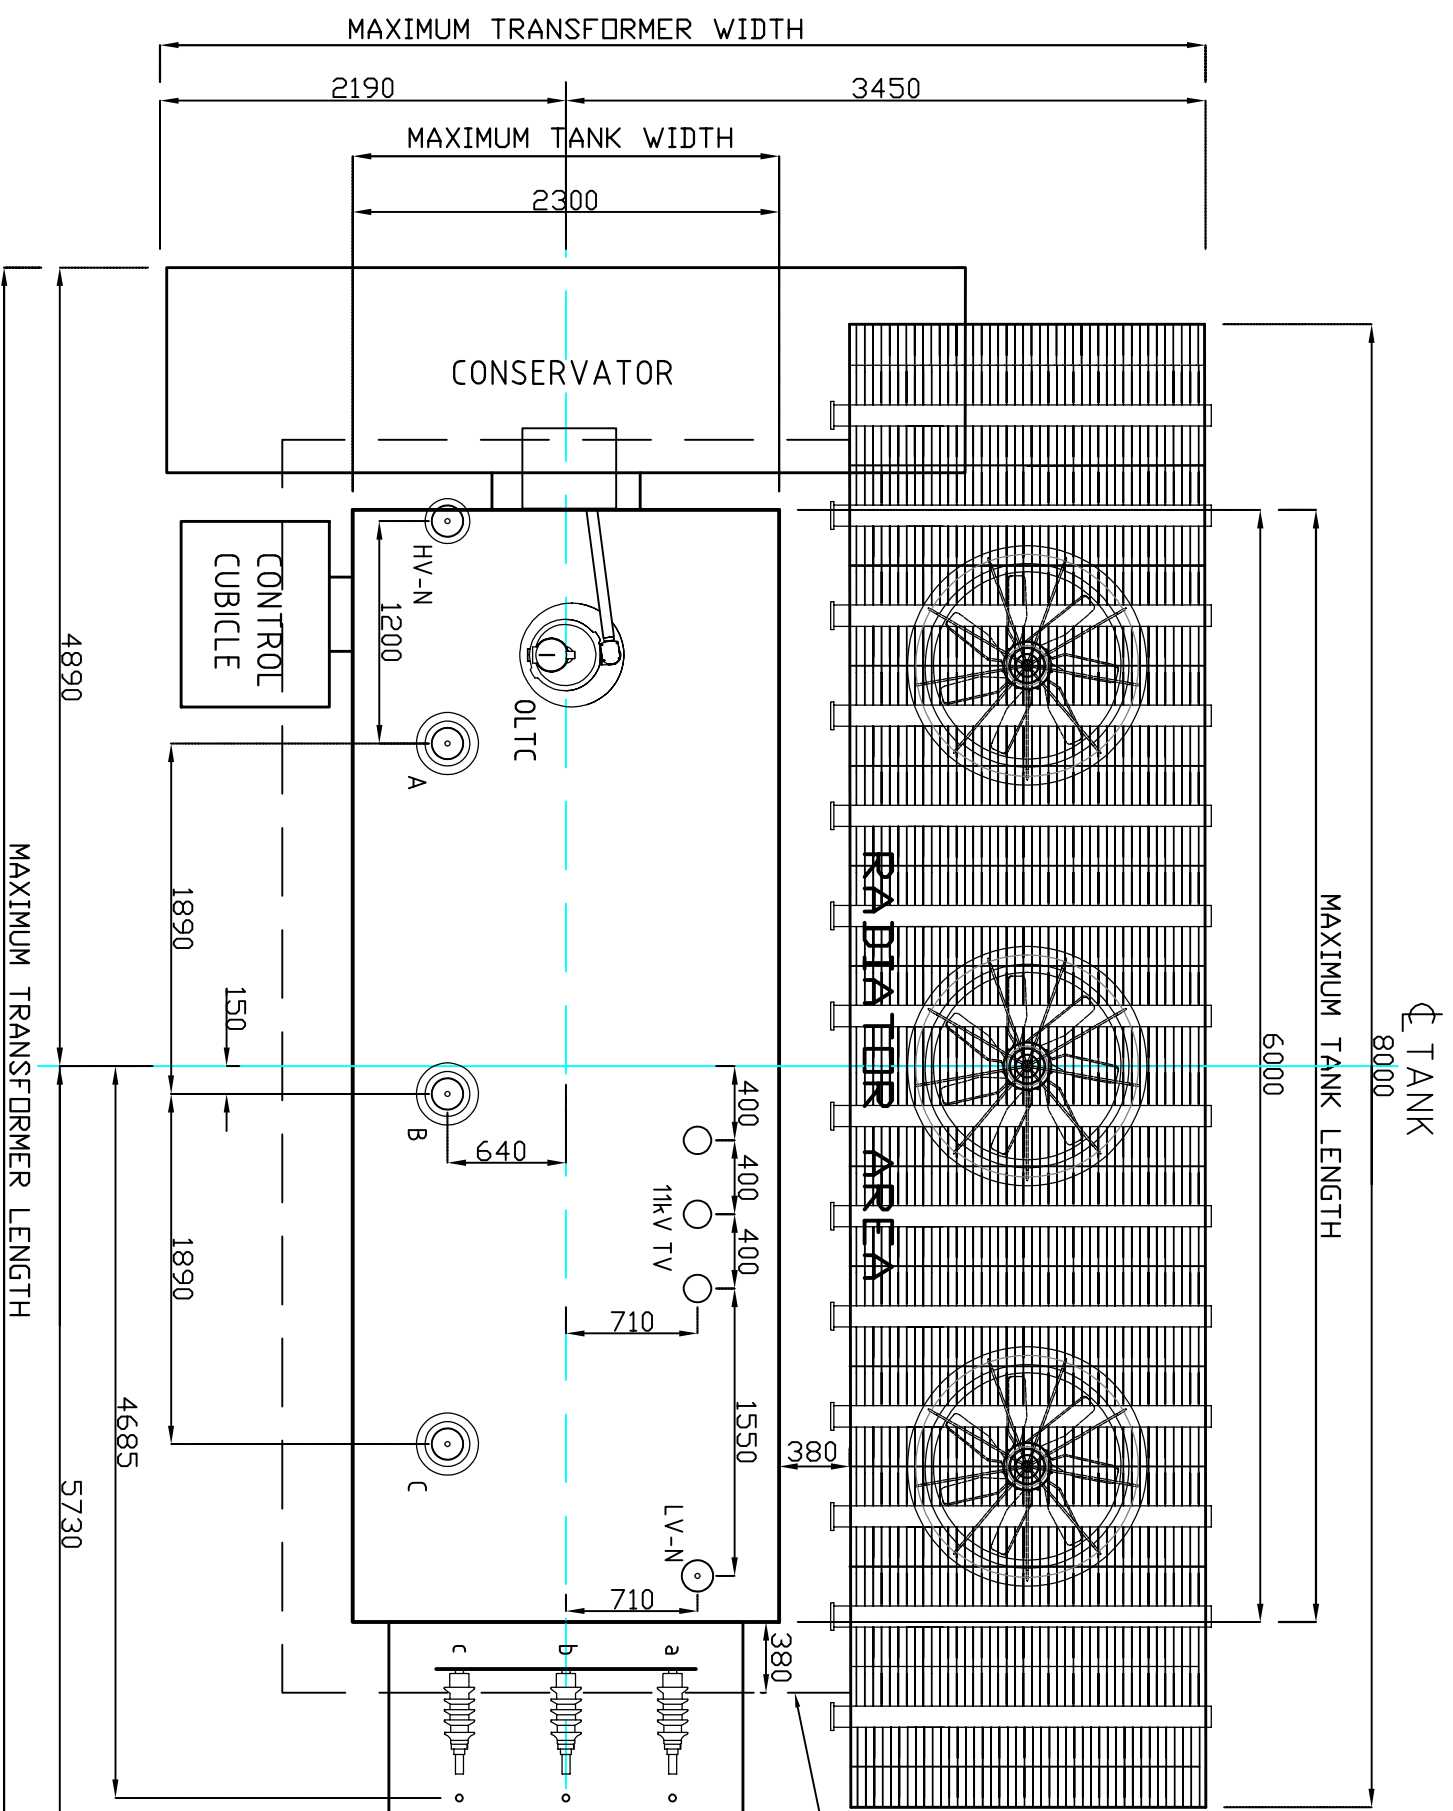

₹ TANK
8000


MAXIMUM TANK LENGTH

600

RADIATOR AREA

PLINTH OUTLINE

DETAIL 1: 33kV AIR CABLE BOX

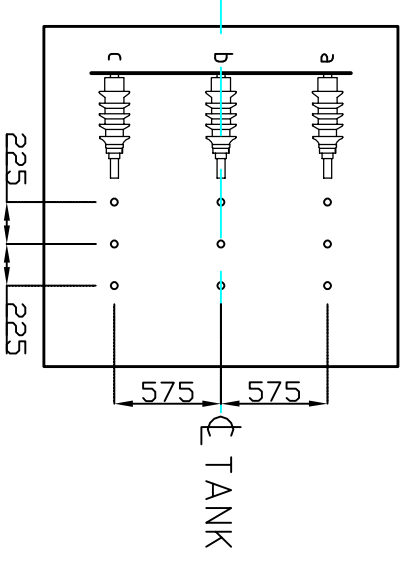

33KV AIR CABLE
BOX SEE DETAIL 1

AMENDMENTS	
A	ORIGINAL ISSUE
Job No.	

	The drawing and the copyright therein are the property of Endeavour Energy. It may not be reproduced, distributed, leased or used without the written consent of Endeavour Energy.
	ORIGINAL SCALE
	DRAWN DBA/JIC
	DATE 20-03-25
	CHD



TENDER BASE DESIGN
TRANSFORMER 132/33/11kV 120MVA
HV BUSHING & LV CABLE ATTACHED RADIATOR
GENERAL ARRANGEMENT

REFERENCE DRAWINGS			
DO NOT SCALE DIMENSIONS IN MILLIMETRES		AUTHORISED	
GN			
V 120WVA SCHED RADIATOR MENT			
A2			
536525		Rev.	
SHEET No 1 OF 1 SHEETS		A	