

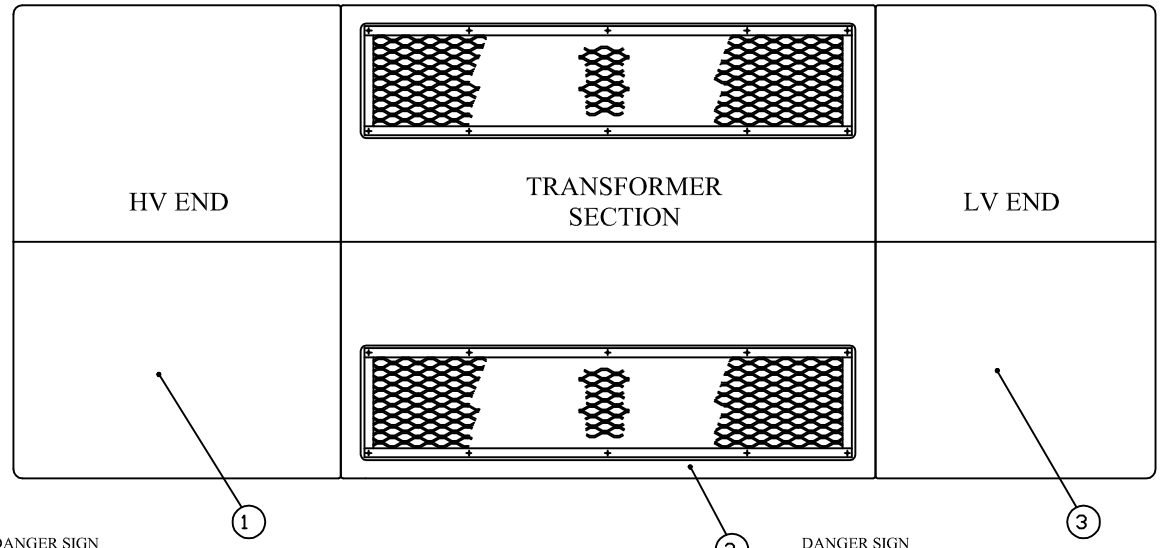



NOTES

1. THIS DRAWING TO BE USED IN CONJUNCTION WITH THE RELEVENT Endeavour Energy PADMOUNT SUBSTATION CUBICLE SPECIFICATION
2. THE REAR VIEW NOT DRAWN IS A MIRROR IMAGE OF FRONT VIEW SHOWN.
3. "DANGER HIGH VOLTAGE" SIGNS AND SUBSTATION NUMBERS TO BE FITTED ON ALL DOORS AS SHOWN.
4. SIGNS & NUMBERS TO BE FITTED BY WORKSHOP STAFF PRIOR TO ISSUE.
5. LETTER "M" TO BE AFFIXED TO LOW VOLTAGE DOOR WHICH ALLOWS ACCESS FOR THE READING OF MAXIMUM DEMAND INDICATORS.

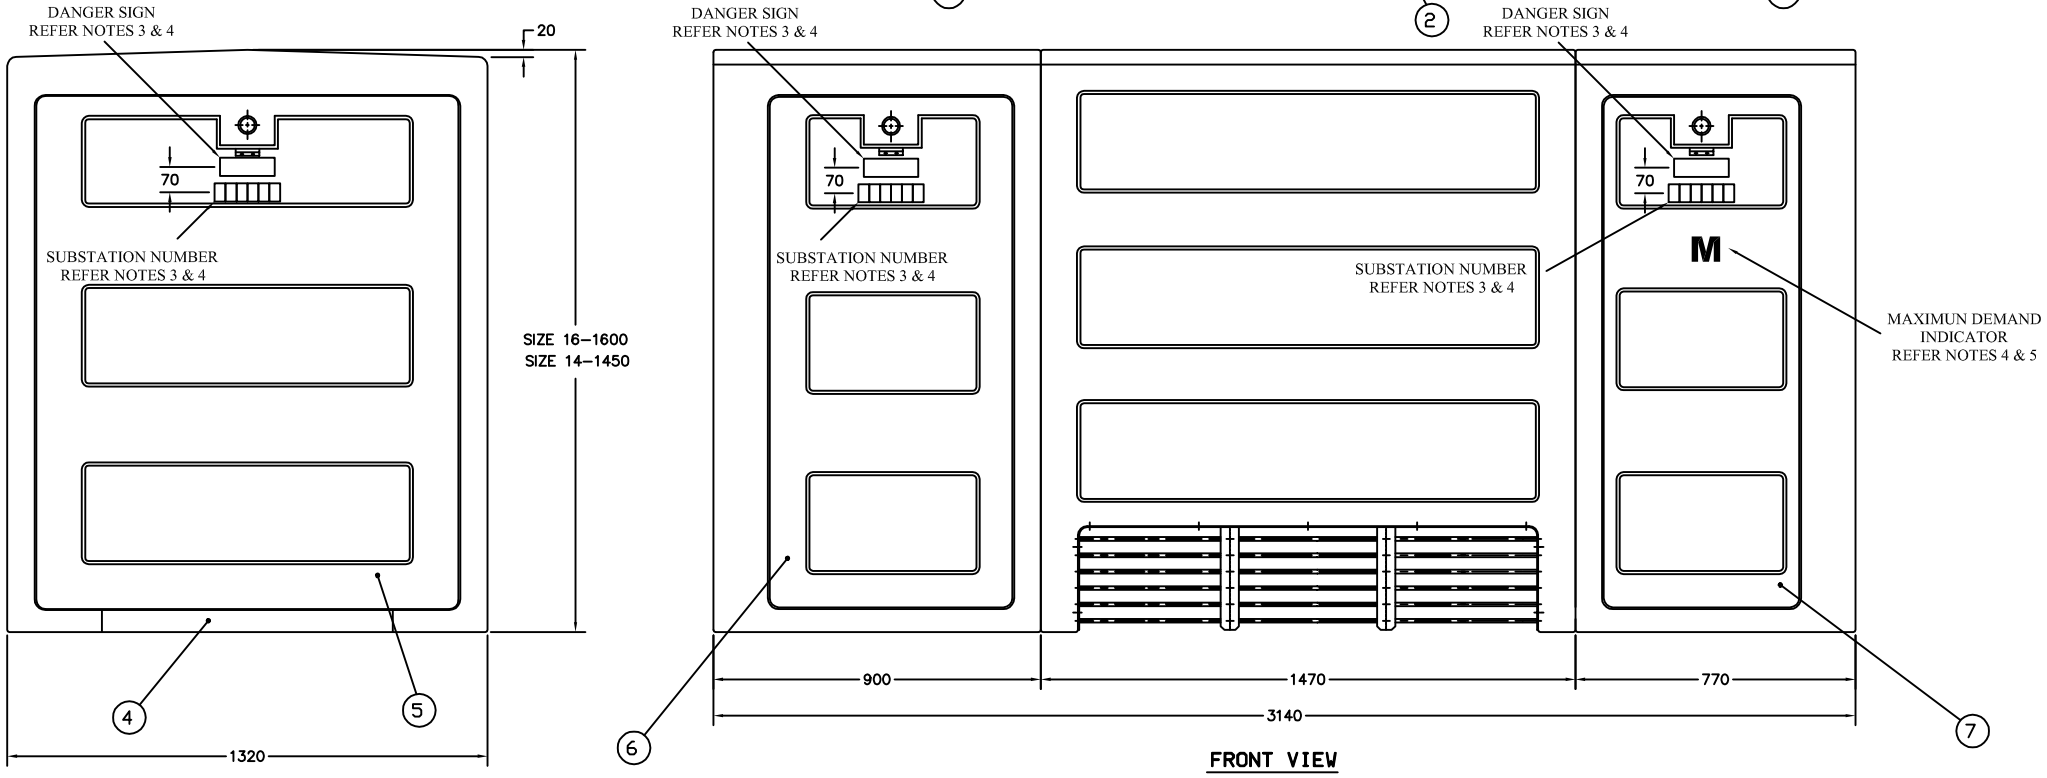


FRONT VIEW

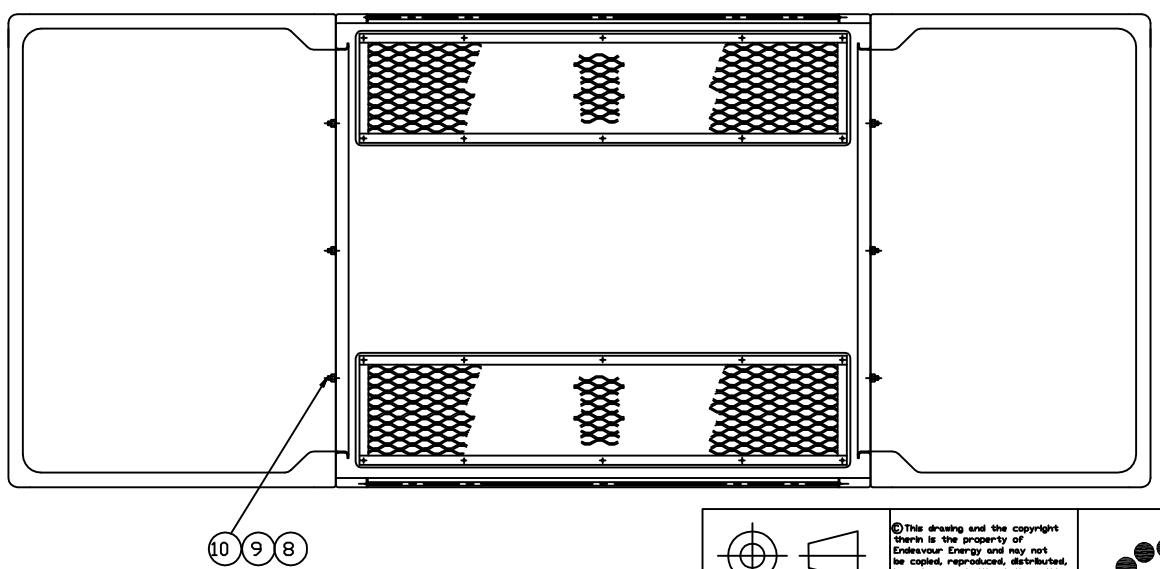


| ITEM NO | VOCAB / DRG | DESCRIPTION | QTY | REFER |
|---|---|---|---|---|
| 1 | NA | HIGH VOLTAGE COMPARTMENT | 1 | DRG 264891 |
| 2 | NA | TRANSFORMER COMPARTMENT | 1 | DRG 264888 |
| 3 | NA | LOW VOLTAGE COMPARTMENT | 1 | DRG 264891 |
| 4 | NA | REMOVABLE BOTTOM MULLION | 2 | DRG 264891 |
| 5 | NA | DOOR CUBICLE END HV & LV | 2 | DRG 264890 |
| 6 | NA | DOOR CUBICLE SIDE HIGH VOLTAGE | 2 | DRG 264890 |
| 7 | NA | DOOR CUBICLE SIDE LOW VOLTAGE | 2 | DRG 264890 |
| 8 | NA | WASHER ROUND FLAT GALV M10 | 18 | – |
| 9 | NA | WASHER SPRING GALV M10 | 18 | – |
| 10 | NA | NUT HEX HD GALV M10 | 18 | – |

AMENDMENTS

| | | | |
|---|---|---|---|
| A | ORIGINAL ISSUE | | |
| B | DR'N | GSF | |
| | CH'D | GSF | |
| | DATE | 01-10-03 | |
| | JR No | – – | |
| | SIZE 14 HEIGHT NOW 1450MM. | | GSF |
| | MDEB | | |

©This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

ORIGINAL SCALE

APPROVED G. Ford

| | | | |
|---|---|---|---|
| DRAWN | G. Ford | | |
| DATE | 10/08/2001 | | |
| CH'D | G. Ford | | |

Endeavour Energy

REFER MATERIAL LIST

STEELWORK DETAILS 264889

REFERENCE DRAWINGS

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

AUTHORISED
W. Isley
MANAGER ASSET SERVICES 10/08/2001

SIZE 14 & 16 – PADMOUNT SUBSTATION
FIBREGLASS CUBICLE
GENERAL ARRANGEMENT

A3 264887 B

SHEET No 1 OF 1 SHEETS