



AMENDMENTS		
A	ORIGINAL ISSUE	
	J R No.	930131
B	DR'N	R.M.M
	CH'D	J.K
	DATE	22-4-94
	JR No	940053
DRG FRAME WAS 'A3'.		
S.D.M.		J.K
C	DR'N	D.J.Z
	CH'D	J.K
	DATE	05-6-95
	JR No	950111
LV NEUTRAL BUSHING REPOSITIONED. DIM 40 MIN WAS 25 MIN.		
M.S.S.		J.K

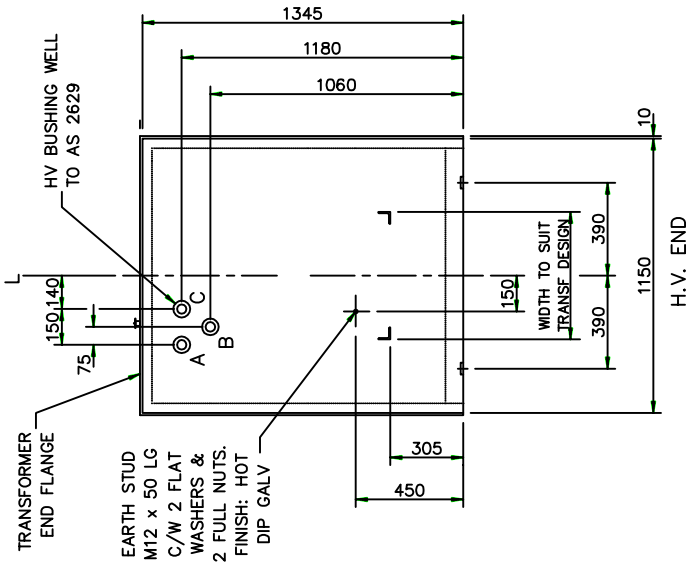

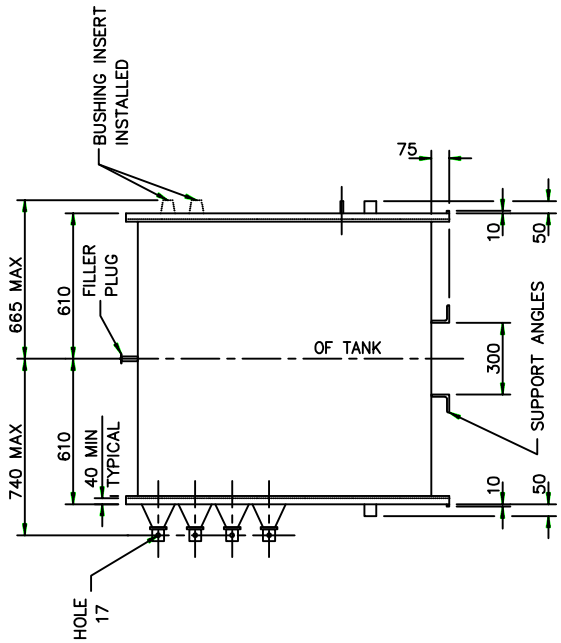

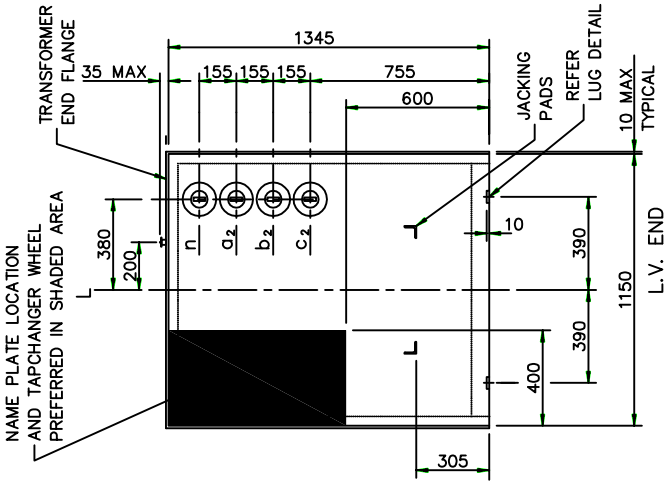

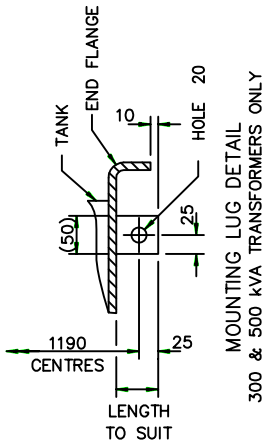

© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

Endeavour Energy

ORIGINAL SCALE	NONE	APPROVED	C.Howat
DRAWN	T.A.B.		
DATE	06-9-93		
CH'D	D.J.Z		

REFERENCE DRAWINGS | DRG. NO. | THIS ISSUE PAGE NO

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

A.Walker/C.H
ASSIST. G.M. ENG. 06-9-93

22kV 300 & 500 kVA PADMOUNT TRANSFORMER
HV & LV TERMINATIONS, END FLANGES,
JACKING PADS & TRANSFORMER MOUNTING LUGS
TYPICAL REQUIREMENTS

SUB 076844 C
SHEET No 1 OF 1 SHEETS
INDEX REF S008A

ISSUE IDENTIFICATION | SDI 114
THIS ISSUE
PAGE NO.