




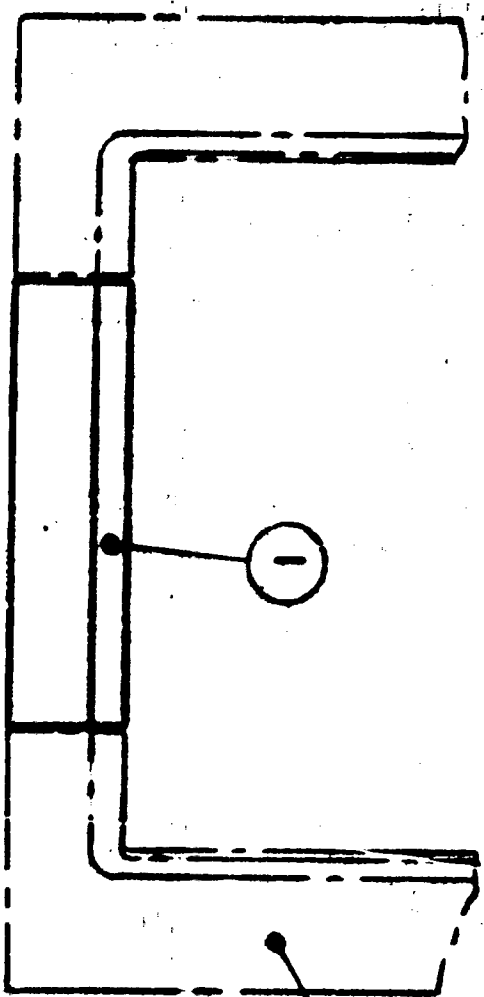


ARRANGEMENT
(OUTSIDE VIEW)

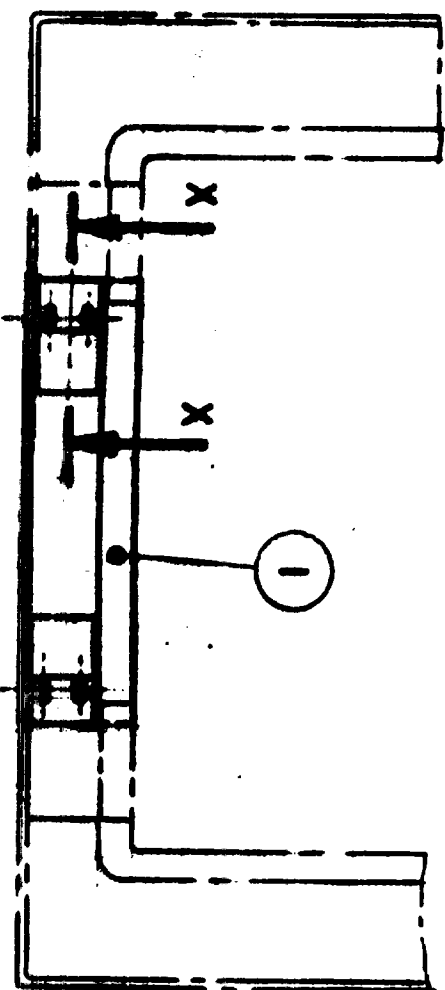


ARRANGEMENT
(INSIDE VIEW)

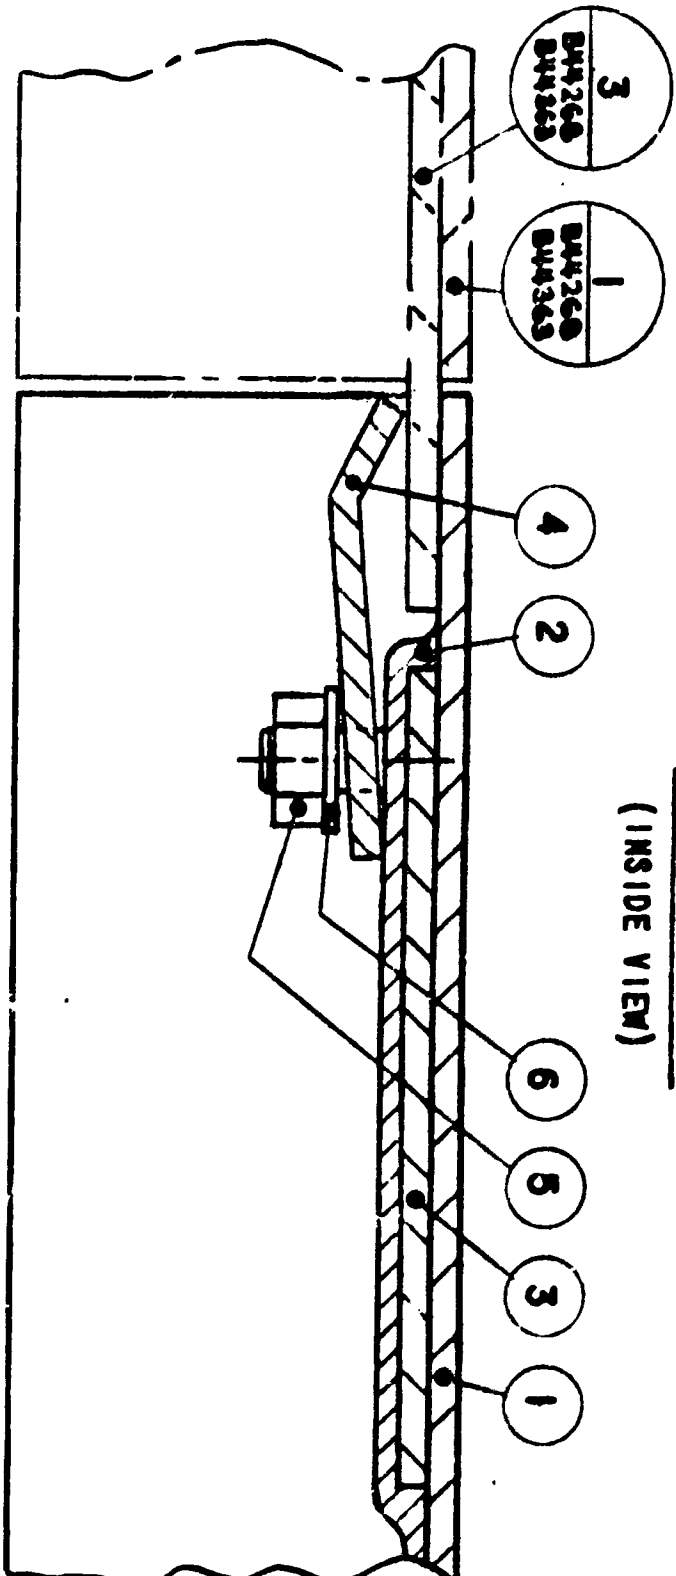

SECTION X-X
SCALE: 1:1

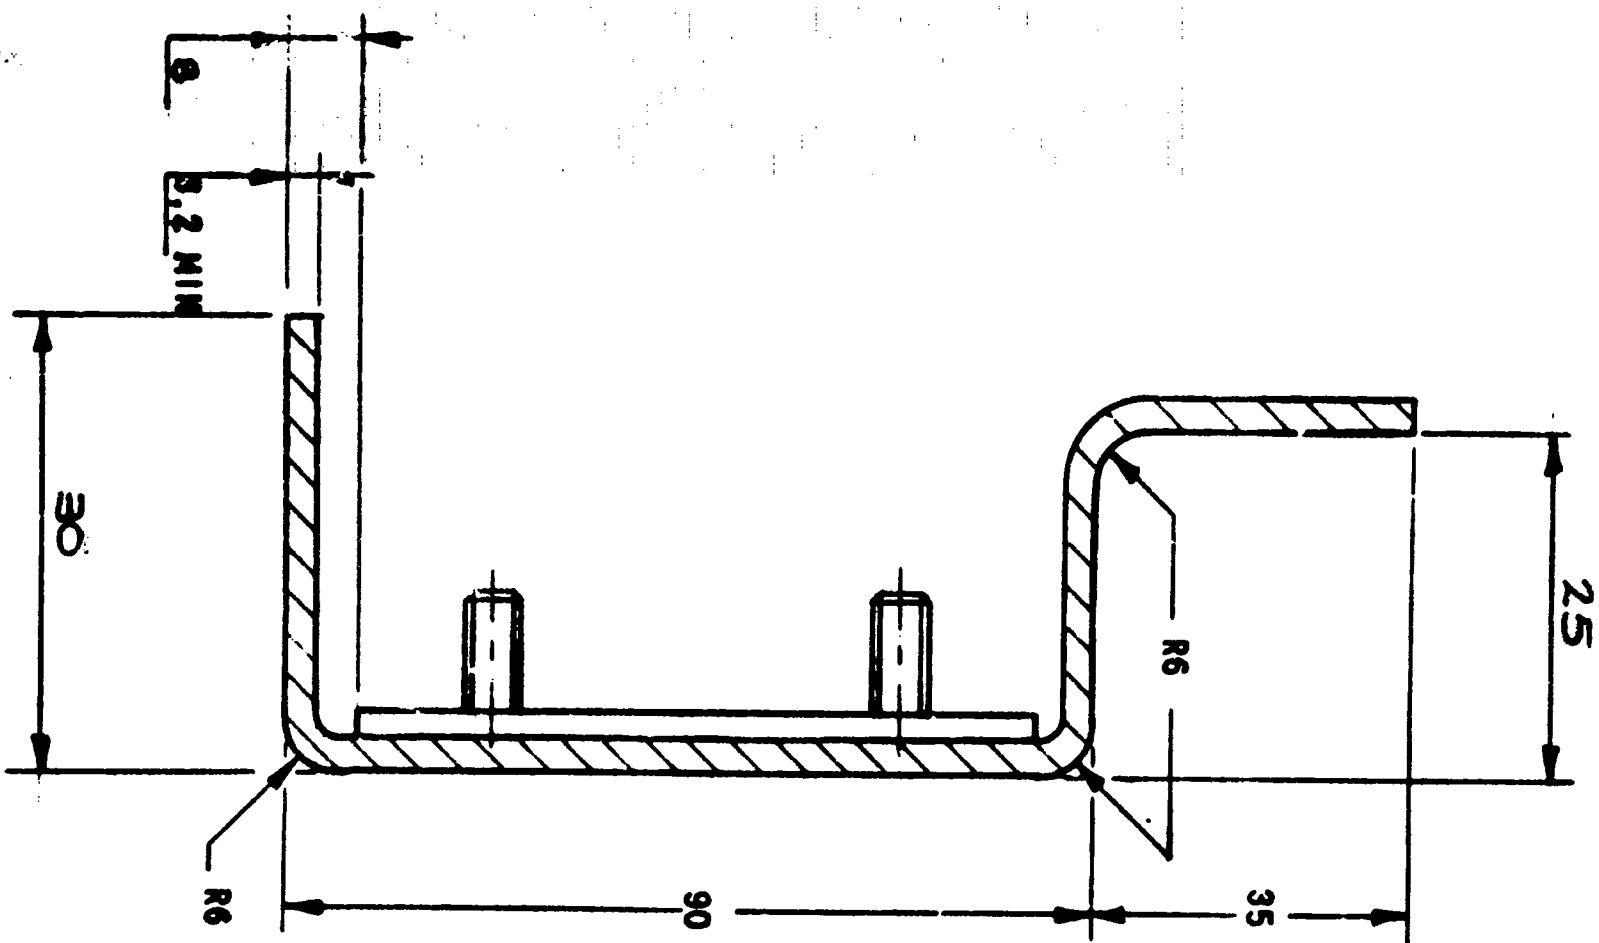

SECTION Y-Y
SCALE: 1:1

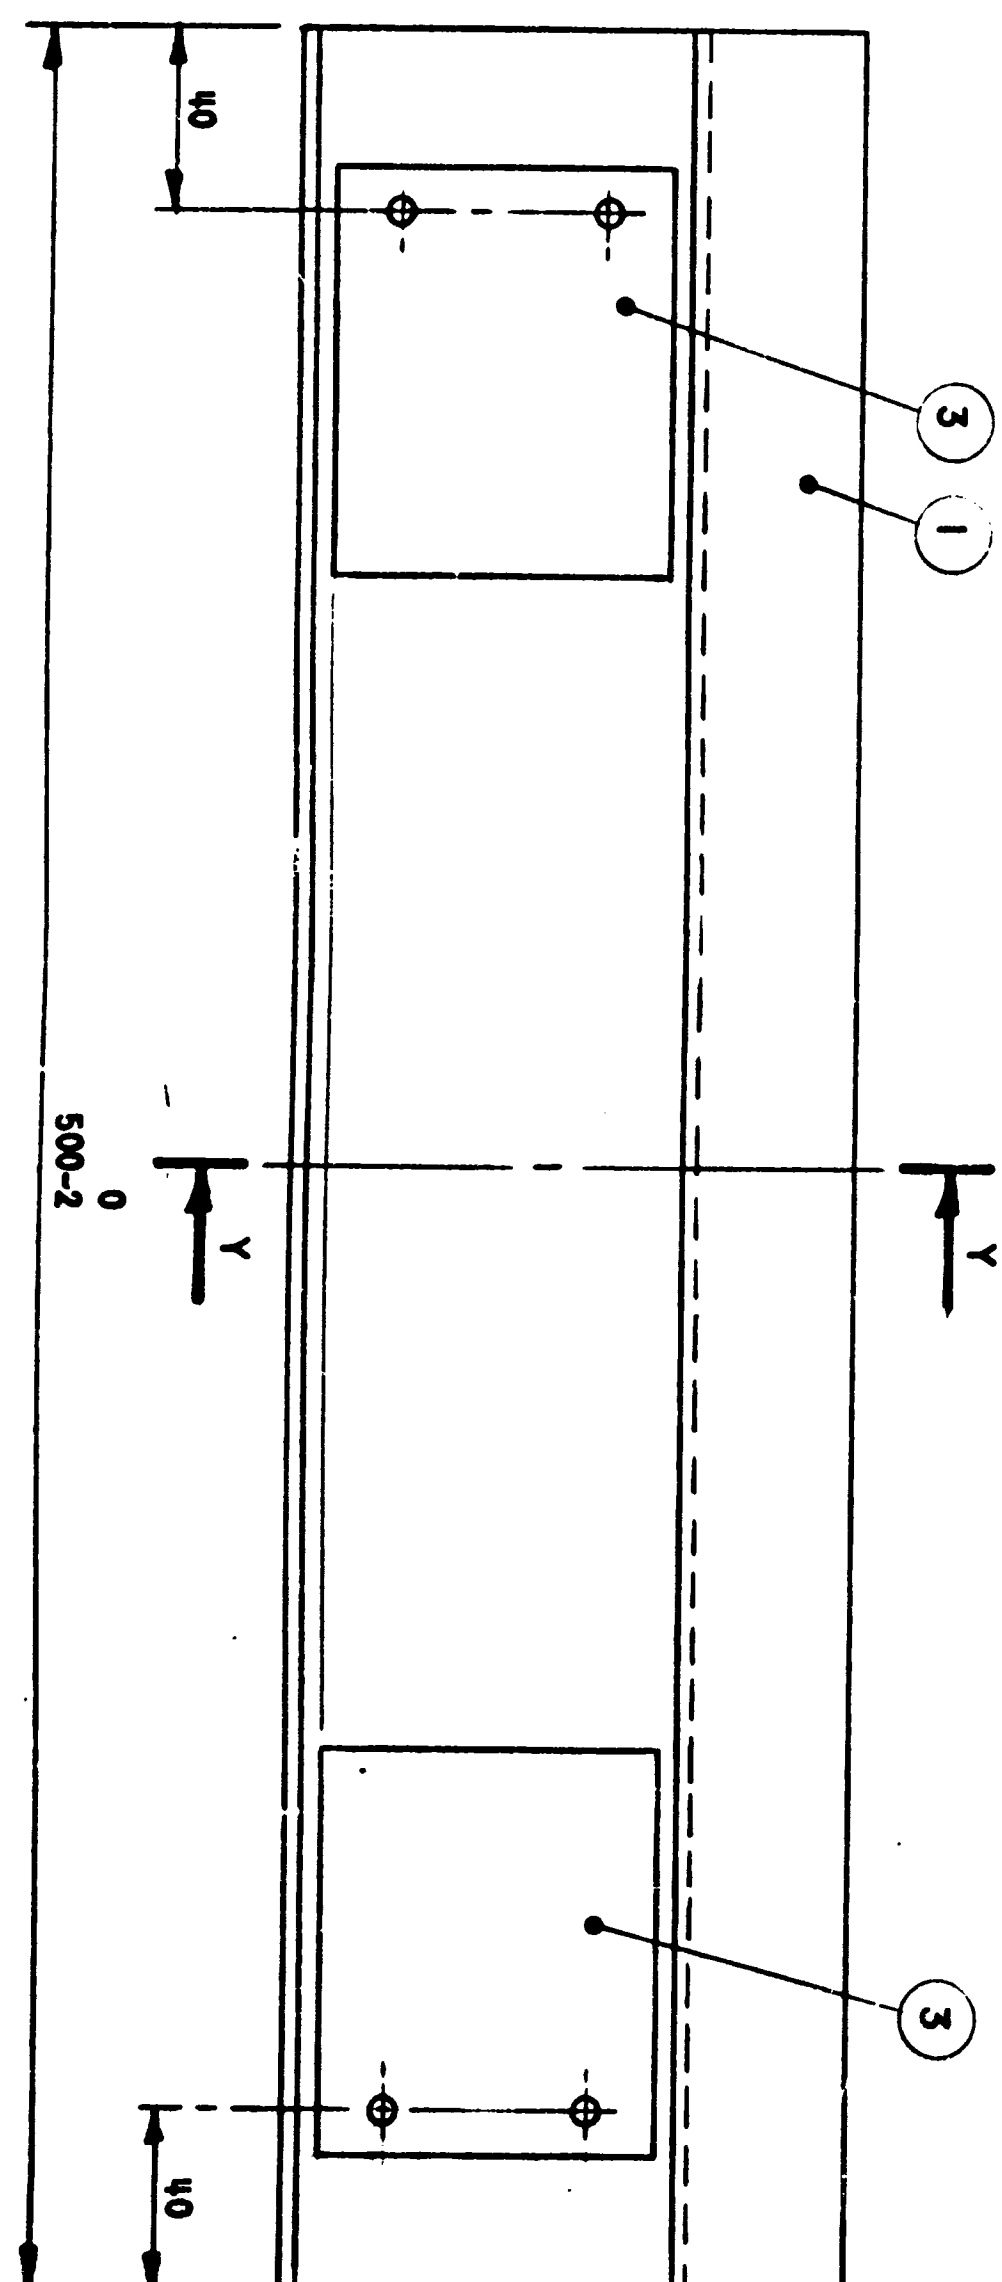

HULLION DETAILS
SCALE: 1:2

- NOTES
- THIS DRAWING TO BE USED IN CONNECTION WITH THE PROSPECT COUNTY COUNCIL SUBSTATION PROCUREMENT SPECIFICATION No 301 "MANUFACTURE OF FIBREGLASS CUBICLES".
 - ITEM 1 (FIBREGLASS SECTION) TO HAVE A MINIMUM WALL THICKNESS OF 3.2 mm (EXCLUDING GELCOAT).
 - ITEM 3 (STUD ANCHOR PLATE) TO BE BONDED TO INSIDE OF ITEM 1 (FIBREGLASS SECTION) USING ITEM 2 (FIBREGLASS LAMINATE).
 - ITEM 2 (FIBREGLASS LAMINATE). SHOWN IN SECTION X-X ONLY, TO GIVE ADEQUATE COVER TO 4 TO BE 50 mm BIGGER ALL AROUND (WHERE POSSIBLE) THAN ITEM 3.

ITEM	DESCRIPTION	QTY
6	WASHER BRASS FLAT	2
5	NUT BRASS HEX	2
4	CLAMP PLATE - MULLION	2
3	ANCHOR PLATE - STUD	2
2	FIBREGLASS LAMINATE	TO SUIT
1	FIBREGLASS SECTION	1

DIMENSIONS IN MILLIMETRES

PROSPECT COUNTY COUNCIL
PADMOUNT SUBSTATION
FIBREGLASS CUBICLE
REMOVABLE BOTTOM HULLION

AMENDMENTS	ORIGINAL	DATE	BY
A			

OFFICER	INITIALS	OFFICER	INITIALS
S.O. ENCL.		CONC. ENCL.	
PLAN ENCL.		M.S.P. ENCL.	
SUB. ENCL.		MAINT. ENCL.	
DIST. ENCL.		DESIGNED	

SCALE	1:10 OR AS SHOWN	DATE	20-12-78
APPROVED	5 GP	CHIEF ELECT. ENCL.	1409
DRAWN	5 GP	DATE	20-12-78
CHECKED	5 GP	DATE	20-12-78
SUP. DRAWN	5 GP	DATE	20-12-78

JOB No.	44338	SHEET No.	3
OF	3	SHEETS	3