
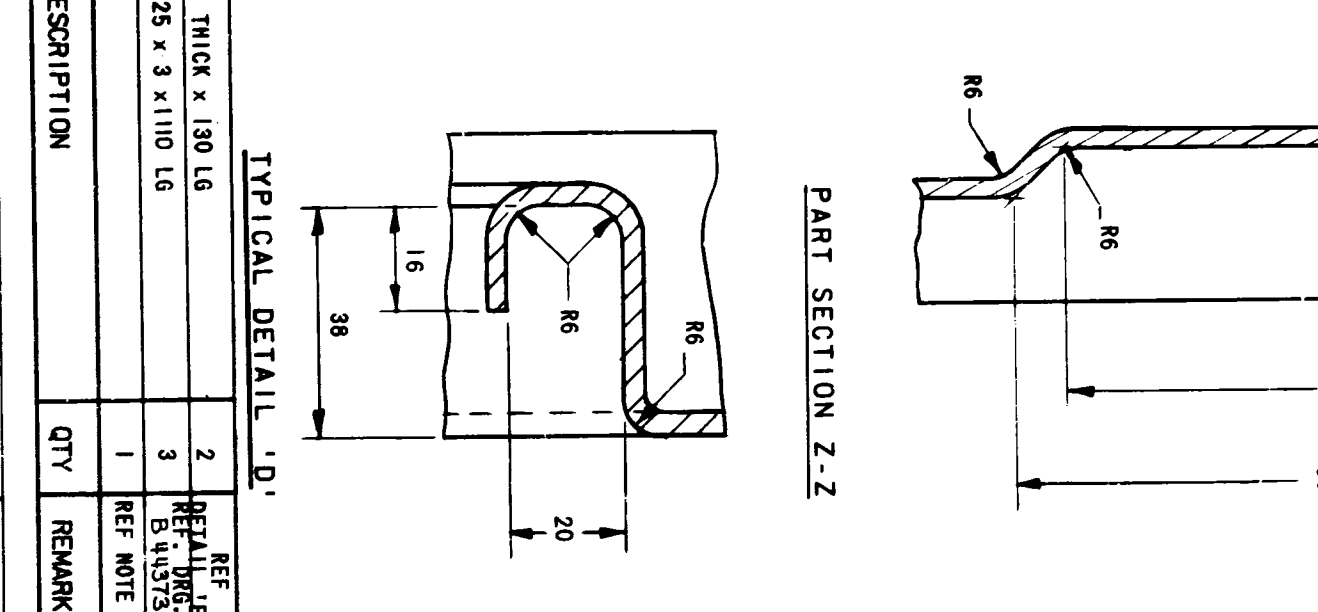
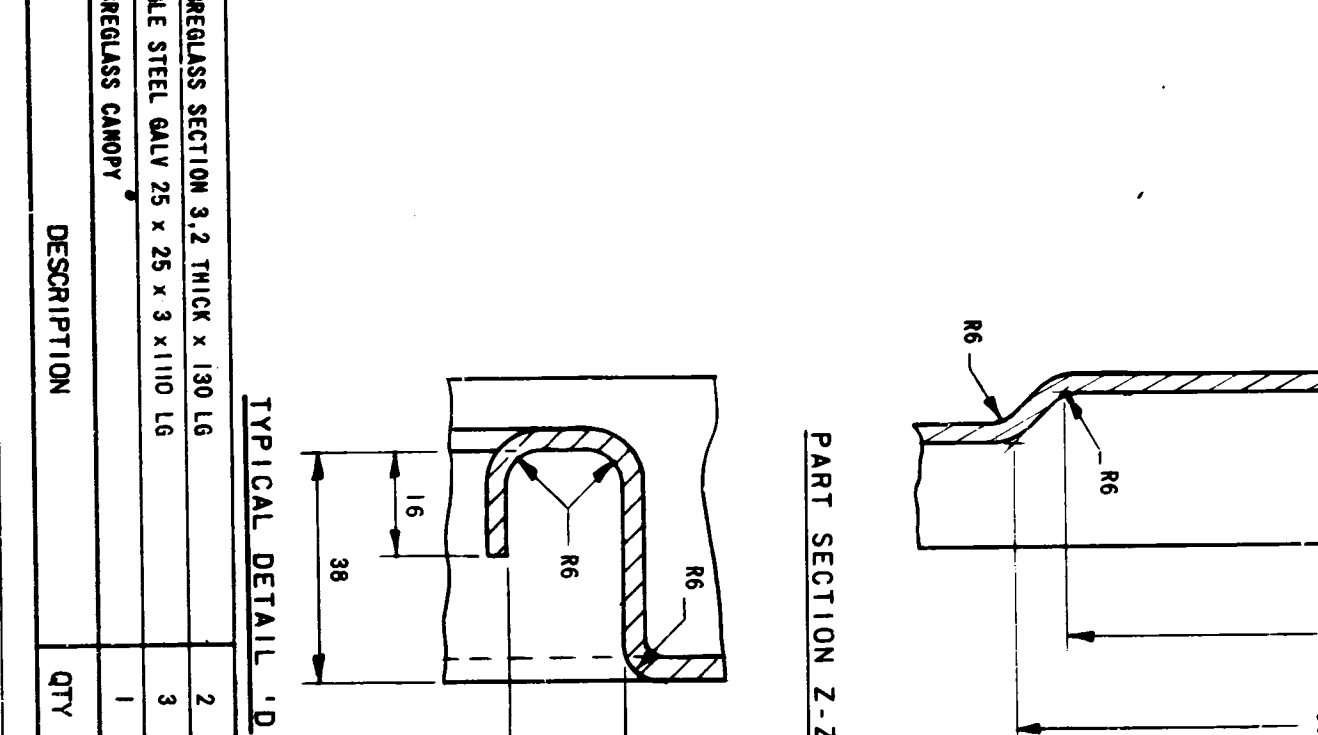
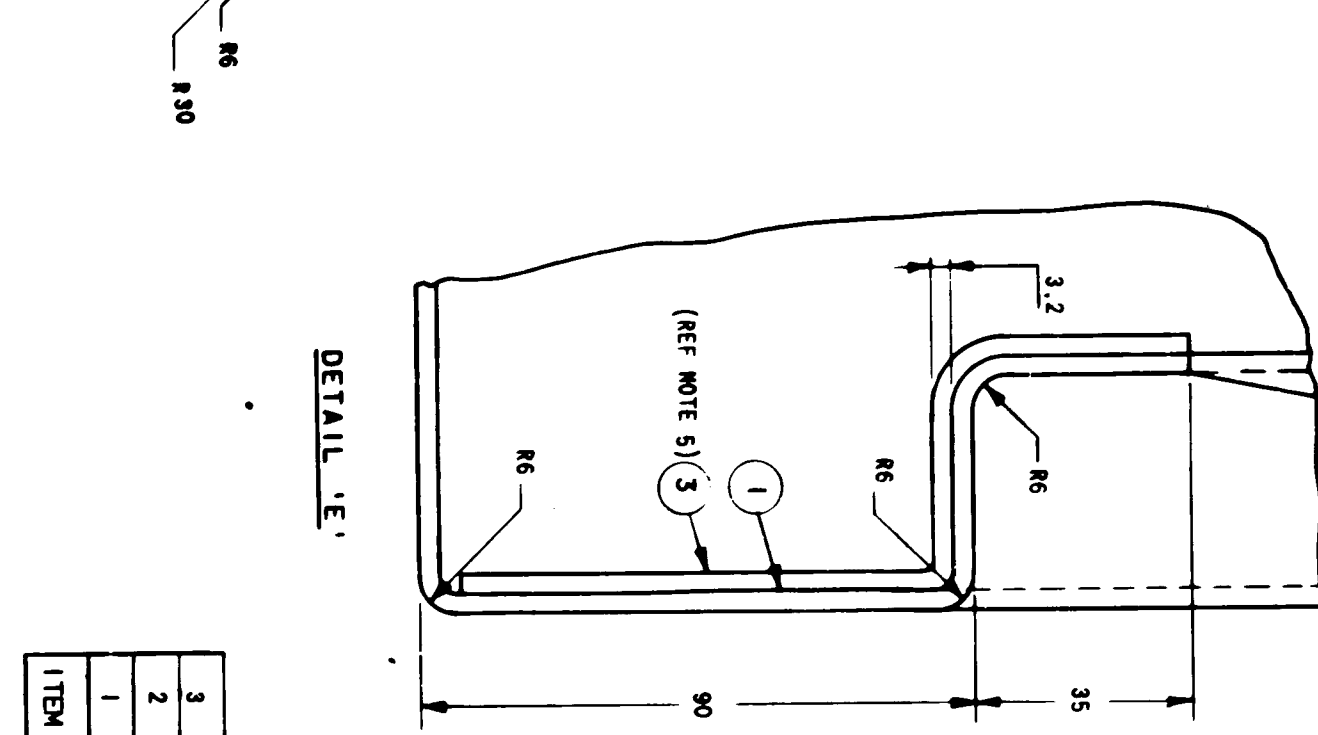
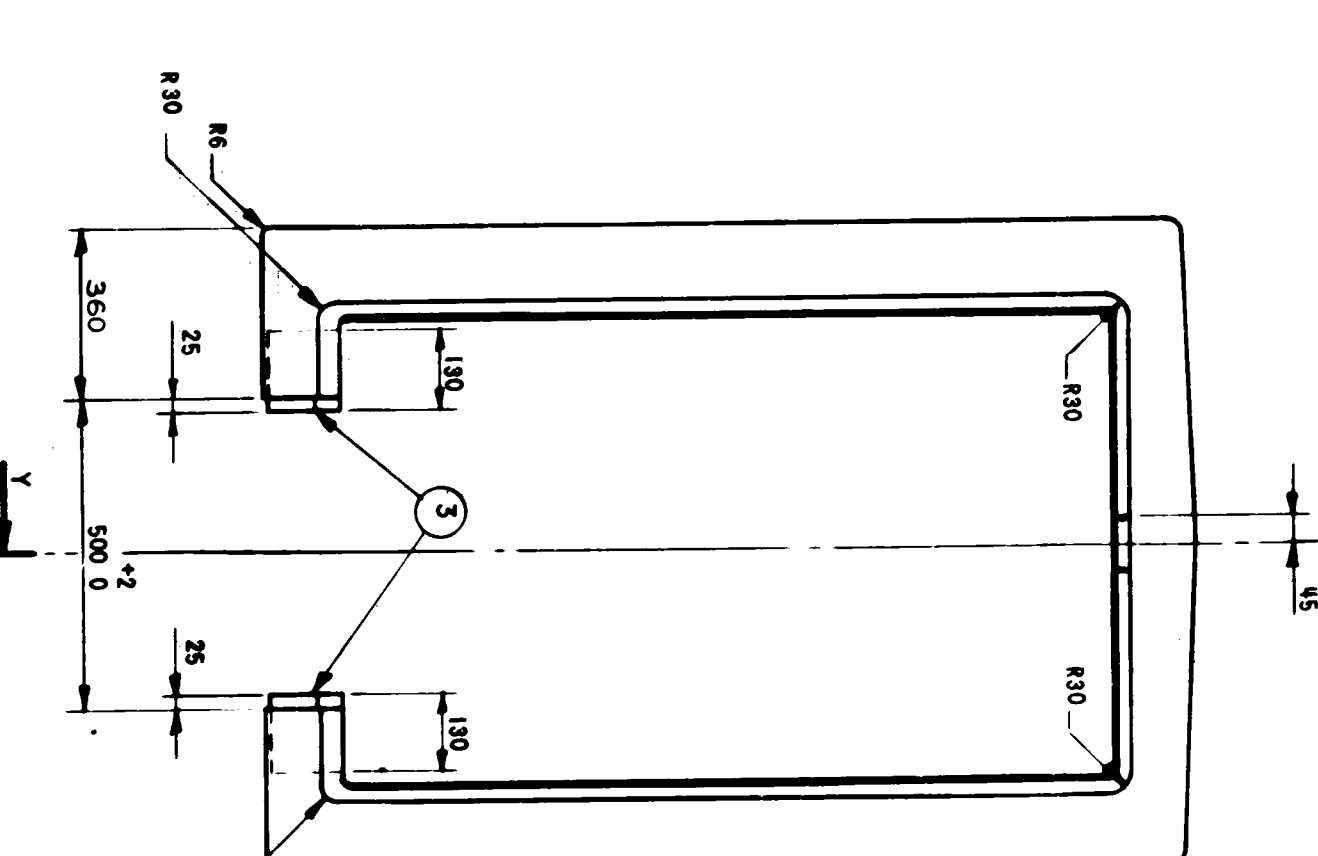
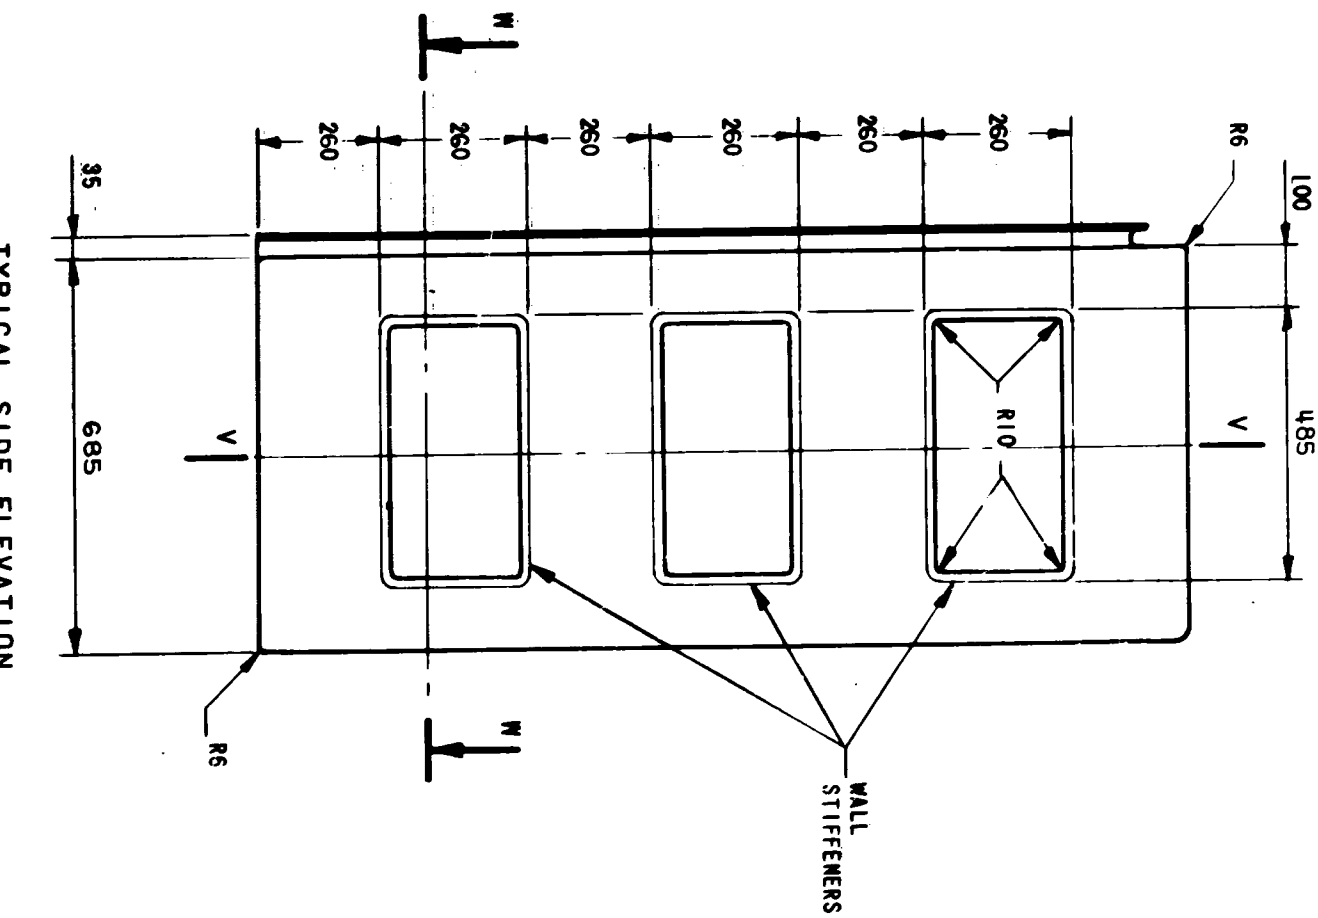
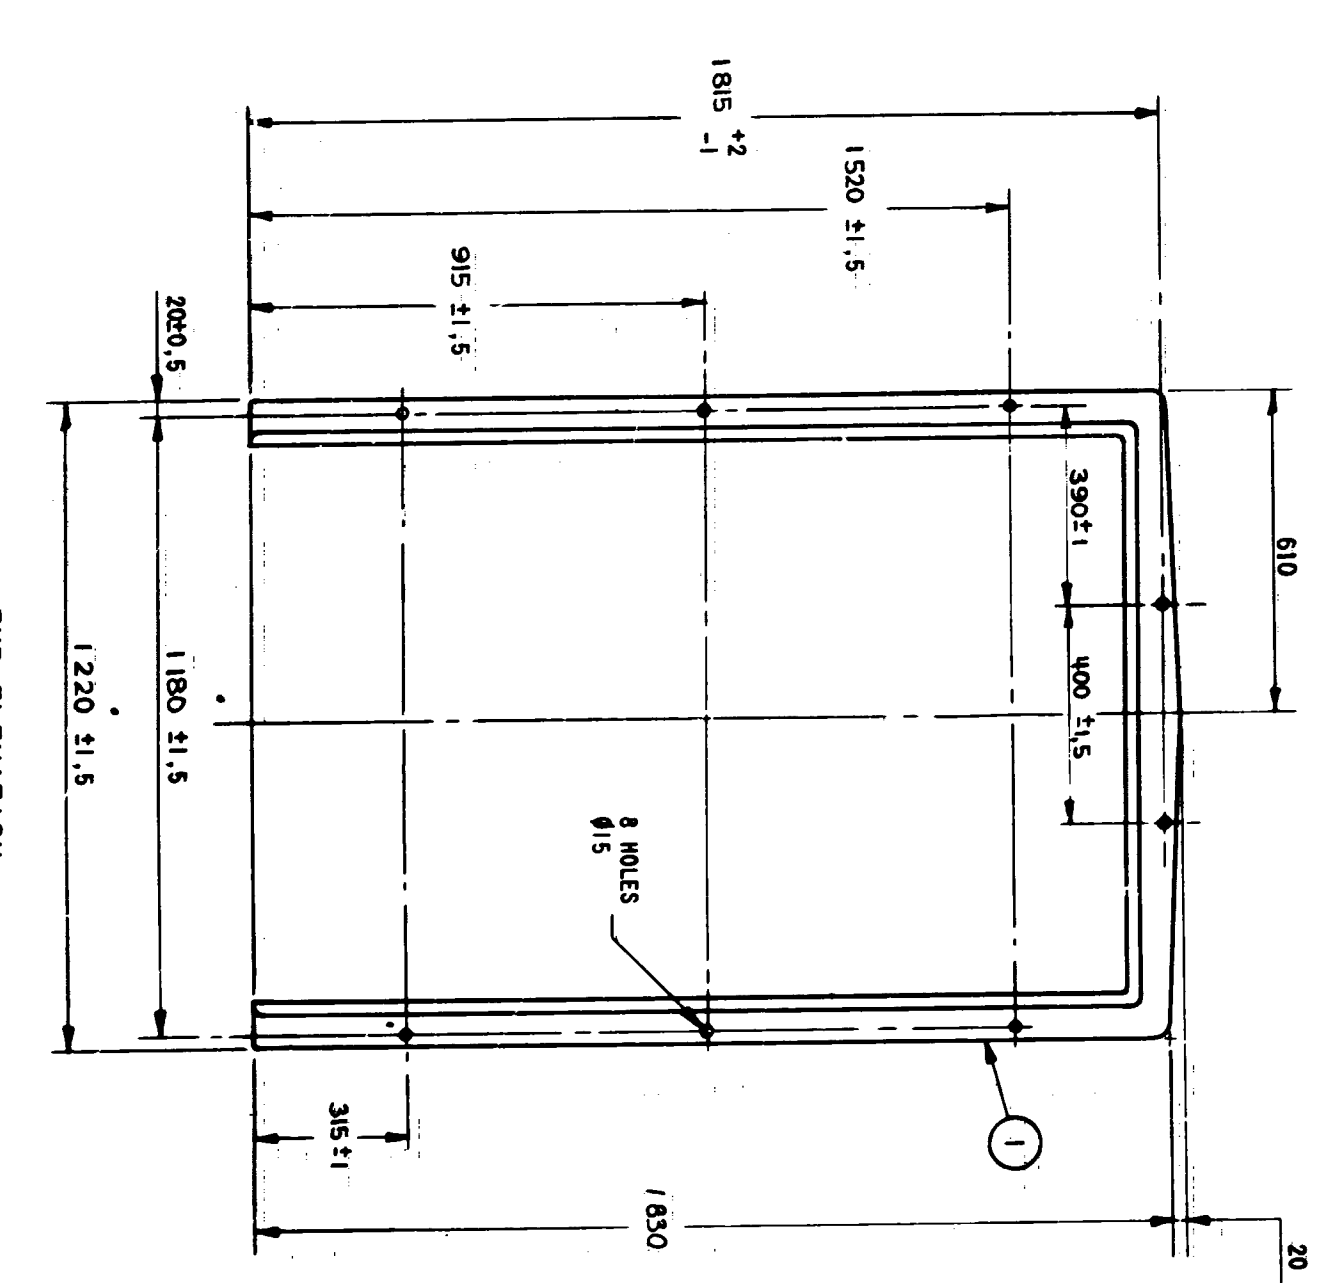
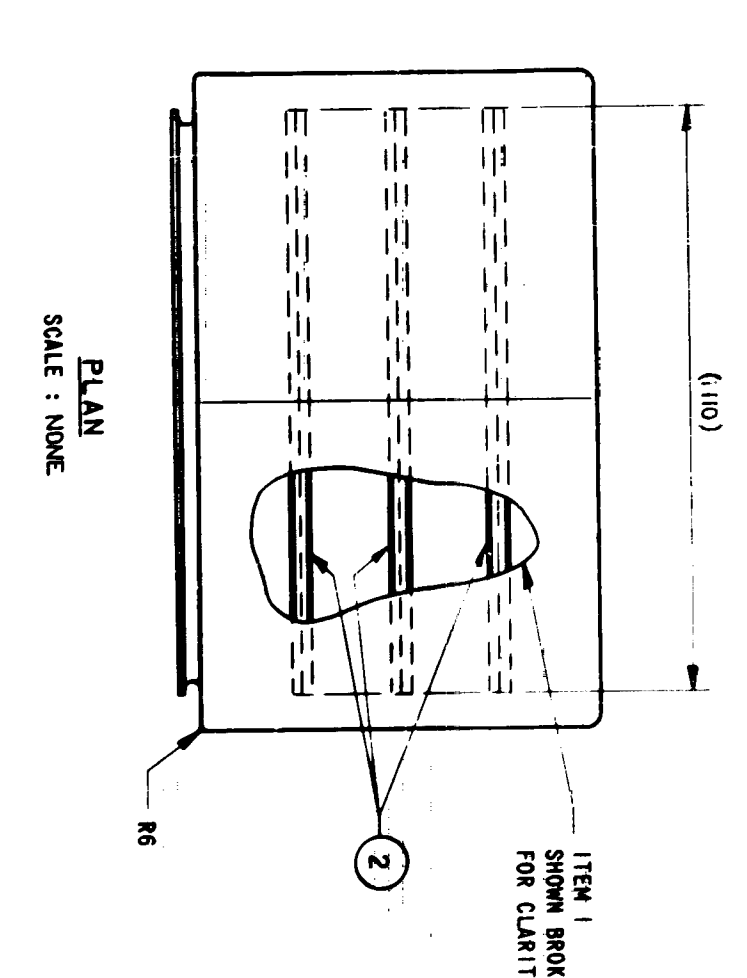
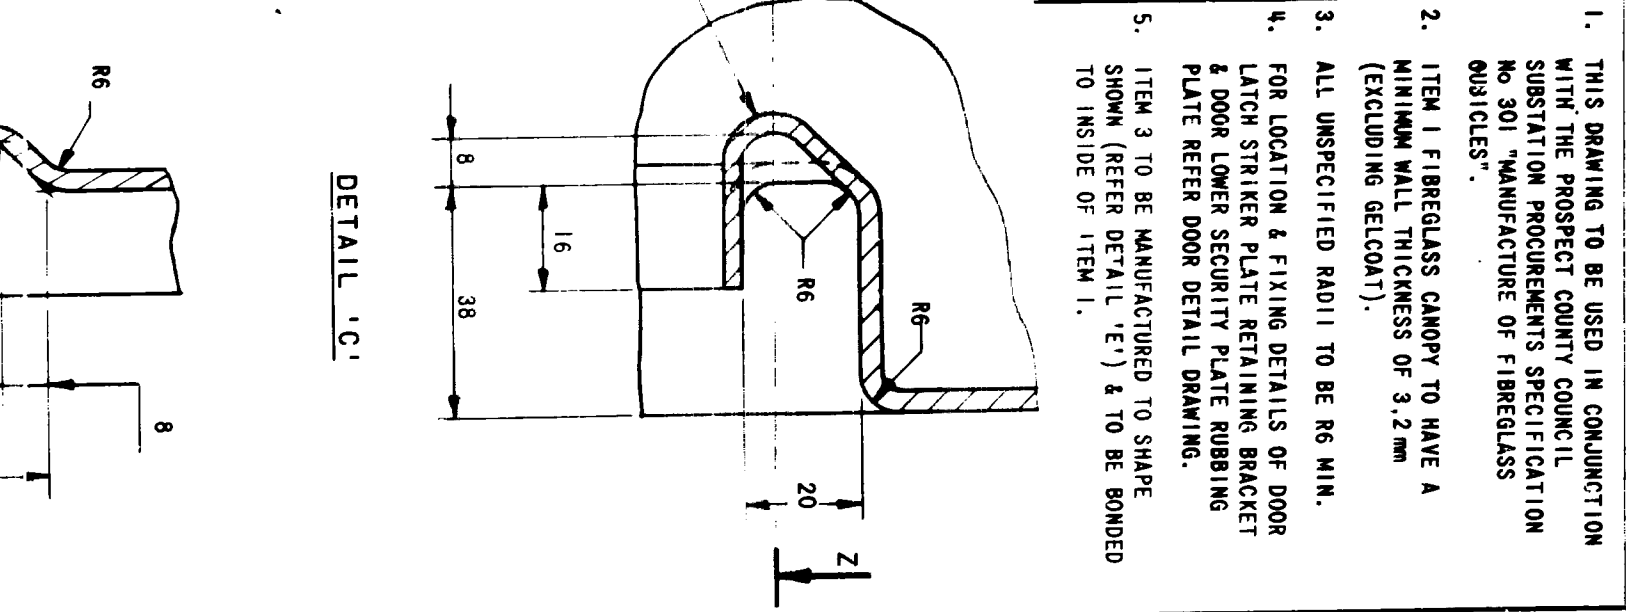
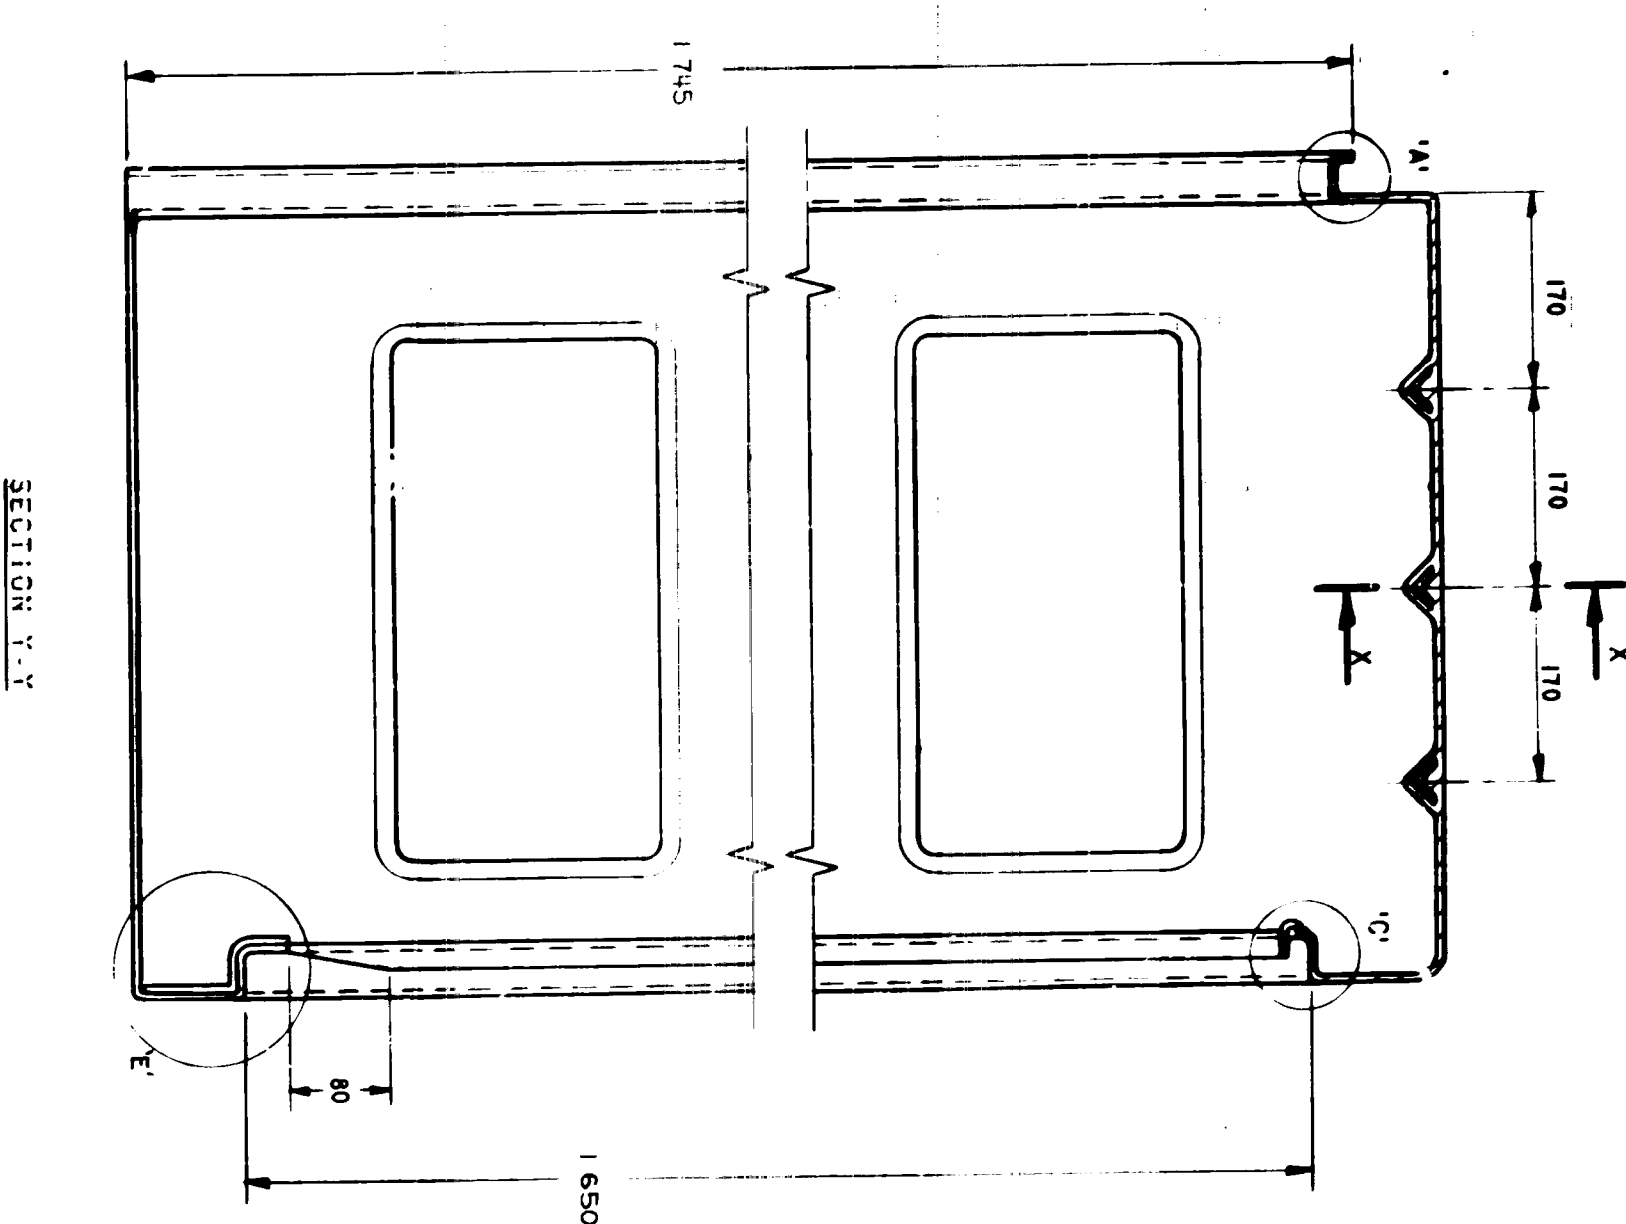
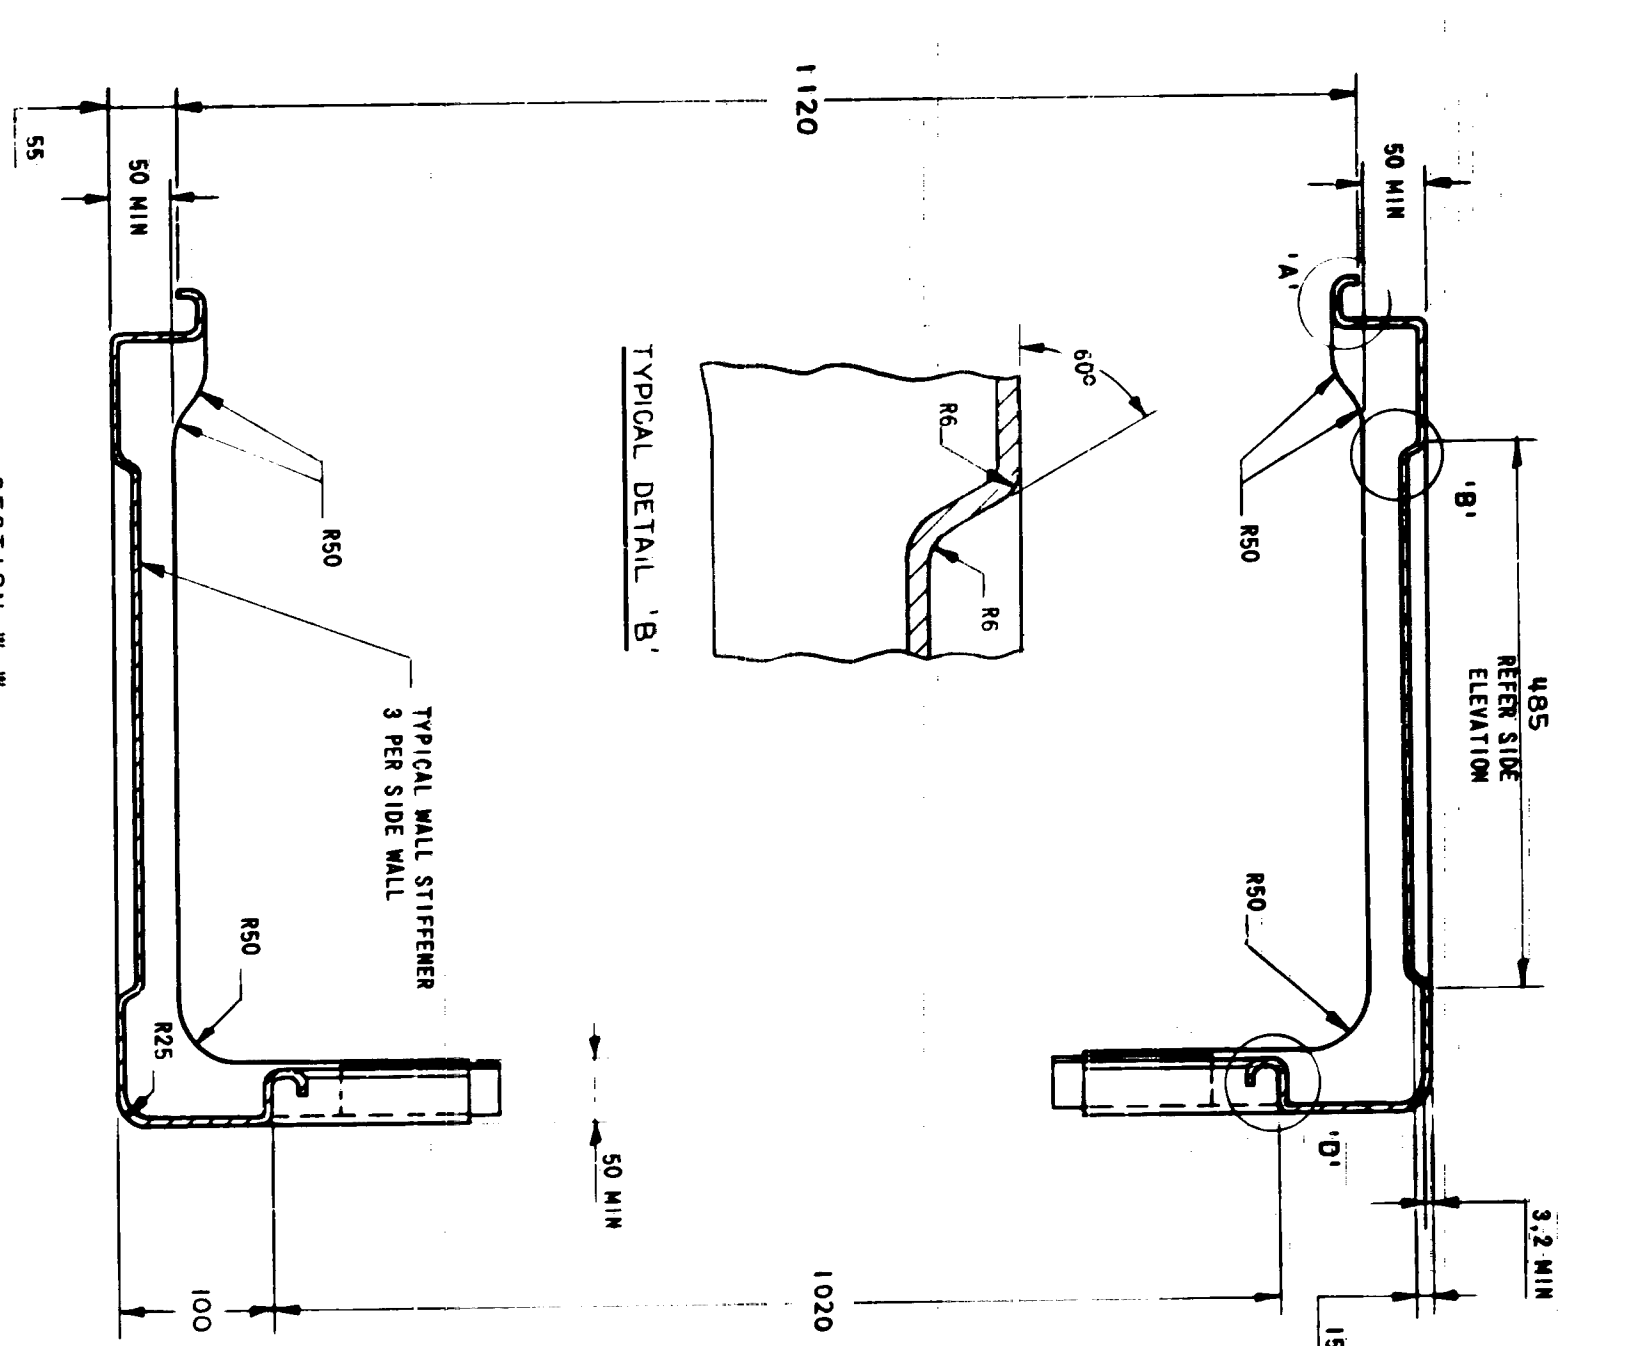
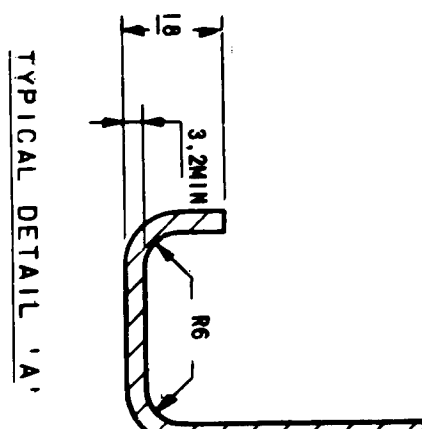


- NOTES
- THIS DRAWING TO BE USED IN CONJUNCTION WITH THE PROSPECT COUNTY COUNCIL SUBSTATION REQUIREMENTS SPECIFICATION No 301 "MANUFACTURE OF FIBREGLASS RIBBLES".
 - ITEM 1 FIBREGLASS CANOPY TO HAVE A MINIMUM WALL THICKNESS OF 3.2 mm (EXCLUDING GELCOAT).
 - ALL UNSPECIFIED RADIUS TO BE R6 MIN.
 - FOR LOCATION & FIXING DETAILS OF DOOR LATCH STRIKER PLATE RETAINING BRACKET & DOOR LOWER SECURITY PLATE MOUNTING PLATE REFER DOOR DETAIL DRAWING NO. 1.
 - ITEM 3 TO BE MANUFACTURED TO SHAPE SHOWN (REFER DETAIL 'E') & TO BE BONDED TO INSIDE OF ITEM 1.

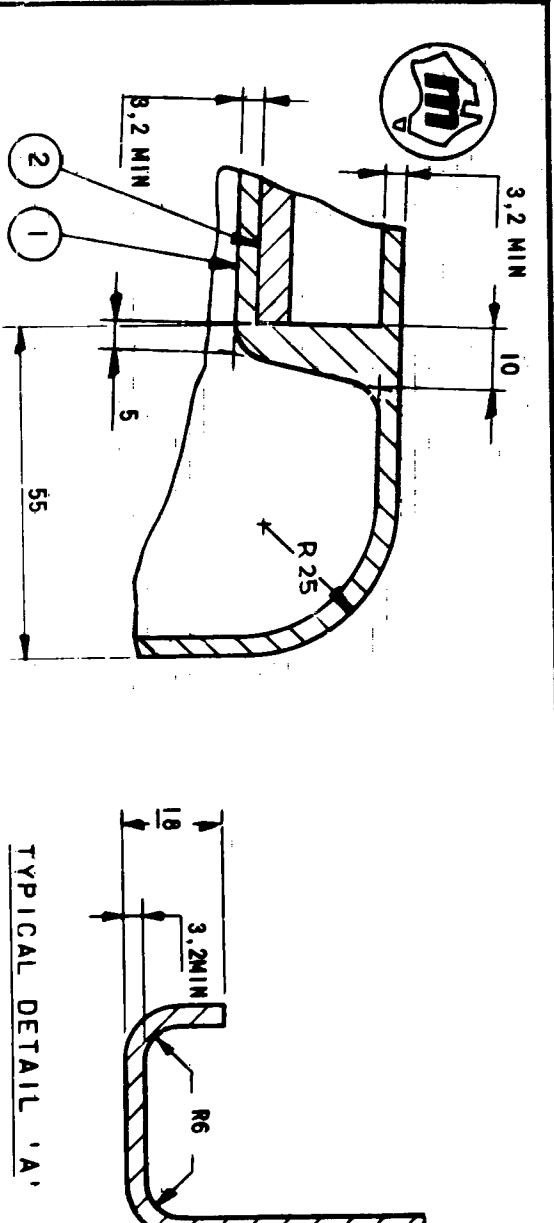

AMENDMENTS			
A	ORIGINAL	DATE	BY
B	CHD 12/22	DATE 06/04	BY 06/04
B	CHD 12/22	DATE 06/04	BY 06/04
B	CHD 12/22	DATE 06/04	BY 06/04

OFFICE	INITIALS	OFFICE	INITIALS
DESIGNED		DESIGNED	
DRAWN		DRAWN	
CHECKED		CHECKED	
APPROVED		APPROVED	

ITEM	DESCRIPTION	QTY	REMARKS
1	FIBREGLASS SECTION 3.2 THICK x 100 LG	2	REF. 100 LG
2	ANGLE STEEL GALV 25 x 25 x 3 x 1110 LG	3	REF. 100 LG
3	FIBREGLASS CANOPY	1	REF. NOTE 2

DOOR DETAILS	STEELWORK DETAILS	FIBREGLASS CURTAIN
REF. 359	REF. 373	REF. 361
REF. 359	REF. 373	REF. 361

B44363