
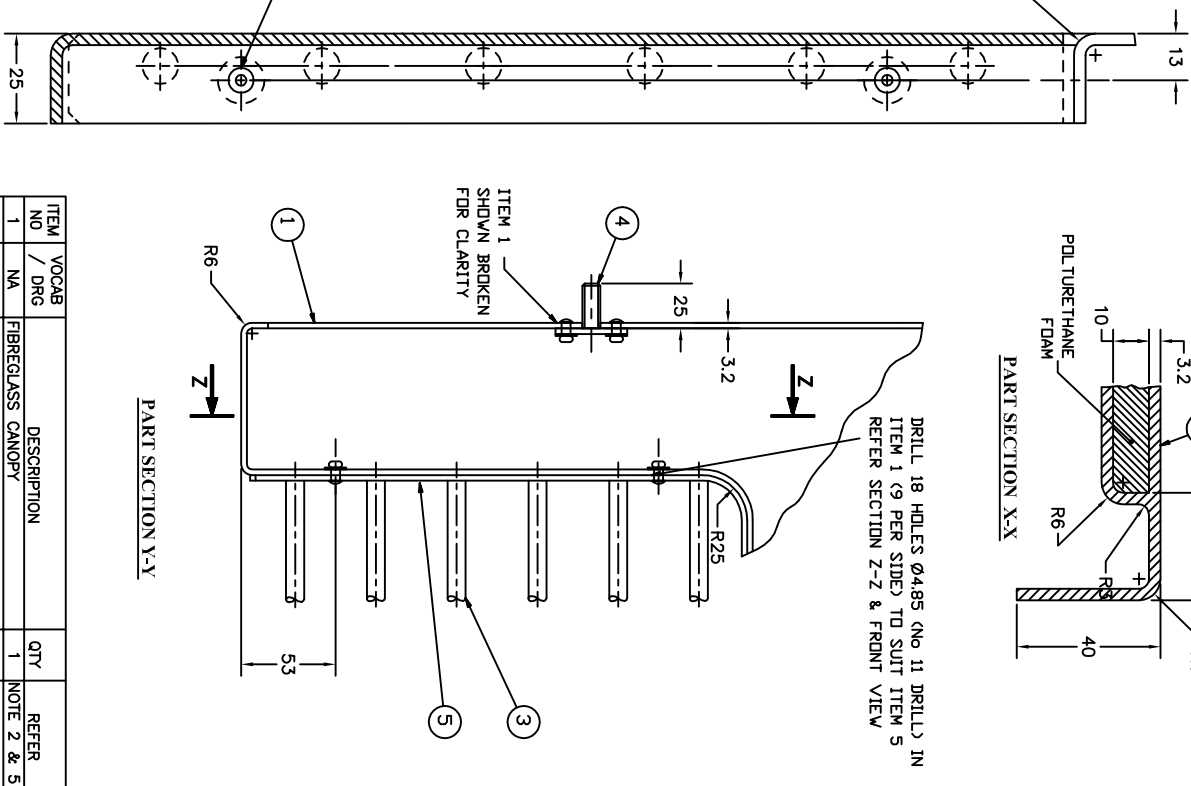
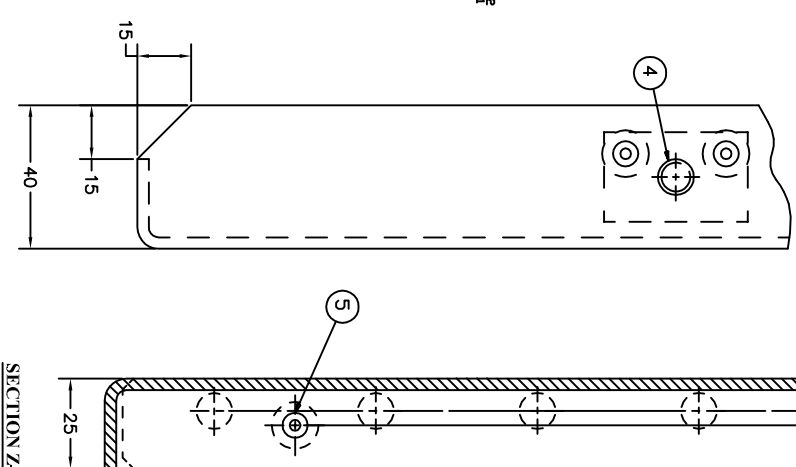
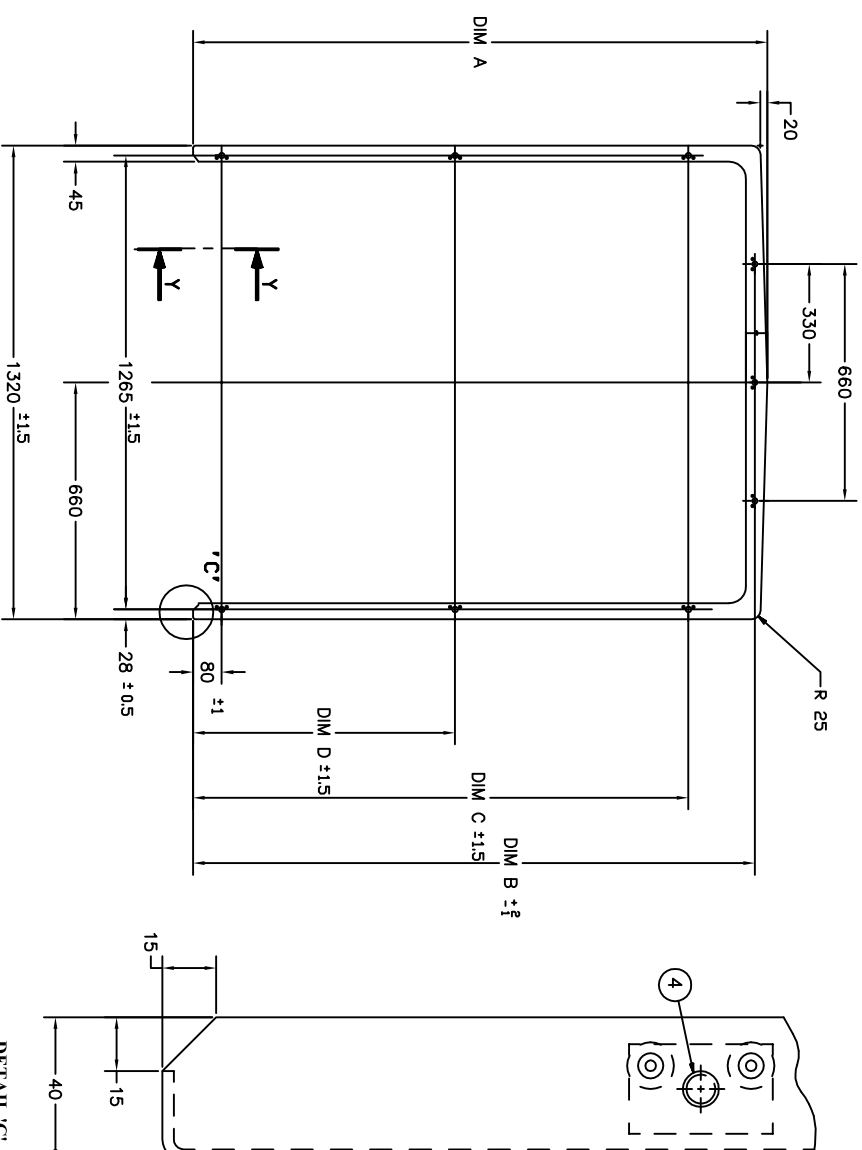
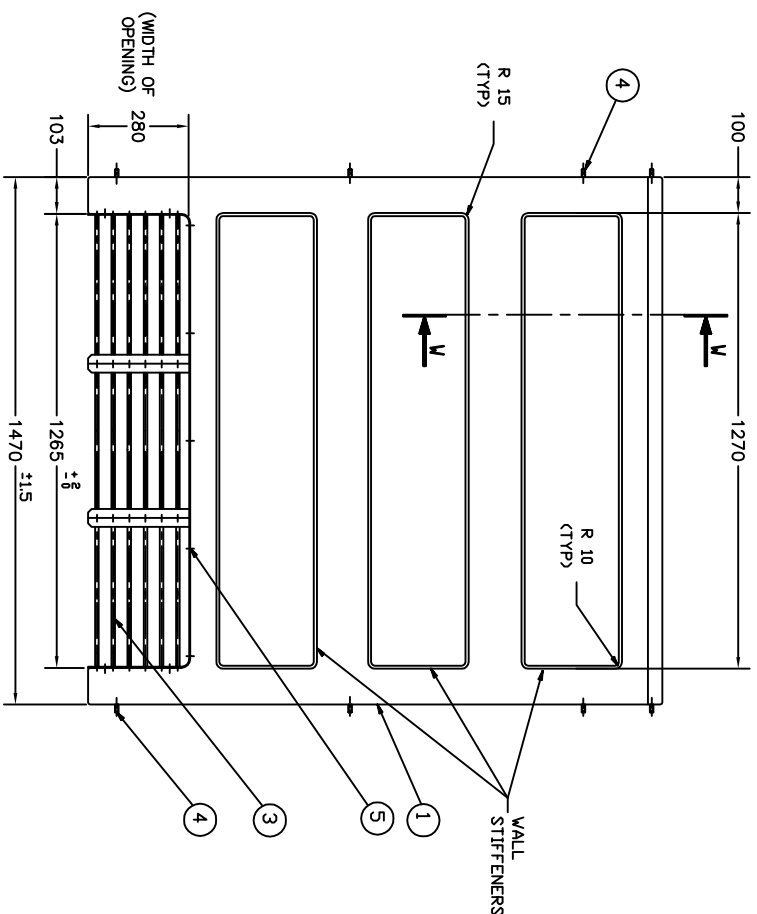
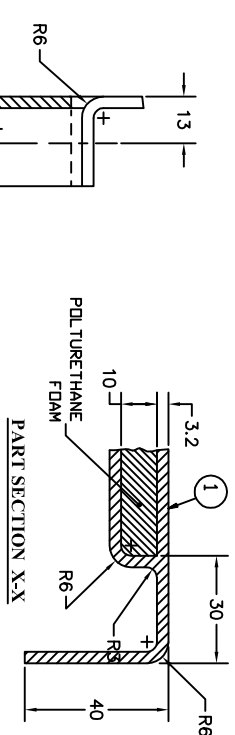
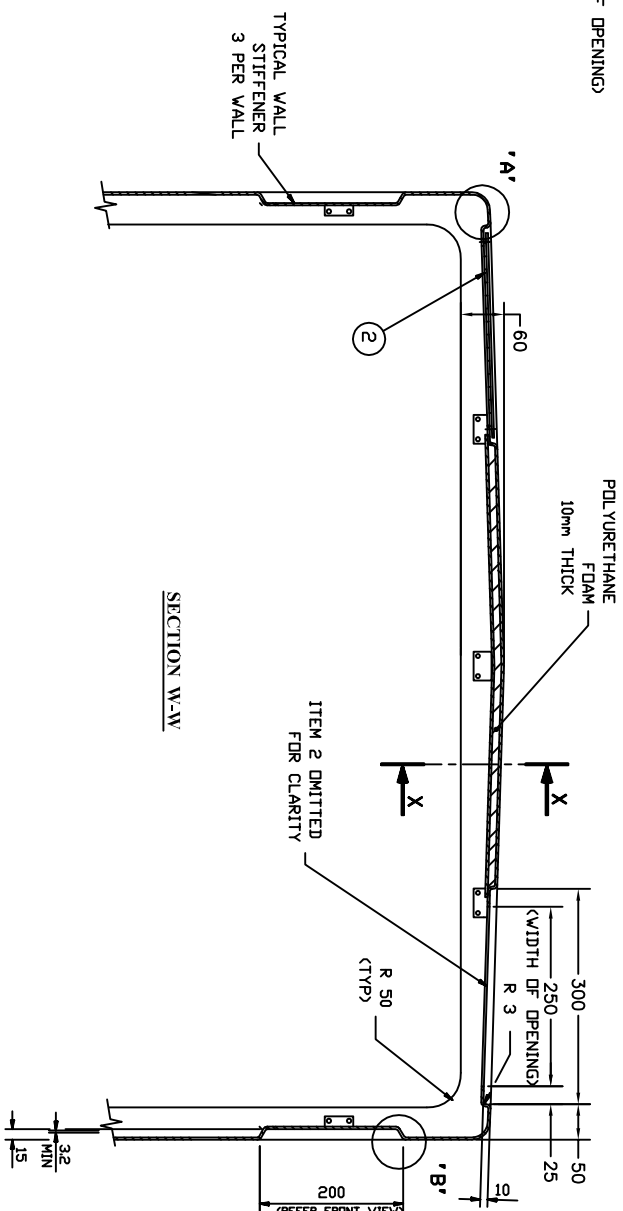
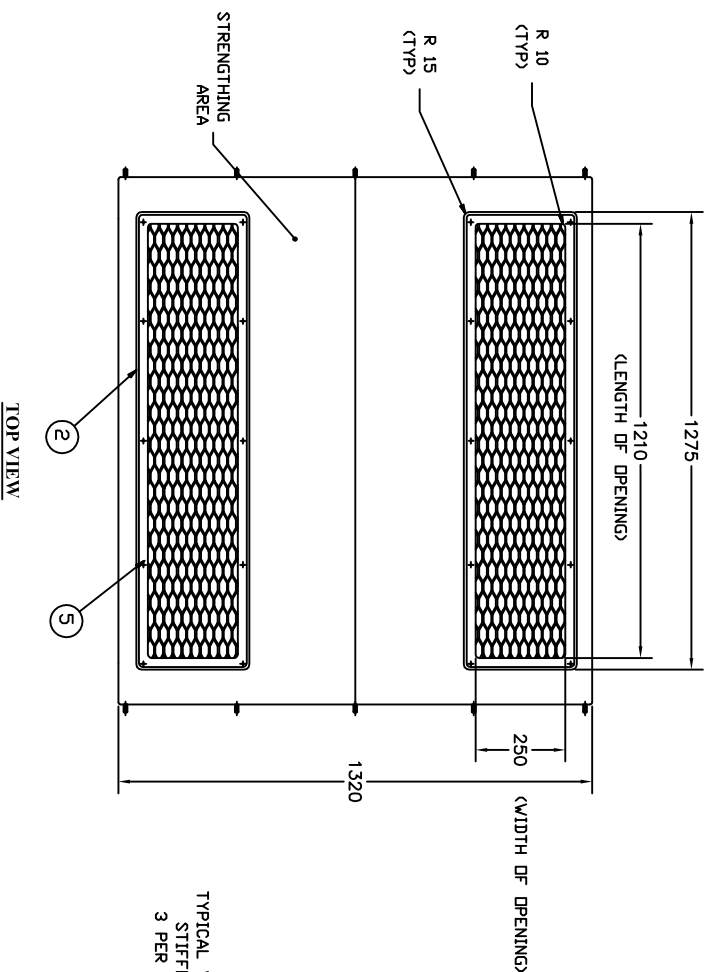



1. THIS DRAWING TO BE USED IN CONDUCTION WITH THE RELEVANT Endeavour Energy PANDMONT SUBSTATION CUBICLE SPECIFICATION. THE INTERNAL AND EXTERNAL CUBICLE FINISH IS ALSO DETAILED IN THIS SPECIFICATION.
2. ITEM 1 (FIBREGLASS CANDPY) TO HAVE A MINIMUM WALL THICKNESS OF 32mm (EXCLUDING GELCAT).
3. ALL UNSPECIFIED RADII TO BE R6 MIN.
4. TOLERANCE - UP TO AND INCLUDING 300 ±0
OVER 300 ±20
UNLESS OTHERWISE NOTED.
5. DRILL 20 HOLES Ø485 (No 11 DRILL) IN ITEM 1 (FIBREGLASS CANDPY) TO SUIT ITEM 2 (VENT).
6. SUITABLE WASHERS TO BE FITTED TO ITEM 5 (POP RIVET) ON INSIDE OF CANDPY PRIOR TO FIXING POP RIVET IN PLACE.
HEAD OF POP RIVET TO BE ON OUTSIDE OF CANDPY AGAINST ITEMS 2, 3 & 4.

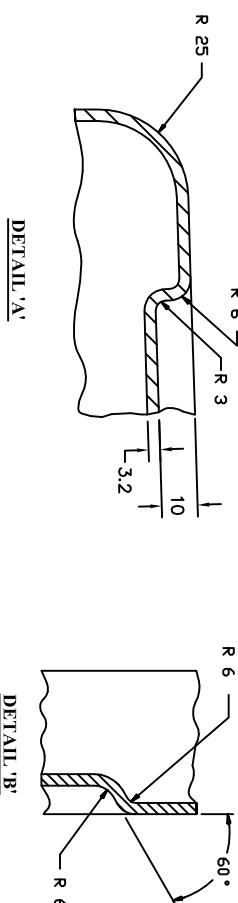


ITEM NO	VOCAB / DRG	DESCRIPTION	QTY	REFER
1	NA	FIBREGLASS CANOPY	1	NOTE 2 & 5
2	NA	VENT STEEL GALV	2	DRG 264889
3	NA	GRILL STEEL GALV	2	DRG 264889
4	NA	STUD STEEL GALV M10 x 25LG	2	DRG 264889
5	NA	POP RIVET AL DIA 4.8 (A0612)	18	NOTE 6

	CUBICLE DIMENSIONS	
	SIZE 14	SIZE 16
DIM A	1450	1600
DIM B	1415	1565
DIM C	1230	1380
DIM D	630	730

AMENDMENTS		
A	ORIGINAL ISSUE	
B	DR'N	G5F
	CH'D	G5F
	DATE	01-10-03
	JR No	--
SIZE 14 DIM A, B & C CHANGES ONLY. HEIGHT NOW 1450MM.		
MDEB	G5F	



© This drafting and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

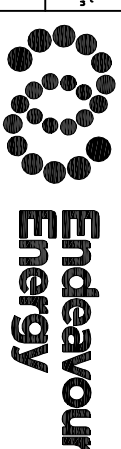

SIZE 14 & 16 - PADMOUNT SUBSTATION
FIBREGLASS CUBICLE
TRANSFORMER COMPARTMENT

STEELWORK DETAILS		264889
FIBREGLOSS CUBICLE ARRGT		264887
REFERENCE DRAWINGS		
DO NOT SCALE	AUTHORISED	
DIMENSIONS IN MILLIMETRES	W. Isley	
SUBSTATION CLE RTMENT	MANAGER ASSET SERVICES	13/08/20
	A3	
	264888	B
SHEET No 1 OF 1 SHEETS		