

1

2

3

4

5






6

7

8

NOTES

1. This drawing is to be used in conjunction with ETS 0077
2. "Danger High Voltage" sign and other signs to be fitted on all doors as shown
3. Substation numbers to be fitted by transformer workshop staff prior to issue
4. All doors and door stiffeners1.5mm 304 S/S 2B and other parts 2mm 304 S/S 2B
5. The paint finish shall be primed to powder coated "Avocado Green" (Code G34) TO AS2700.

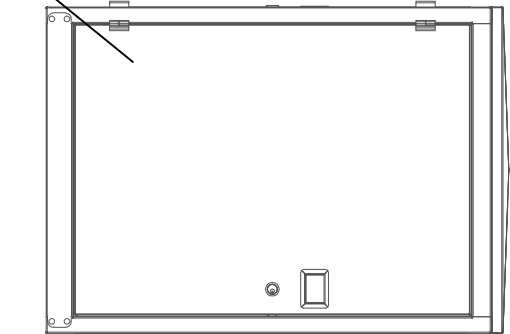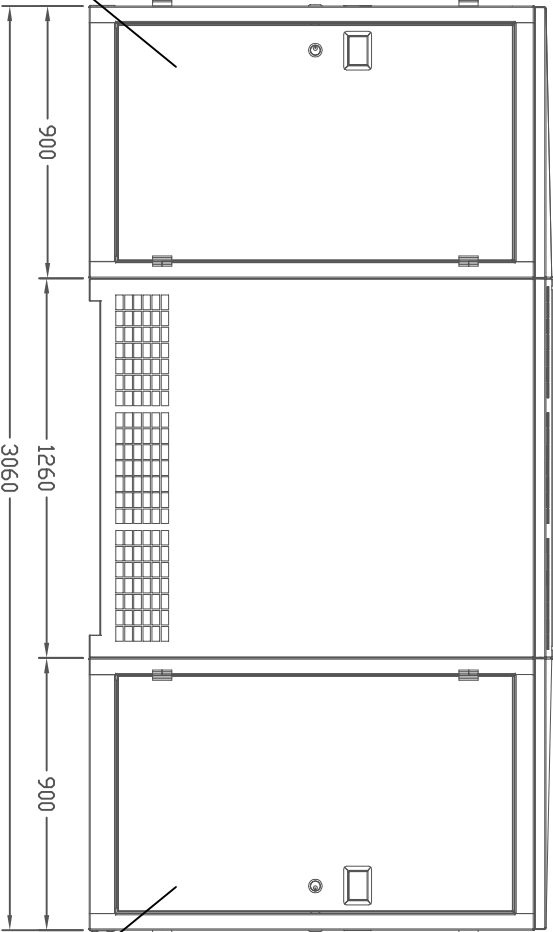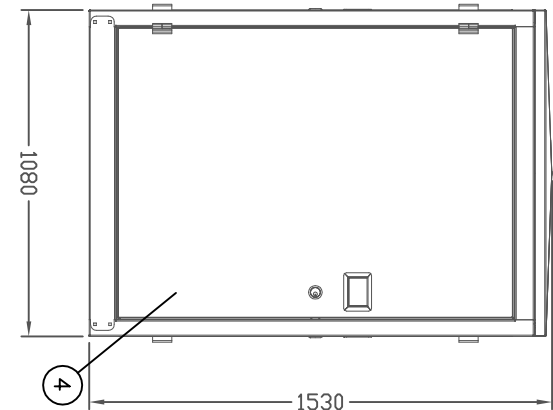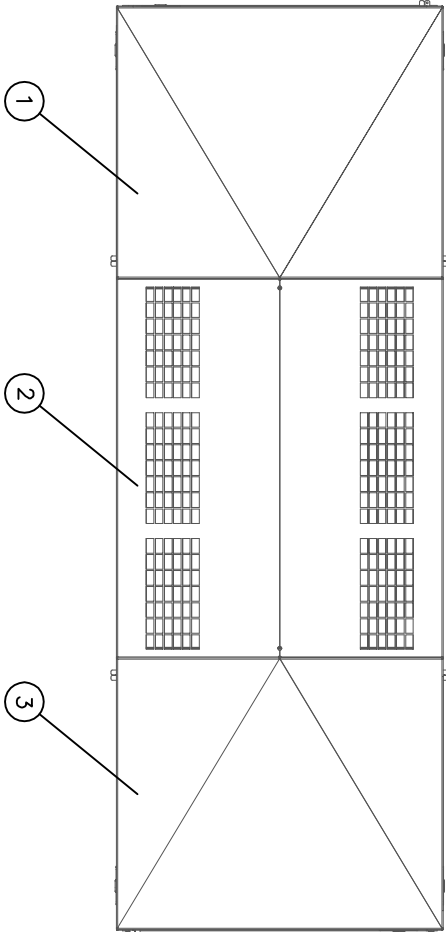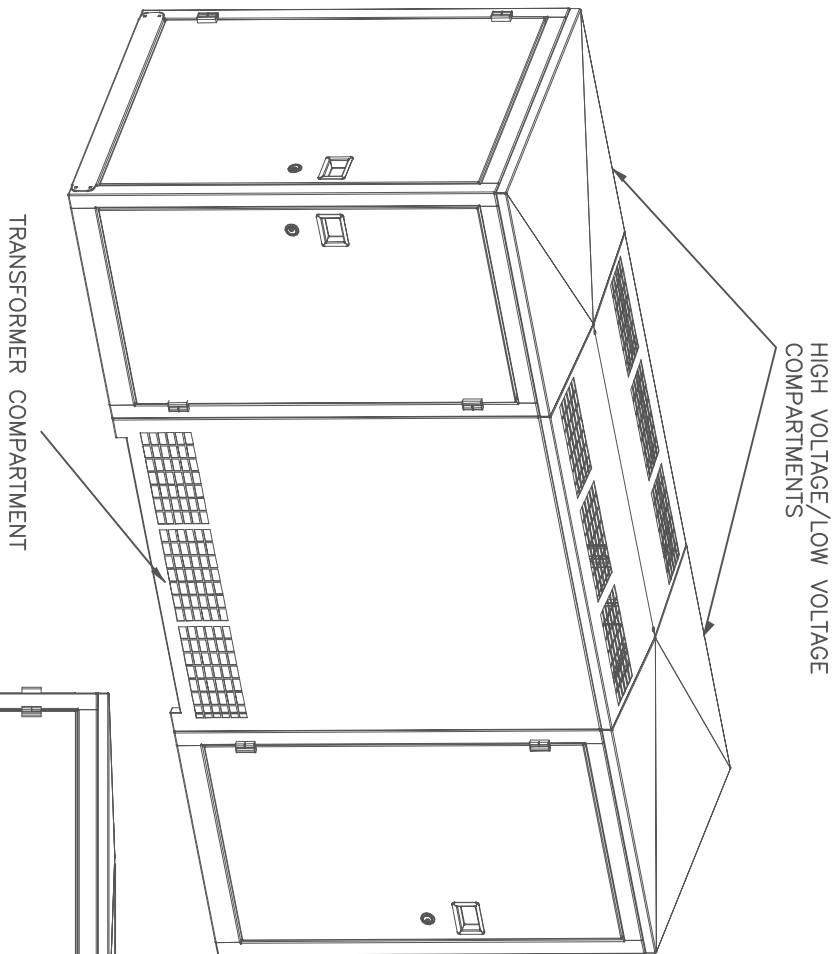


ITEM NO	DESCRIPTION	QTY	REFER
1	HIGH VOLTAGE COMPARTMENT	1	DRG 360389
2	TRANSFORMER COMPARTMENT	1	DRG 360388
3	LOW VOLTAGE COMPARTMENT	1	DRG 360389
4	DOOR CUBICLE END LV & HV	2	DRG 360389
5	DOOR CUBICLE SIDE HIGH VOLTAGE	2	DRG 360389
6	DOOR CUBICLE SIDE LOW VOLTAGE	2	DRG 360389



© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.





DO NOT SCALE
DIMENSIONS
IN MILLIMETRES

REFERENCE DRAWINGS



ORIGINAL
SCALE

APPROVED
G.Ford



AUTHORISED
J. Perera

DRAWN
P Watson

MGR NETWORK ENGINEERING

DATE
22 Mar 2011

SIZE 5 - PADMOUNT SUBSTATION
STAINLESS STEEL CUBICLE
GENERAL ARRANGEMENT

Rev.

AMENDMENTS

A

ORIGINAL
ISSUE

J R No.

A3

360387

A

SHEET No 1 OF 1 SHEETS