

1

2

3

4

5

6

7

8

NOTES

1.

This drawing is to be used in conjunction with ETS 0077
2.


“Danger High Voltage” sign and other signs to be fitted on all doors as shown
3.

Substation numbers to be fitted by transformer workshop staff prior to issue
4.

MATERIAL:
5.


All doors and door stiffeners1.5mm 304 S/S 2B and other parts 2mm 304 S/S 2B
6.

The point finish shall be primed to powder coated “Avocado Green” (Code G34) TO AS2700.

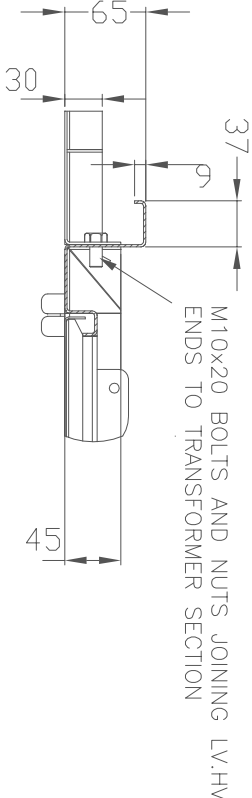


DETAIL A

LV/HV AND TRANSFORMER COMPARTMENT JOINED WITH M12 STAINLESS HARDWARE

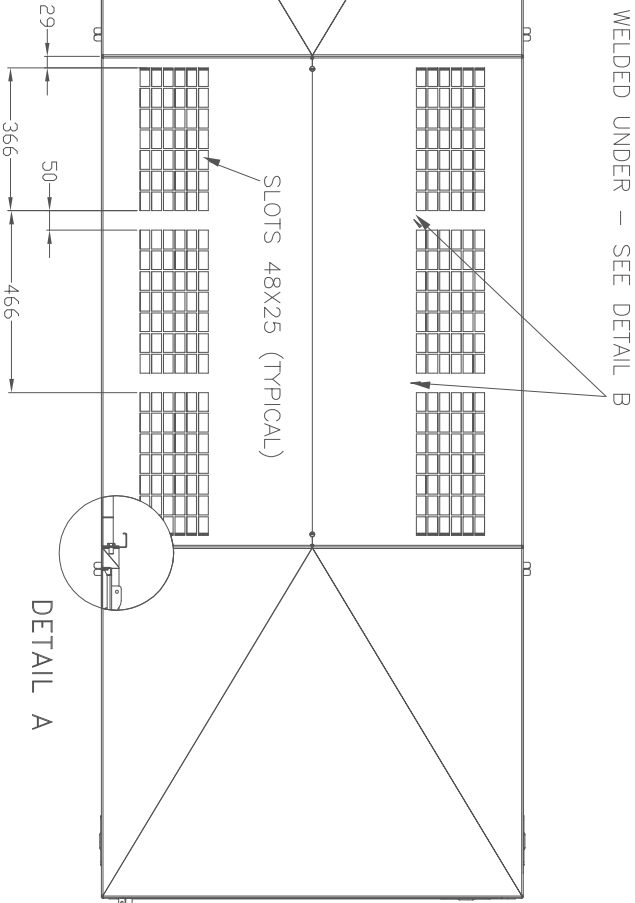


DETAIL A

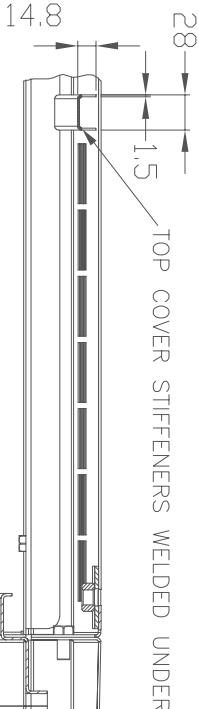


DETAIL B


DETAIL C

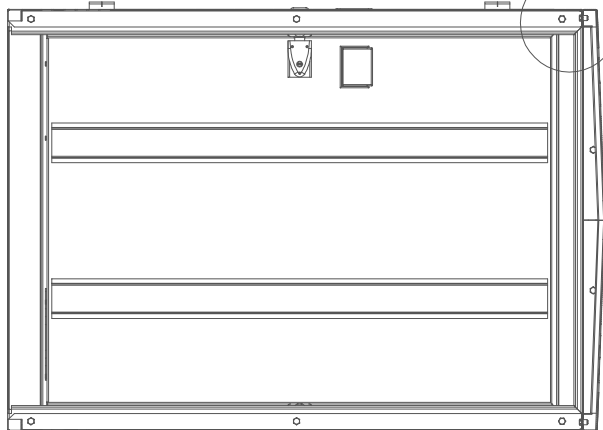

DETAIL B

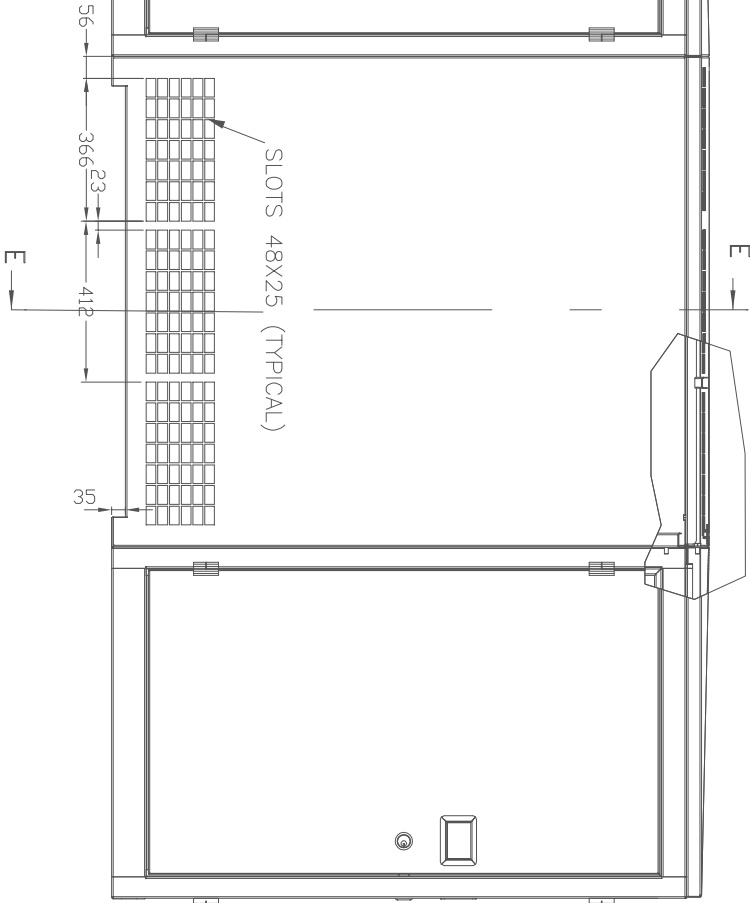


SLOTS 48X25 (TYPICAL)

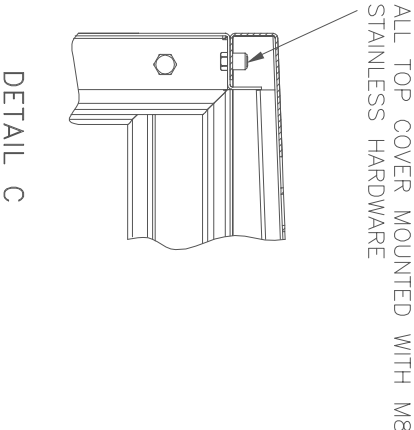

DETAIL C



©This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.



DO NOT SCALE
DIMENSIONS
IN MILLIMETRES



REFERENCE DRAWINGS

AUTHORISED
J. Perera



ORIGINAL
SCALE
APPROVED
G.Ford

DRAWN
P Watson

DATE
22 Mar 2011

CHD

AMENDMENTS
ORIGINAL
ISSUE

J R No.

SIZE 5 - PADMOUNT SUBSTATION

STAINLESS STEEL CUBICLE

TRANSFORMER COMPARTMENT

A3

360388

Rev.

A

MGR NETWORK ENGINEERING

08-12-11

SHEET No 1 OF 1 SHEETS