
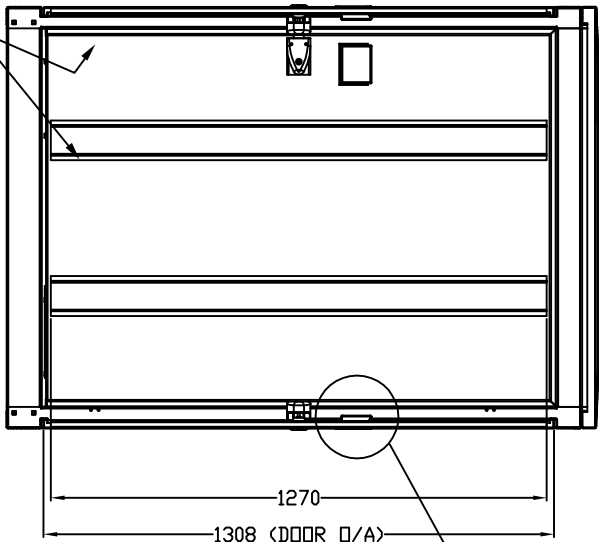
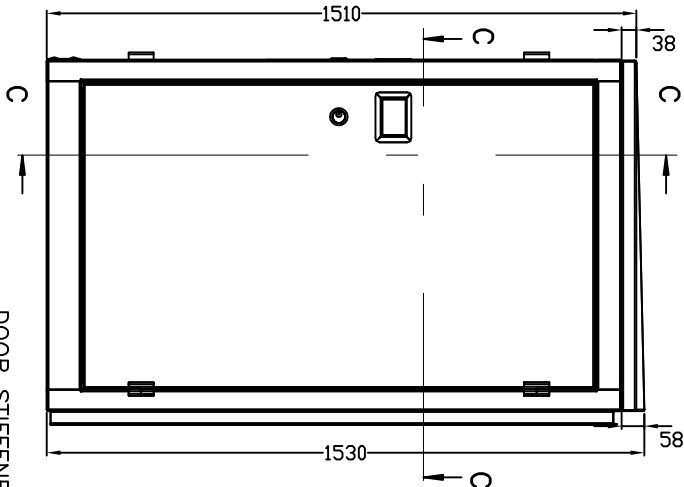


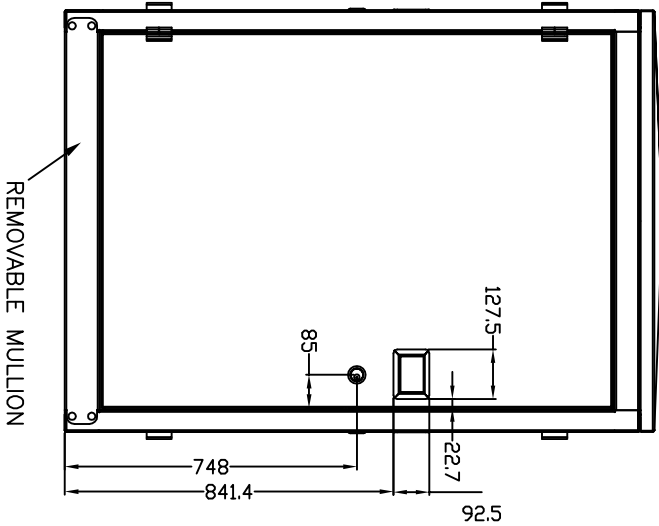

- NOTES
1. This drawing is to be used in conjunction with ETS 0077 “Danger High Voltage” sign and other signs to be fitted on all doors as shown



2. Substation numbers to be fitted by transformer workshop staff prior to issue

3. All doors and door stiffeners 1.5mm 304 S/S 2B and other parts 2mm 304 S/S 2B


4. The paint finish shall be primed to powder coated “Avocado Green” (Code G34) TO AS2700.

5.


EARTH STRAP 70mm² CONNECTING CONNECTING DOOR TO CABINET ENCLOSURE (TYPICAL)

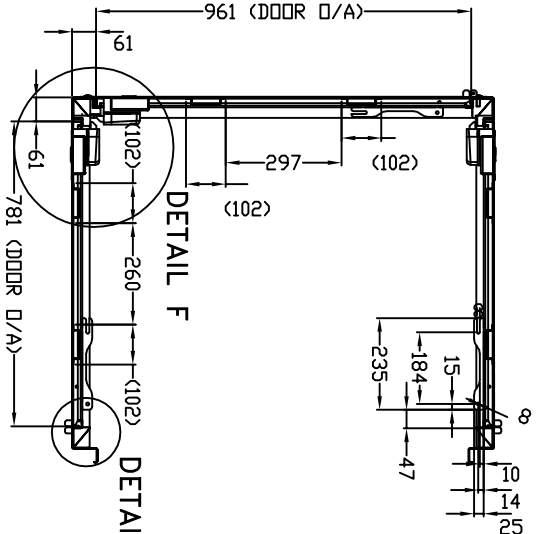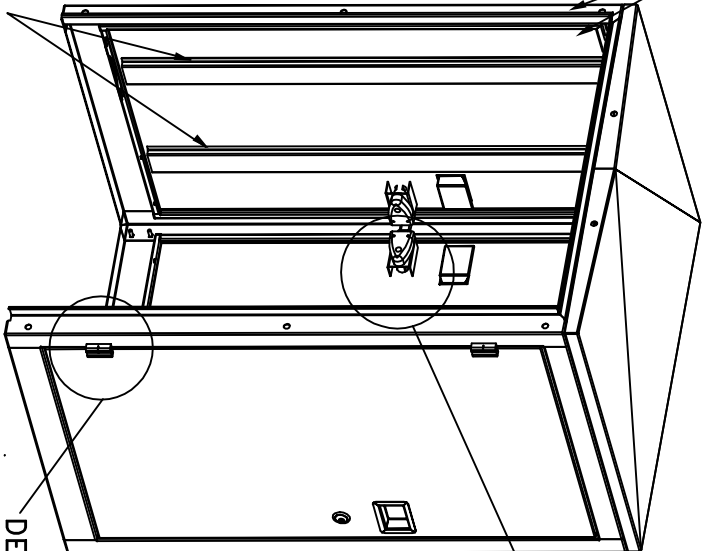


SECTION D-D

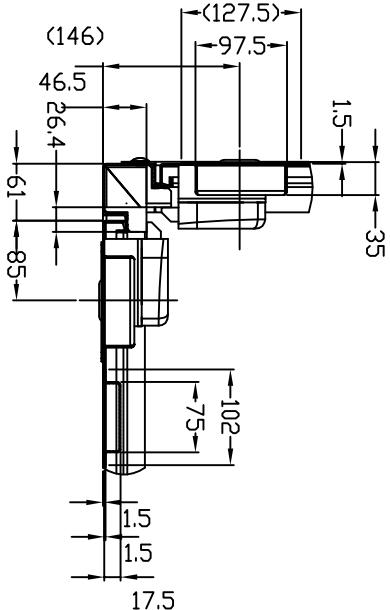

DETAIL F



DETAIL G



DETAIL H

DOOR STIFFENERS (SPOT WELDED – ALL DOORS)


DETAIL H

DETAIL F

DETAIL F

DETAIL G

©This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.



DO NOT SCALE
DIMENSIONS
IN MILLIMETRES

REFERENCE DRAWINGS

AUTHORISED

J. Pereira

MGR NETWORK ENGINEERING

08-12-11

SIZE 5 - PADMOUNT SUBSTATION

STAINLESS STEEL CUBICLE

HV AND LV COMPARTMENTS

AMENDMENTS

ORIGINAL
ISSUE

J R No.



ORIGINAL
SCALE

APPROVED
G.Ford

DRAWN P Watson

DATE 22 Mar 2011

CHD

A3

360389

Rev.

SHEET No 1 OF 1 SHEETS