

NOTES

1.

This drawing is to be used in conjunction with ETS 0077
2.



"Danger High Voltage" sign and other signs to be fitted on all doors as shown
3.

Substation numbers to be fitted by transformer workshop staff prior to issue
4.


MATERIAL:
5.

All doors and door stiffeners 1.5mm 304 S/S 2B and other parts 2mm 304 S/S 2B
6.



The paint finish shall be primed to powder coated "Avocado Green" (Code G34) TO AS2700.

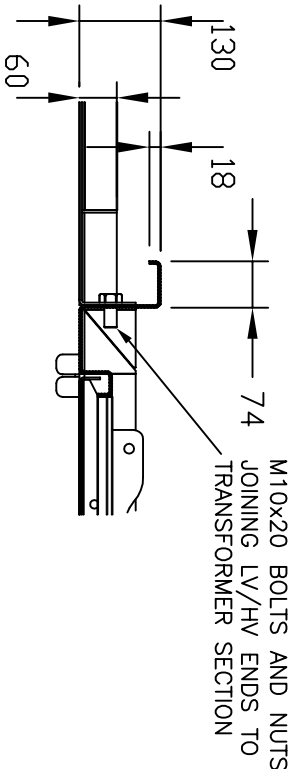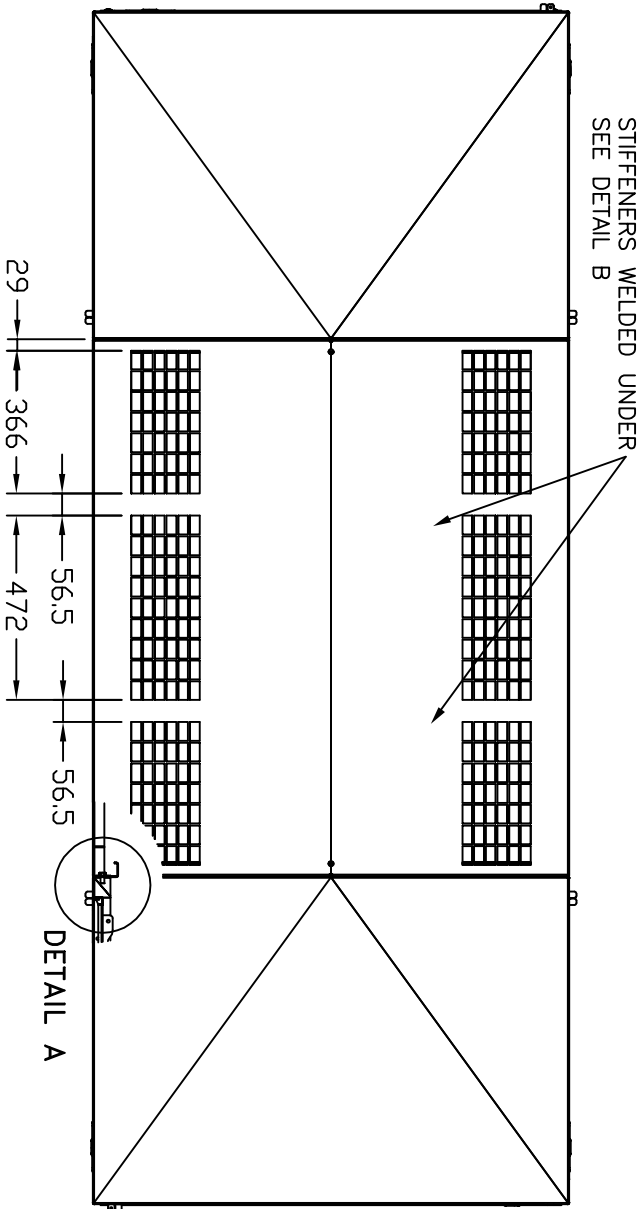


DETAIL B

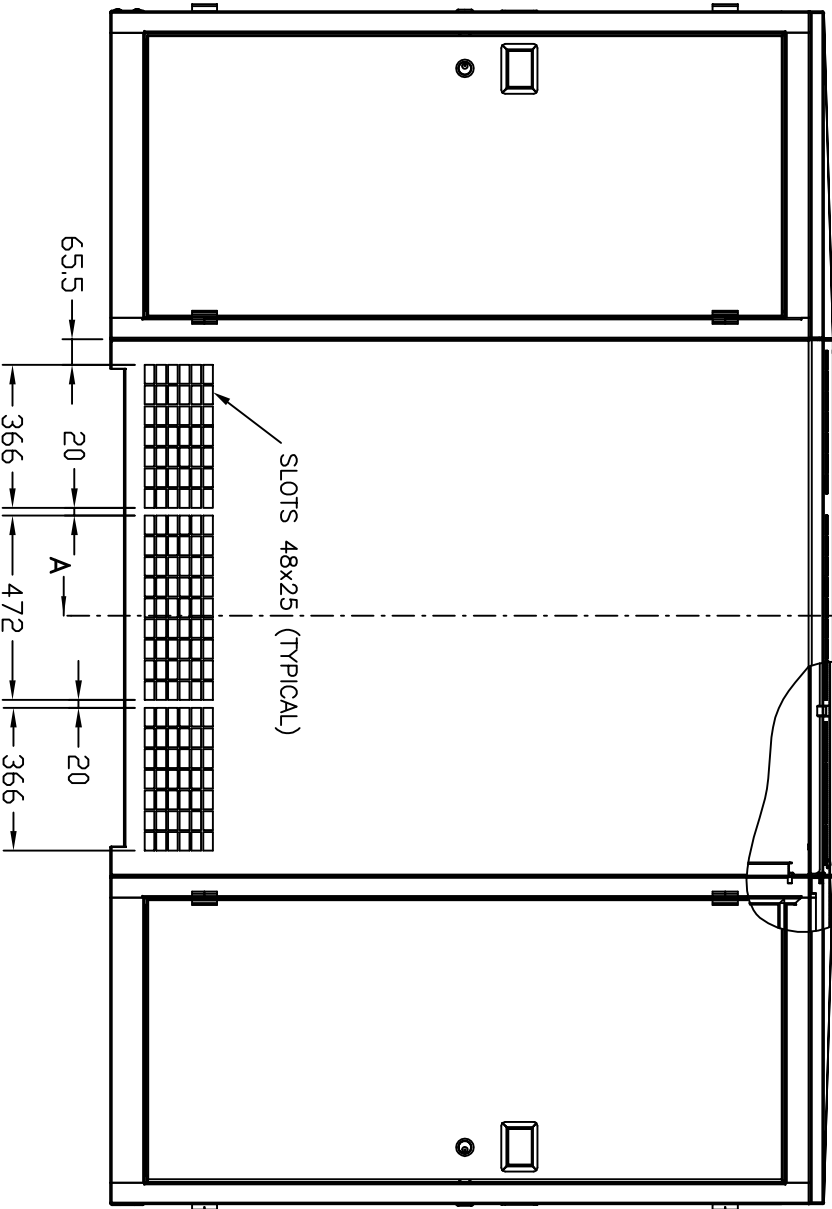

DETAIL C

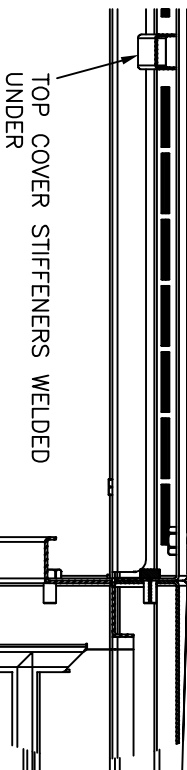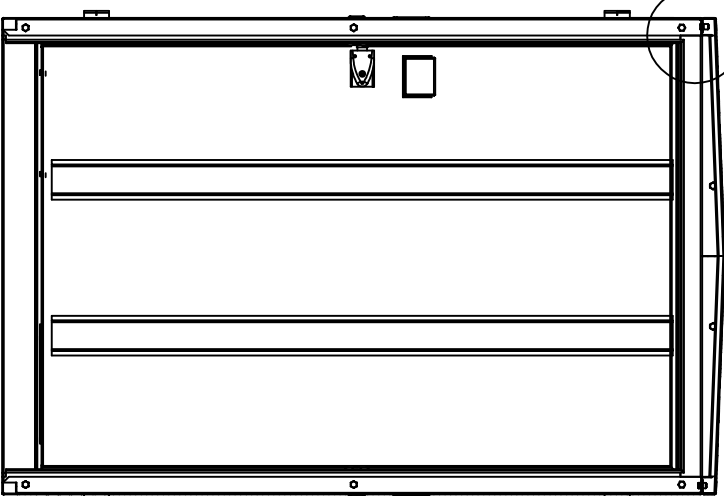


DETAIL B

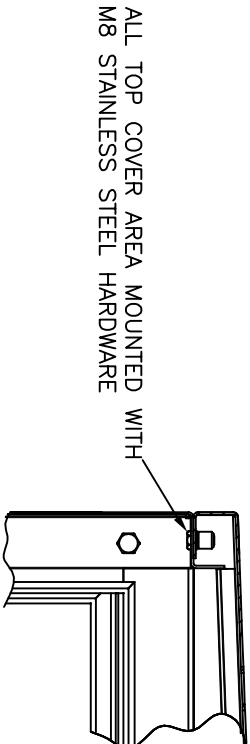

DETAIL C



© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.



DO NOT SCALE
DIMENSIONS
IN MILLIMETRES

REFERENCE DRAWINGS



ORIGINAL
SCALE
APPROVED
G.Ford



AUTHORISED
J. Pereira

DRAWN
P Watson
DATE
26 May 2011
CHD

SIZE 10 - PADMOUNT SUBSTATION
STAINLESS STEEL CUBICLE
TRANSFORMER COMPARTMENT

MGR NETWORK ENGINEERING

08-12-11

A3

360391

Rev.

A

AMENDMENTS
ORIGINAL
ISSUE
J R No.

SHEET No 1 OF 1 SHEETS