

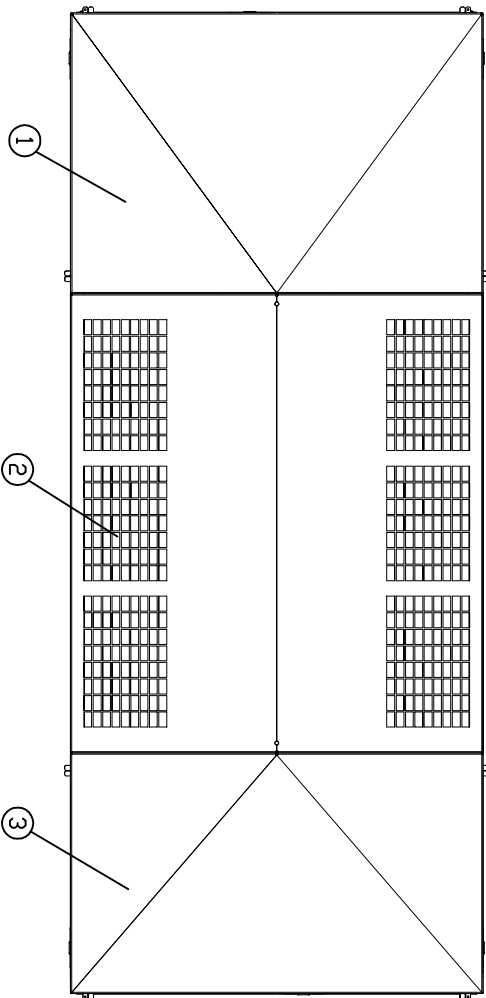


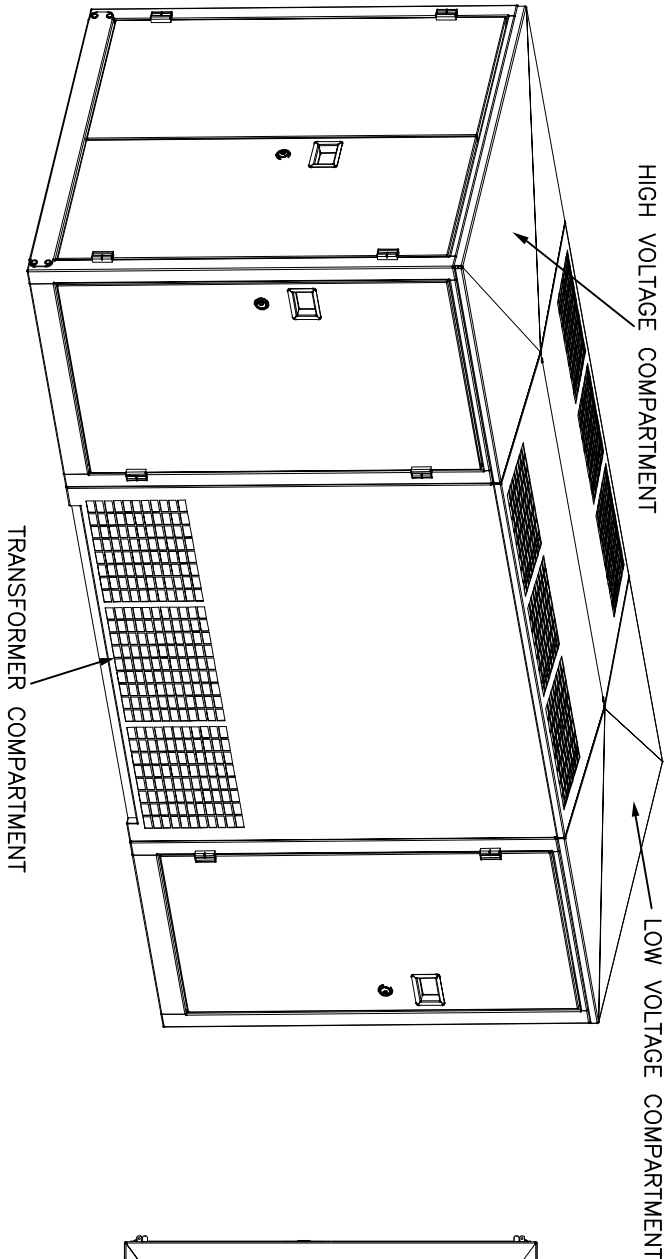

NOTES


1. This drawing is to be used in conjunction with ETS 0077
2. "Danger High Voltage" sign and other signs to be fitted on all doors as shown
3. Substation workshops to be fitted by transformer workers staff prior to issue
4. All doors and door stiffeners1.5mm 304 S/S 2B and other parts 2mm 304 S/S
5. The paint finish shall be primed to powder coated "Avocado Green" (Code G34) TO AS2700.

CUBICLE DIMESIONS		
	SIZE 14	SIZE 16
DIM A	1450	1600

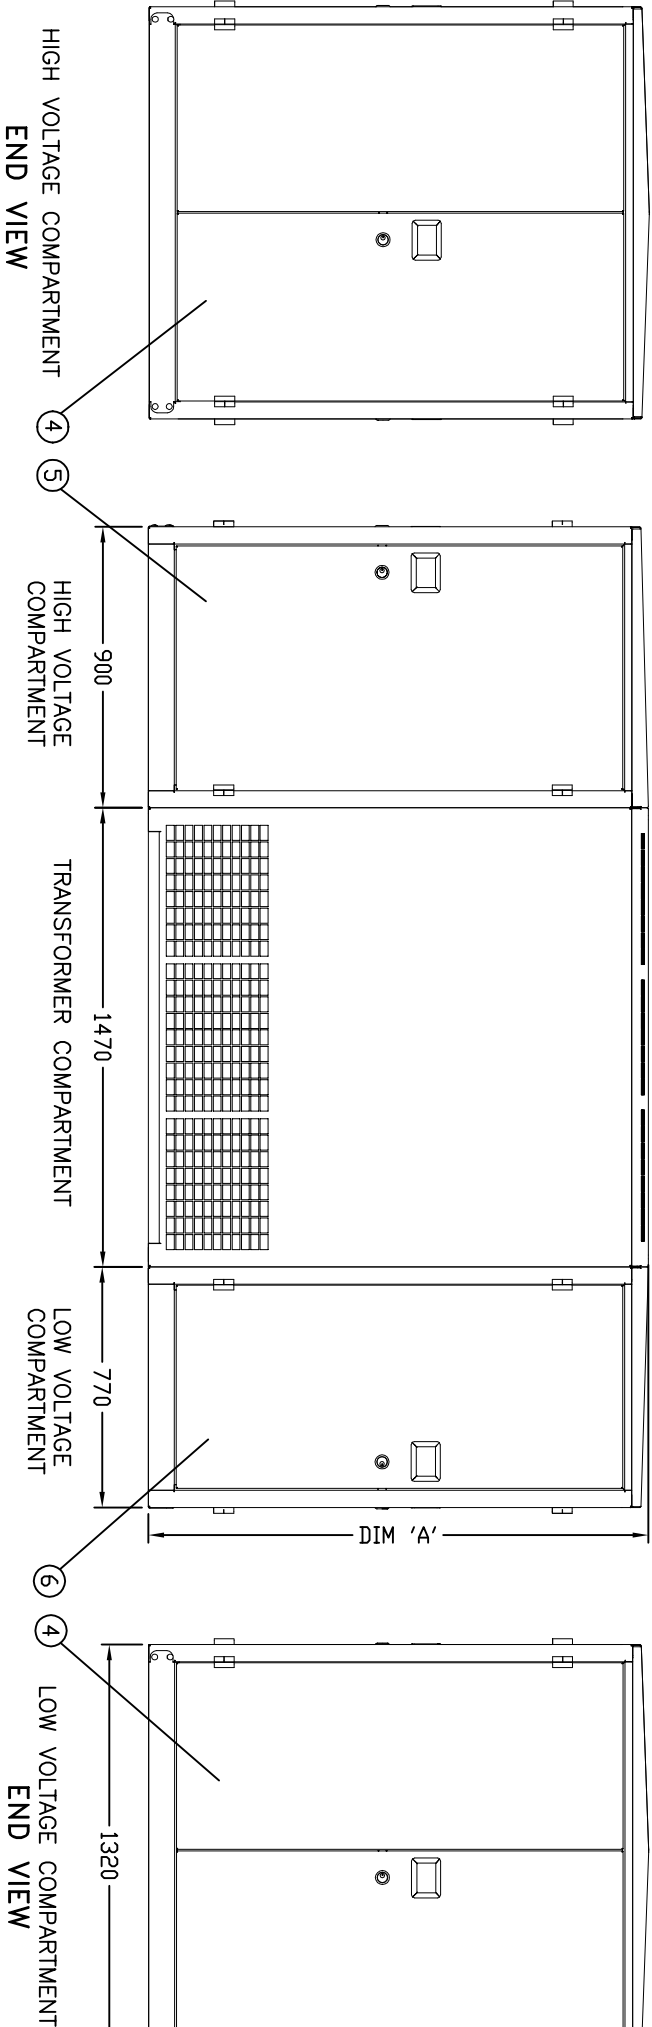

ITEM NO	DESCRIPTION	QTY	REFER
1	HIGH VOLTAGE COMPARTMENT	1	DRG 360395
2	TRANSFORMER COMPARTMENT	1	DRG 360394
3	LOW VOLTAGE COMPARTMENT	1	DRG 360395
4	DOOR CUBICLE END LV & HV	2	DRG 360395
5	DOOR CUBICLE SIDE HIGH VOLTAGE	2	DRG 360395
6	DOOR CUBICLE SIDE LOW VOLTAGE	2	DRG 360395

© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.



DO NOT SCALE
DIMENSIONS
IN MILLIMETRES

REFERENCE DRAWINGS



ORIGINAL SCALE
APPROVED G.Ford



AUTHORISED
J. Pereira

DRAWN P Watson

MGR NETWORK ENGINEERING 08-12-11

DATE 26 May 2011

Rev. 360393 A

CHD

SIZE 14-16 PADMOUNT SUBSTATION
STAINLESS STEEL CUBICLE
GENERAL ARRANGEMENT

AMENDMENTS
ORIGINAL ISSUE
A

J R No.

A3

SHEET No 1 OF 1 SHEETS