

1

2

3

4

5

6



7

8




NOTES

1. This drawing is to be used in conjunction with ETS 0077
2. "Danger High Voltage" sign and other signs to be fitted on all doors as shown
3. Substation numbers to be fitted by transformer workshop staff prior to issue
4. All doors and door stiffeners 1.5mm 304 S/S 2B and other parts 2mm 304 S/S
5. The paint finish shall be primed to powder coated "Avocado Green" (Code G34) TO AS2700.

CUBICLE DIMENSIONS		
	SIZE 14	SIZE 16
DIM A	1450	1600
DIM B	1244	1397
DIM C	1257	1407
DIM D	1280	1430

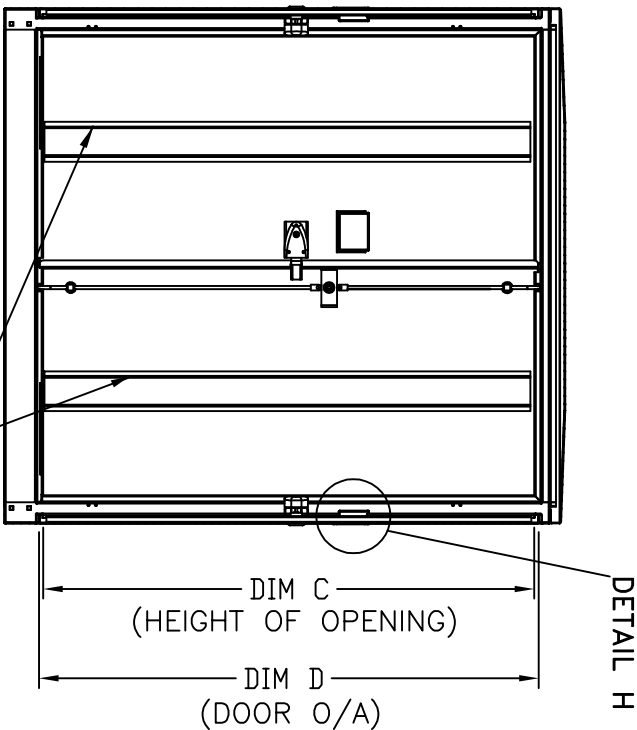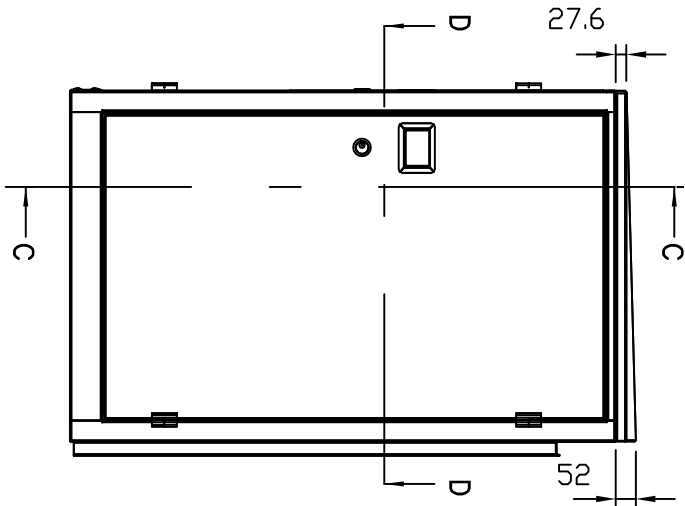

SECTION C-C
(TYPICAL ALL DOORS)

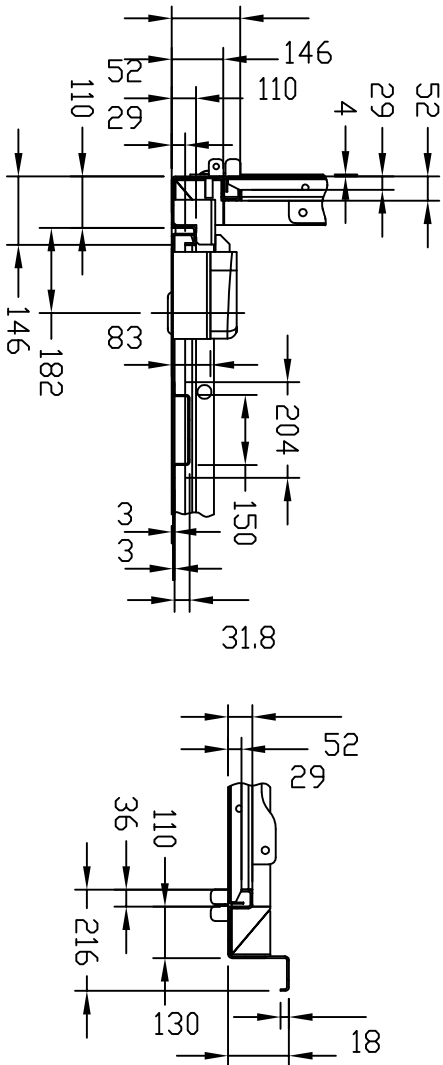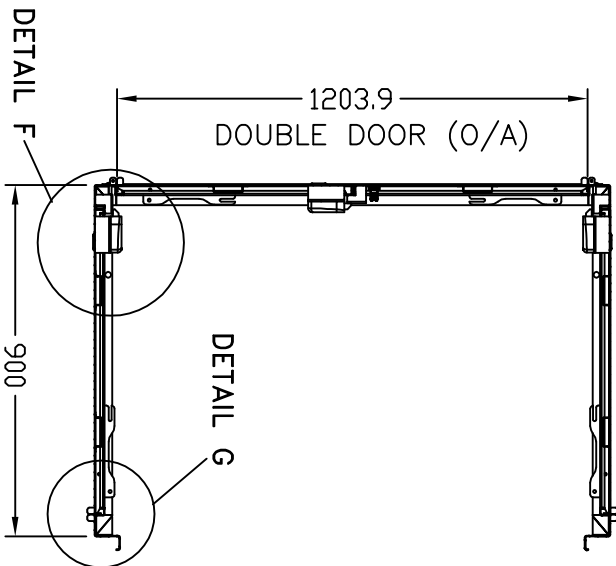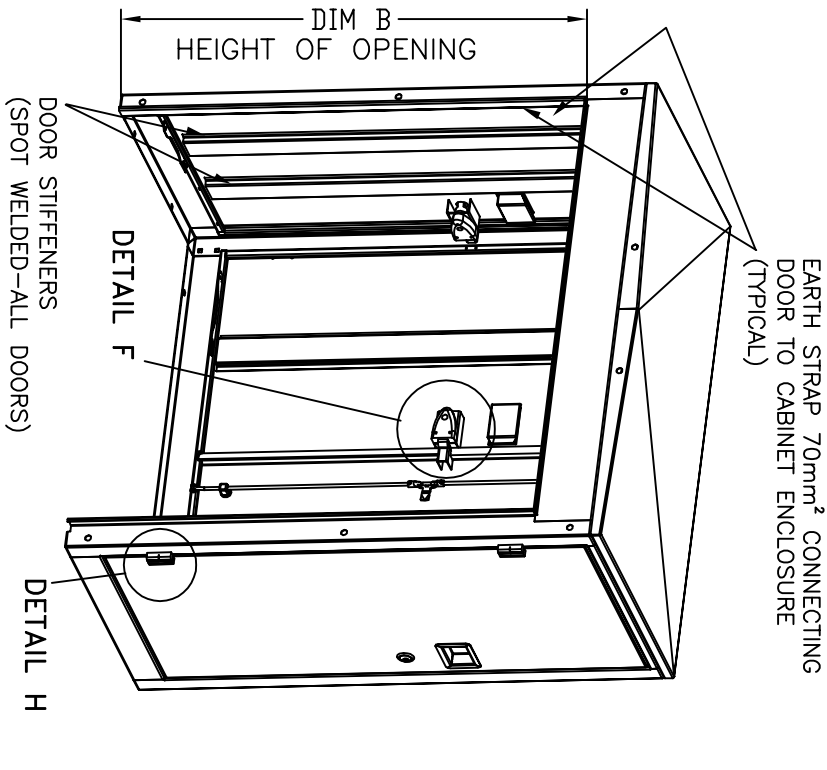


DETAIL G

DETAIL H

DETAIL F

© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.



DO NOT SCALE
DIMENSIONS
IN MILLIMETRES

REFERENCE DRAWINGS



ORIGINAL SCALE
APPROVED
G.Ford



AUTHORISED
J. Pereira

MGR NETWORK ENGINEERING

SIZE 14-16 PADMOUNT SUBSTATION
STAINLESS STEEL CUBICLE
HV AND LV COMPARTMENTS

08-12-11

360395

A3

SHEET No 1 OF 1 SHEETS

Rev.

A

DATE

26 May 2011

DRAWN

P. Watson

CHD

AMENDMENTS

ORIGINAL ISSUE

J R No.

A