

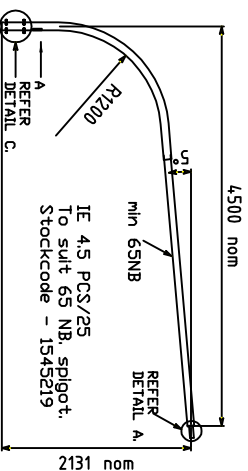
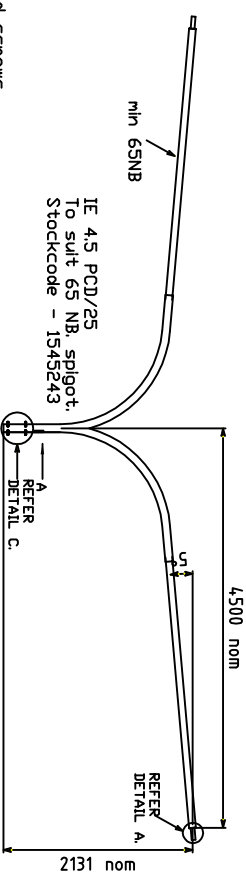

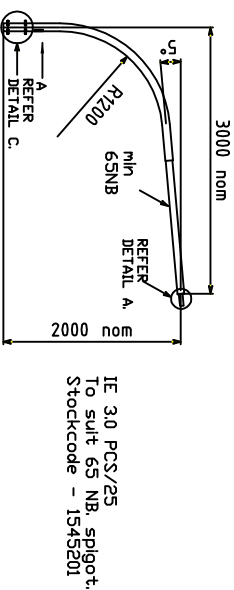
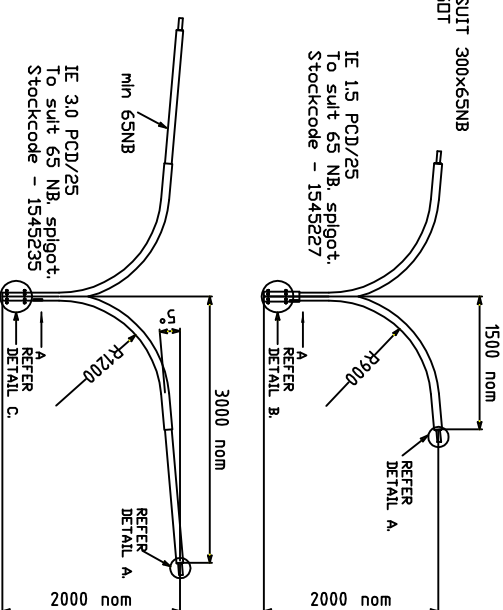
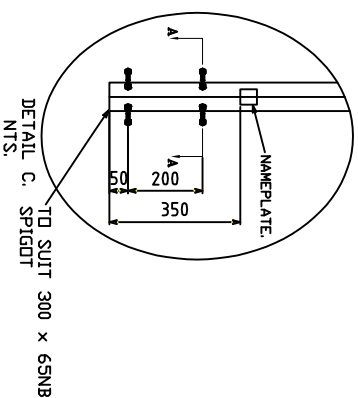
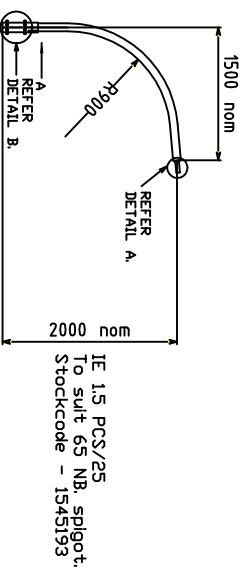

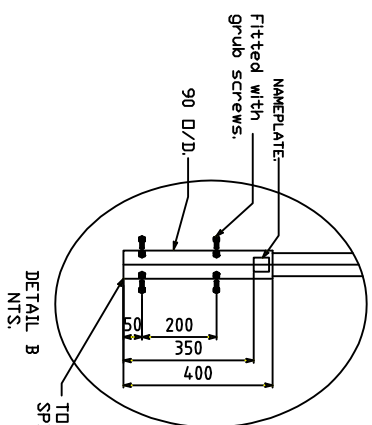


AMENDMENTS					
A	ORIGINAL ISSUE				
<table border="1"> <tr> <td>DATE</td> <td>BY</td> </tr> <tr> <td>DATE 12.2.2010</td> <td>BY RM--</td> </tr> </table>		DATE	BY	DATE 12.2.2010	BY RM--
DATE	BY				
DATE 12.2.2010	BY RM--				
MINIMUM SIZES					
ADDL.					
<table border="1"> <tr> <td>DATE</td> <td>BY</td> </tr> <tr> <td>DATE 12.2.2010</td> <td>BY RM--</td> </tr> </table>		DATE	BY	DATE 12.2.2010	BY RM--
DATE	BY				
DATE 12.2.2010	BY RM--				
STOCKCODE ADDL.					
<table border="1"> <tr> <td>DATE</td> <td>BY</td> </tr> <tr> <td>DATE 12.2.2010</td> <td>BY RM--</td> </tr> </table>		DATE	BY	DATE 12.2.2010	BY RM--
DATE	BY				
DATE 12.2.2010	BY RM--				
MINOR CHANGES					
<table border="1"> <tr> <td>DATE</td> <td>BY</td> </tr> <tr> <td>DATE 12.2.2010</td> <td>BY RM--</td> </tr> </table>		DATE	BY	DATE 12.2.2010	BY RM--
DATE	BY				
DATE 12.2.2010	BY RM--				
DRAWING FRAME.					

NOTES:

1. ALL STEEL PLATES TO CONFORM TO AS 3678 GRADE 250 U.O.N.
2. ALL STEEL BARS AND SECTIONS TO CONFORM TO AS 3679 GRADE 250 U.O.N.
3. ALL STEEL PIPES TO CONFORM TO AS 1163 GRADE 250 U.O.
4. ALL FILLET WELDS TO BE 6mm CONTINUOUS U.O.N. AND CONFORM TO AS 1554.
5. ALL SHARP EDGES AND BURRS TO BE REMOVED.
6. ALL STEEL TO BE FULLY HOT DIP GALVANIZED AFTER FABRICATION IN ACCORDANCE WITH AS4680.

2.0m. post top extension.
IE 2.0 PTE
Stockcode - 1542265

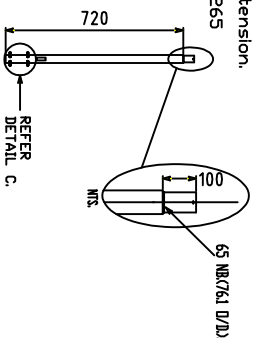

Endeavour Energy CURVED PIPE OUTREACHES FOR MINOR ROADS GENERAL DETAIL											
						DID NOT SCALE					
						REFERENCE DRAWINGS					
						AUTHORISED					
						W. ISLEY					
						NUMERICAL DISTRIBUTION ENGINEERING					
						SCALE					
A4						262717					
						E					
SHEET No. 1 OF 1 SHEETS											