


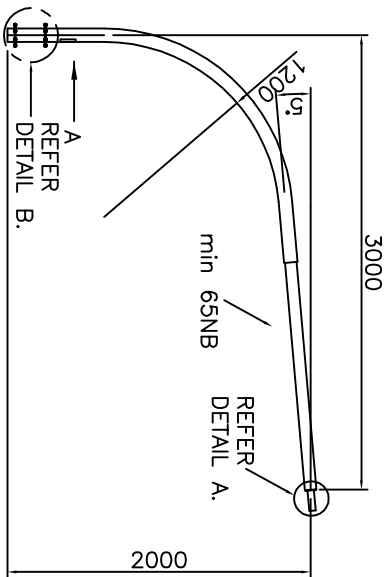


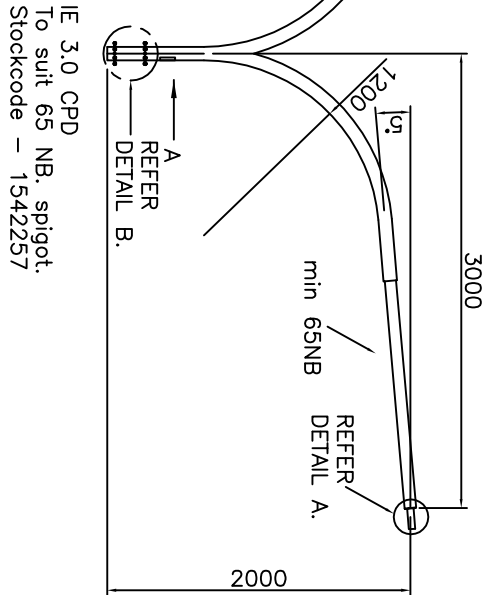



IE 3.0 CPS
To suit 65 NB. spigot.
Stockcode – 1540210

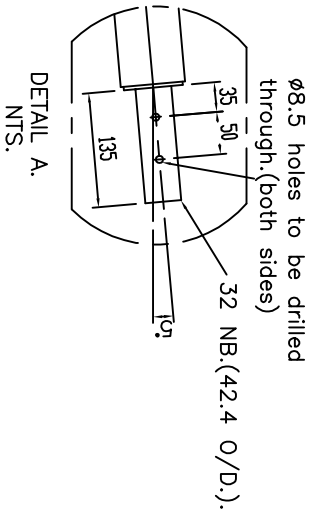


IE 3.0 CPD
To suit 65 NB. spigot.
Stockcode – 1542257

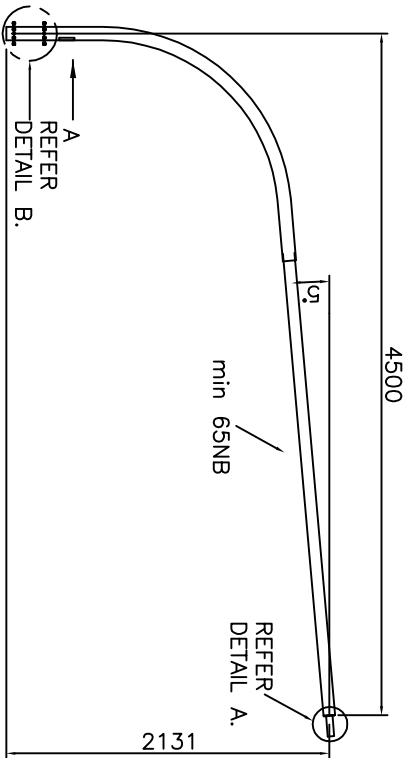


IE 4.5 CPS
To suit 65 NB. spigot.
Stockcode – 1540228

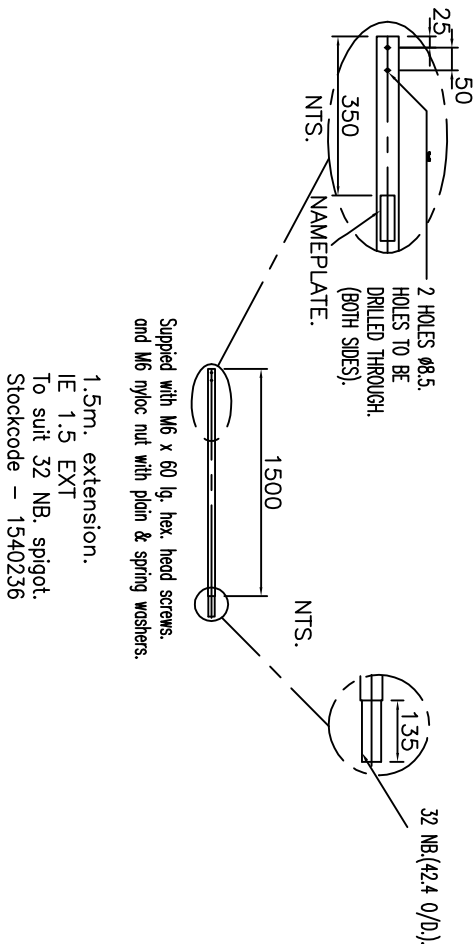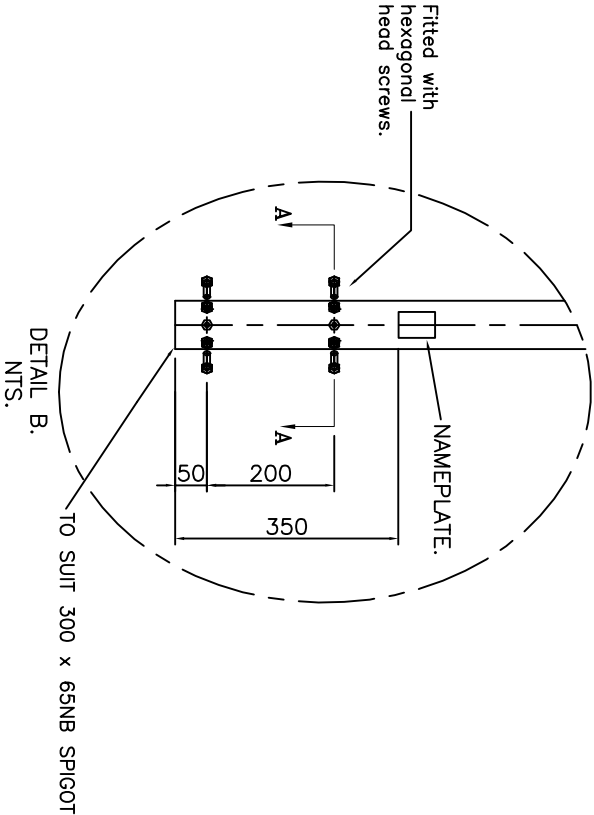

1.5m. extension.
IE 1.5 EXT
To suit 32 NB. spigot.
Stockcode – 1540236

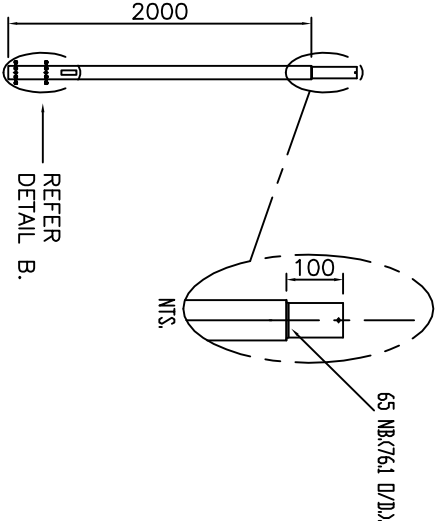

2.0m. post top extension.
IE 2.0 PTE
Stockcode – 1542265

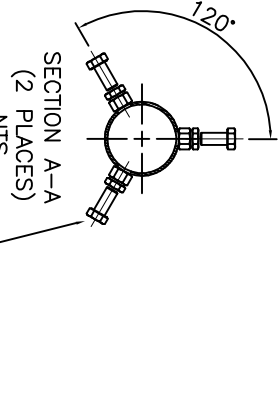

- NOTES:**
1. ALL STEEL PLATES TO CONFORM TO AS 3678 GRADE 250 U.O.N.
 2. ALL STEEL BARS AND SECTIONS TO CONFORM TO AS 3679 GRADE 250 U.O.N.
 3. ALL FILET WELDS TO BE 6mm CONTINUOUS U.O.N. AND ARE TO CONFORM TO AS1554, PART 1, CATEGORY G.P. U.O.N
 4. ALL SHARP EDGES AND BURRS TO BE REMOVED.
 5. ALL TAPER LOCK JOINT LENGTHS ARE NOMINAL U.O.N.
 6. ALL STEEL TO BE FULLY HOT DIP GALVANIZED AFTER FABRICATION IN ACCORDANCE WITH AS1650.

AMENDMENTS			
A	ORIGINALS ISSUE		
PW		18/04/01	
B	MINIMUM SIZES ADDED		
BJH		1/3/04	
C	STOCKCODE ADDED		
LTB		21/5/08	
D	DETAIL B CHANGED		
JP		28/01/14	
DWG No		DESCRIPTION	
REFERENCE DRAWINGS			
		DO NOT SCALE DIMENSIONS IN MILLIMETRES	
AUTHORISED:		DATE: 18/04/01	
©The drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.			
PT ENG FILENAME:		CHECKED: PA	
SCALE: 1:50		APPROVED: BH	
SHEET No 1 OF 1 SHEETS		SIZE: A3	
 Endeavour Energy		PO BOX 6366 BLACKTOWN, NSW 2148 PHONE: 131 081 FAX: 02 96555160	
MAJOR ROAD OUTREACHES STANDARD SERIES GENERAL ARRANGEMENT PUBLIC LIGHTING		REV No: D	