


AMENDMENTS	
A	ORIGINAL ISSUE
J R No.	NA
DRN	D.J.Z.
CHD	D.J.Z.
DATE	11-12-92
JR No	920301
DIM 750 WAS 800.	
M.S.D.	B.M.C.D.
DRN	D.J.Z.
CHD	D.J.Z.
DATE	18-5-93
JR No	930095
VOCAB No 5810509	
TERMINAL BLOCK FOR NEUTRAL CONNECTION	
ADDED.JPC VOCAB No SC10082 DELETED.	
M.S.D.	B.M.C.D.
DRN	D.J.Z.
CHD	D.J.Z.
DATE	11-6-93
JR No	930105
19/2.14 BARE EARTH CABLE DELETED.	
INTERNAL INSULATING SHEET ADDED.	
M.S.D.	B.M.C.D.
DRN	D.J.Z.
CHD	D.J.Z.
DATE	30-8-95
JR No	950162
DIMS FOR CONDUITS, SERVICE CABLE AND TERMINAL BLOCK REVISED RELATIVE TO COLUMN DOOR. PICTORIALLY REVISED TO SHOW ALTERNATIVE EARTHING ON DECORATIVE COLUMN.	
M.M.S.	GVH.
DRN	D.J.Z.
CHD	GVH.
DATE	27-11-96
JR No	960076
NOTE 1 ADDED. REF DRGS 075106, 241053 AND 241977 ADDED. REF DRG 241052 WAS 060911. TERMINAL BLOCK WAS 50 BELOW TOP EDGE OF COLUMN DOOR. DECORATIVE COLUMN EARTHING DELETED.	
M.M.A.	GVH.
DRN	D.J.Z.
CHD	D.J.Z.
DATE	17-7-97
JR No	970055
DIM 135 WAS 125	
M.M.A.	GVH.
DRN	GSF
CHD	GSF
DATE	24-8-05
JR No	
3 HOLE SERVICE BLOCKS REPLACED WITH SIX HOLE BLOCKS. STREETLIGHT FUSE ADDED	
MAE	GSF
DRN	VOITA
CHD	B.H.
DATE	2.2.2009
JR No	
ITEM 1 & 2 AND BORDER CHANGED, REDRAWN	
MAE	W.I.
DRN	BIB
CHD	D.H.
DATE	12.4.2010
JR No	
ITEM 2, 13 & 15 AND DRAWING UPDATED, REDRAWN.	
MAE	J.P.
DRN	BIB
CHD	D.H.
DATE	11.11.2010
JR No	
ITEM 5 AND 6 UPDATED.	
MAE	J.P.
DRN	JP
CHD	E.W.
DATE	9.07.2025
JR No	
MATERIAL No. ADDED. REFERENCES UPDATED. SCHEDULE UPDATED.	
EDM	K.S.

- NOTES**
- FOR 3 PHASE CABLES, 3 CABLE TERMINATION BLOCKS AND ONE NEUTRAL CABLE TERMINATION BLOCK ARE REQUIRED.
 - ITEM 5 (NEUTRAL BOND CABLE) SHALL BE LOOPED WITH A MINIMUM OF 600MM EXCESS.



ITEM	QTY	DESCRIPTION	MAT. No.
14	1	STREETLIGHT COLUMN	-
13	2	M10 SS WASHER	1000000137
12	1	CABLE TERMINAL BLOCK SERVICE LINK 6 HOLES	1000007366
11	1	CABLE TERMINAL BLOCK - NEUTRAL	1000007366
10	1	1 MAINS INCOMING	-
9	1	2 CORE 2.5mm ² BUNCHED COPPER CABLE	-
8	2	S/STEEL LOCKING NUT - M10 - EARTH STUD	1000000133
7	1	LANTERN NEUTRAL CONNECTION	-
6	1	COPPER CRIMP LUG 16mm ² SCREW M10	-
5	1	16mm ² NEUTRAL BOND, GREEN/YELLOW INSULATION	-
4	1	50mm UPVC CONDUITS H.D.	-
3	-	STREETLIGHT ONLY IDENTIFICATION CAP	1000005870
2	1	FUSE CARTRIDGE - 10 AMP	-
1	1	FUSE CARRIER	1000005684

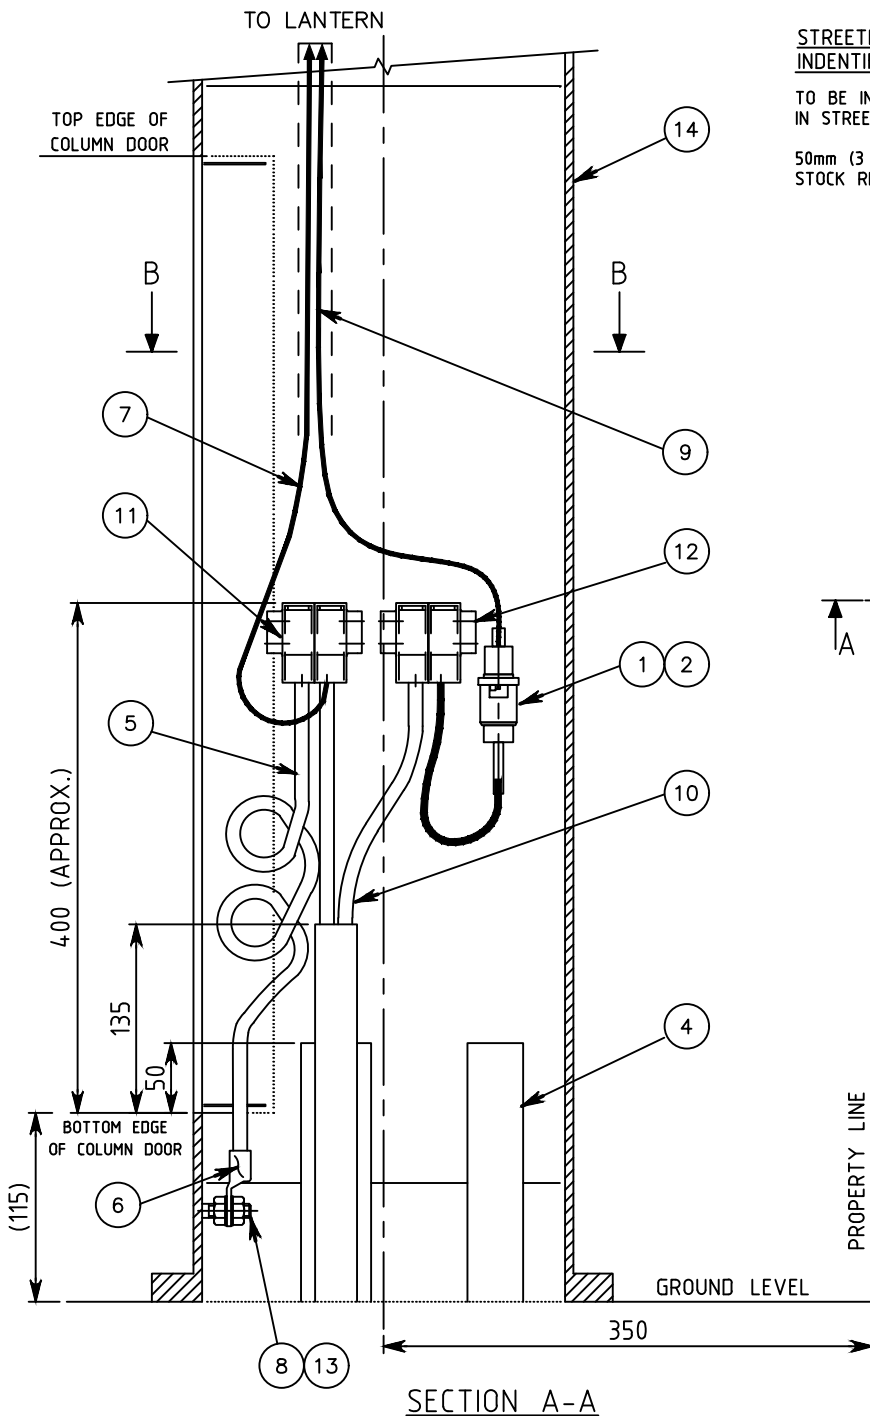

STREETLIGHT ONLY IDENTIFICATION CAP

TO BE INSTALLED ON ACTIVE BLOCK IN STREETLIGHT ONLY COLUMNS.

50mm (3 HOLE BLOCK)
STOCK REF: 1557651

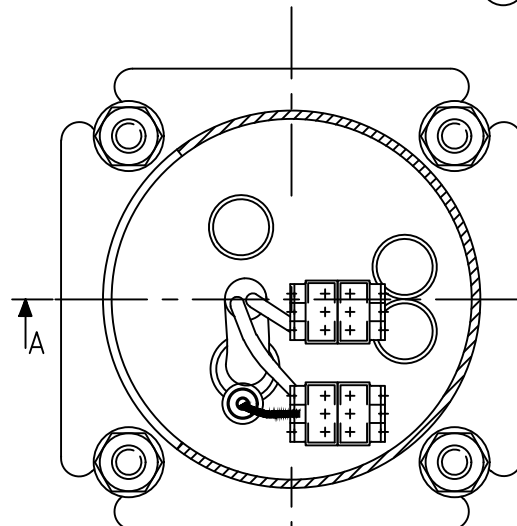

SECTION B-B
NEUTRAL TO EARTH CONNECTION
NOT SHOWN FOR CLARITY

		This drawing and the copyright therein to the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.	
ORIGINAL SCALE	APPROVED G. FORD		
DRAWN D.J.Z.			
DATE 23.9.1992			
CHD B.H.		STREETLIGHT COLUMN STREETLIGHT CONNECTION ARRANGEMENT	

STREETLIGHT COLUMN		-
SERVICE CABLE TERMINAL BLOCK 6 HOLE		241053
SERVICE CABLE TERMINAL BLOCK 3 HOLE		241052
STREETLIGHT CONNECTION DETAILS		280143
REFERENCE DRAWINGS		
DO NOT SCALE DIMENSIONS IN MILLIMETRES		AUTHORISED W. ISLEY
MANAGER ASSET ENGINEERING		12.2.2009
A4		075035 L
SHEET No 1 OF 1 SHEETS		