
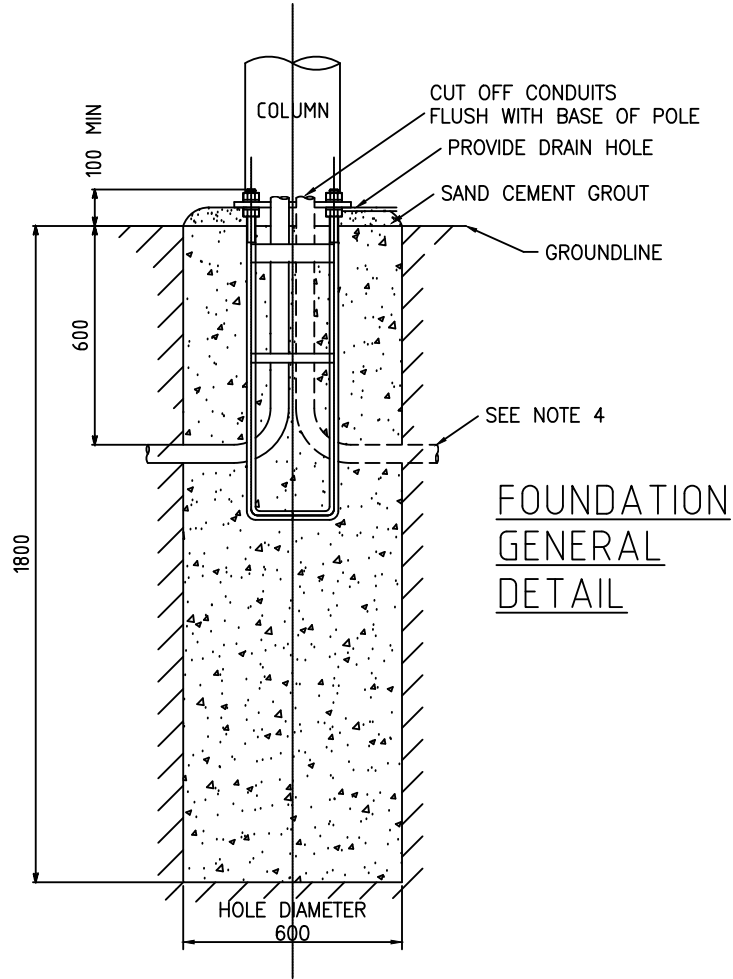


AMENDMENTS	
A	ORIGINAL ISSUE
B	
DR'N	BTH
CH'D	ST
DATE	30.6.05
JR NQ	--
GROUNDLINE INCLUDED. HOLE DEPTH WAS 1500. CONDUIT DEPTH WAS 500 & 300.	
M.A.E.	W.I.
C	
DR'N	BIB
CH'D	D.H.
DATE	12.4.2010
JR NQ	--
CHANGES TO DRAWING FRAME	
M.A.E.	J.P.
D	
DR'N	S.F.
CH'D	E.W.
DATE	25-11-24
JR NQ	N/A
REPLACED STOCK CODE BY MATERIAL NO.	
EDM	K.S.

- NOTES:
1. ANY VARIATION TO DIMENSIONS TO BE APPROVED BY LIGHTING SOLUTIONS MANAGER.
 2. CONCRETE MIN . COMP STRENGTH 20MPa
 3. INSTALL 50mm DIAMETER CONDUIT AS REQUIRED. USE LARGE RADIUS BENDS.

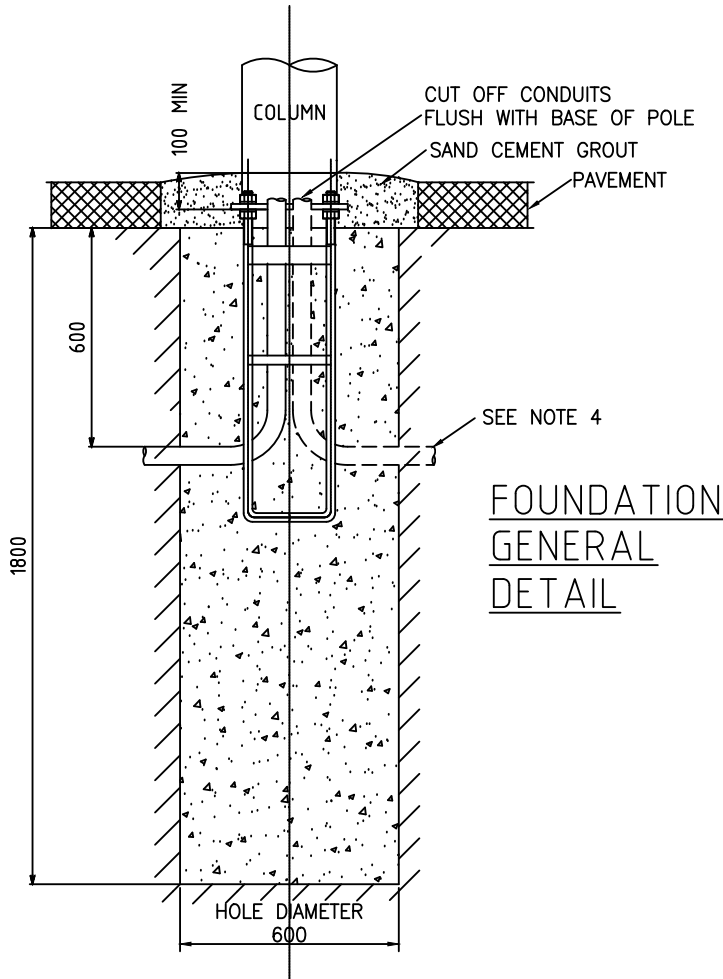

TYPE 2 RAGBOLT ASSEMBLY MATERIAL NO. 1000008030 OR
UNIVERSAL RAGBOLT ASSEMBLY MATERIAL NO. 1000000504

		 Endeavour Energy						
 © This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.				REFERENCE DRAWINGS				
 ORIGINAL SCALE		APPROVED BH		DO NOT SCALE DIMENSIONS IN MILLIMETRES		AUTHORISED W. ISLEY		
DRAWN	PW			UNIVERSAL FOUNDATION INSTALLATION DETAIL		MANAGER DISTRIBUTION ENGINEERING		29.6.01
DATE	29.6.01					A4	263983	D
CH'D	PA						SHEET No 1 OF 1 SHEETS	