


AMENDMENTS	
A	ORIGINAL ISSUE
B	3 HOLE SERVICE BLOCK REPLACED WITH 6 HOLE.
C	IPC REMOVED FROM DRAWING. FUSE SIZE ADDED.
D	FUSE CARRIER FLEXIBLE TAIL DETAIL ADDED.
E	MATERIAL NUMBERS UPDATED.
EDM	K.S



FUSE CARTRIDGE SIZES:
COLUMN FUSE CARTRIDGE SIZE = 10A
PILLAR FUSE CARTRIDGE SIZE = 16A

		© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.	
	ORIGINAL SCALE	APPROVED W. ISLEY	
DRAWN	DFL	DATE	
DATE	25.6.03		
CHECKED	DPM		

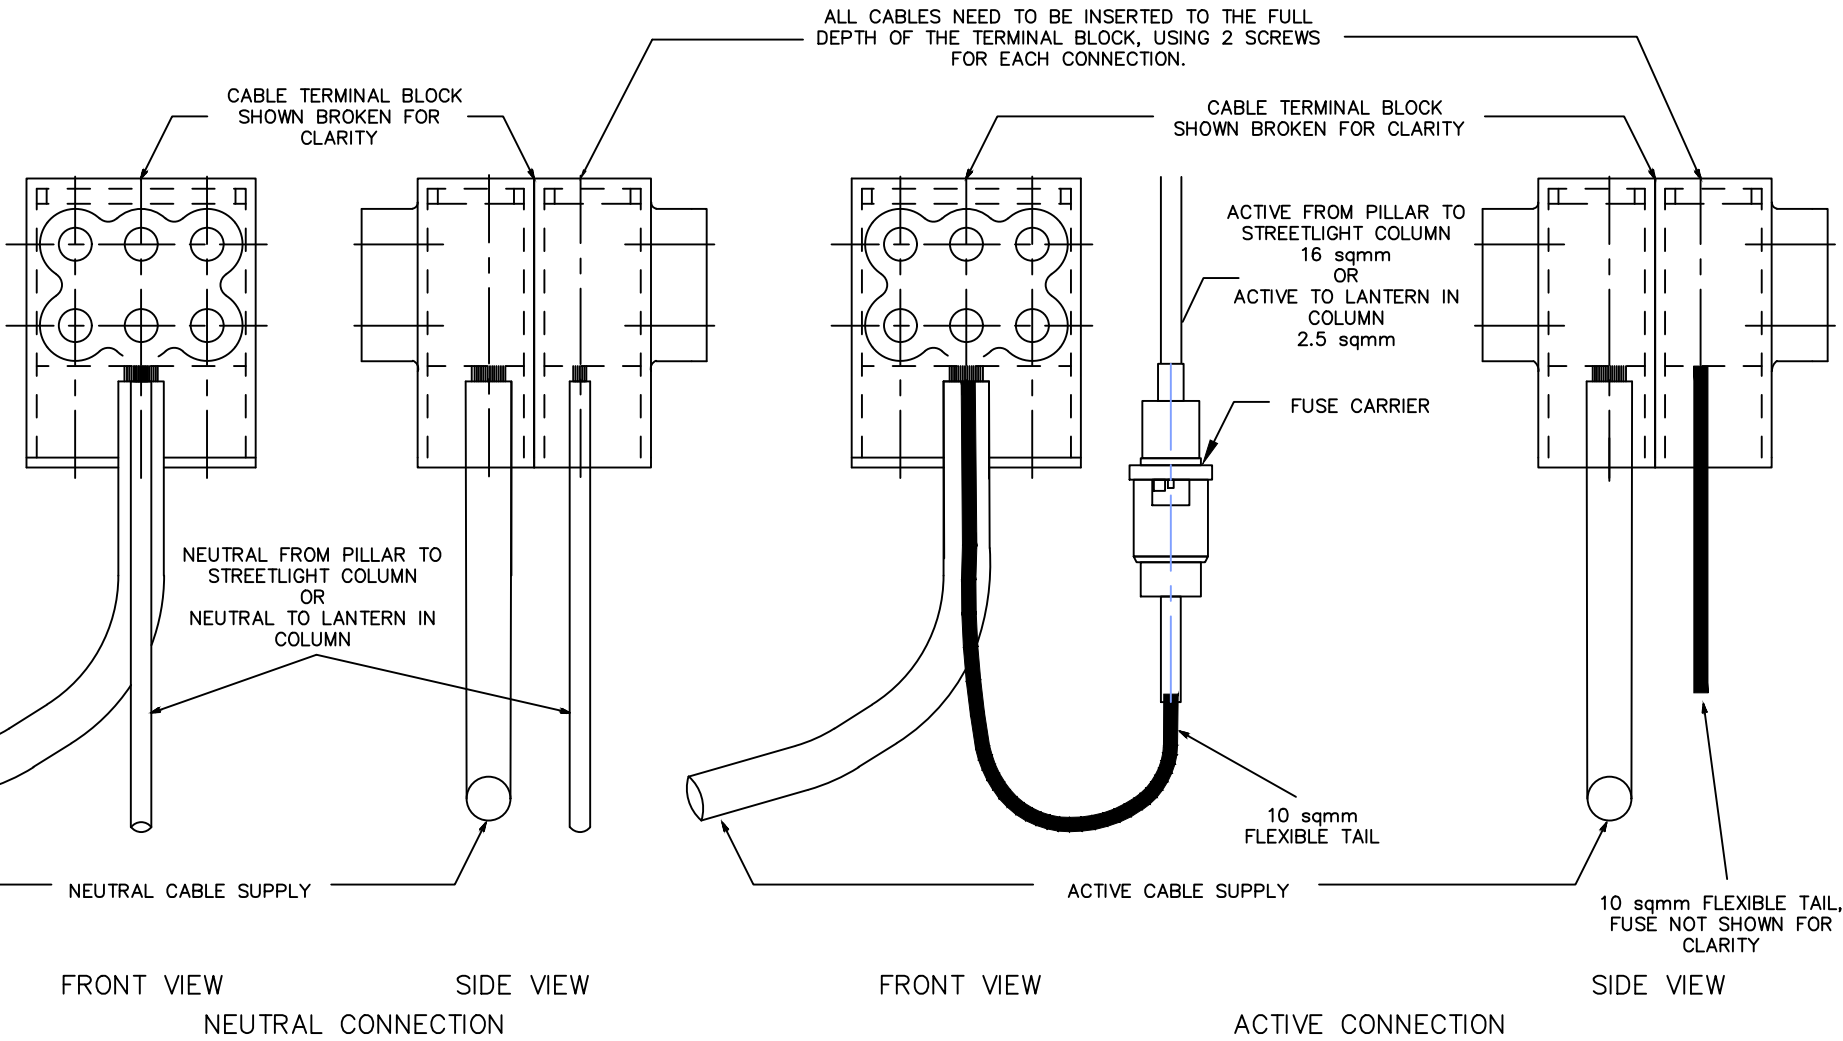

PE CELL CONTROLLED
STREET LIGHTING
TERMINATION ARRANGEMENT

10A CARTRIDGE	1000000372
16A CARTRIDGE	1000001875
FUSE CARRIER	1000005684
SERVICE CABLE TERMINAL BLOCK 6 HOLE	1000007366
REFERENCE DRAWINGS	
DO NOT SCALE DIMENSIONS IN MILLIMETRES	AUTHORISED/CERTIFIED W. ISLEY
ENGINEERING DELIVERY MANAGER	
A4	280143 E
SHEET No 1 OF 1 SHEETS	