


AMENDMENTS	
A	ORIGINAL ISSUE
B	
DR'N	VO/HA
CH'D	BH
DATE	17.3.2009
JR No	--
REDRAWN. CIRCUIT REMOVED. TITLE MODIFIED.	
M.A.E.	W.I.
C	
DR'N	BIP
CH'D	DH
DATE	12.4.2010
JR No	--
CHANGED FRAME AND LINEWEIGHTS.	
D	
M.A.E.	J.P.
DR'N	BIP
CH'D	DH
DATE	24.1.2011
JR No	--
NOTE ADDED FOR NEW INSTALLATIONS.	
E	
M.A.E.	J.P.
DR'N	SF
CH'D	EW
DATE	27-05-25
JR No	--
TIME CLOCK ADDED.TB UPDATED. STOCK CODE REPLACED BY MATERIAL NO.	
EDM	KS

NOTES:
1). TO BE FITTED INSIDE ENLARGED BASE POLES ONLY. NOT TO BE FITTED IN IMPACT ABSORBANT POLES.

ITEM	DESCRIPTION	VOCAB No	QTY
1	PANEL BAKELITE		1
2	NEUTRAL LINK 7 HOLE		1
3	AF RELAY/TIME CLOCK		1
4	50A FUSE SIEMENS TYPE 3NWCM63F		1
5	3 PHASE CONTACTOR SIEMENS TYPE 3RT1036-1A		1
6	4A FUSE		1
7	80A CIRCUIT BREAKER TYPE ABB E271		1
8	COVERED TERMINAL STRIP HPM		1
9	METAL MOUNTING BRACKETS - 3mm THICK		2
10	MOUNTING SCREW		
11	ACTIVE LINK 7 HOLE		1

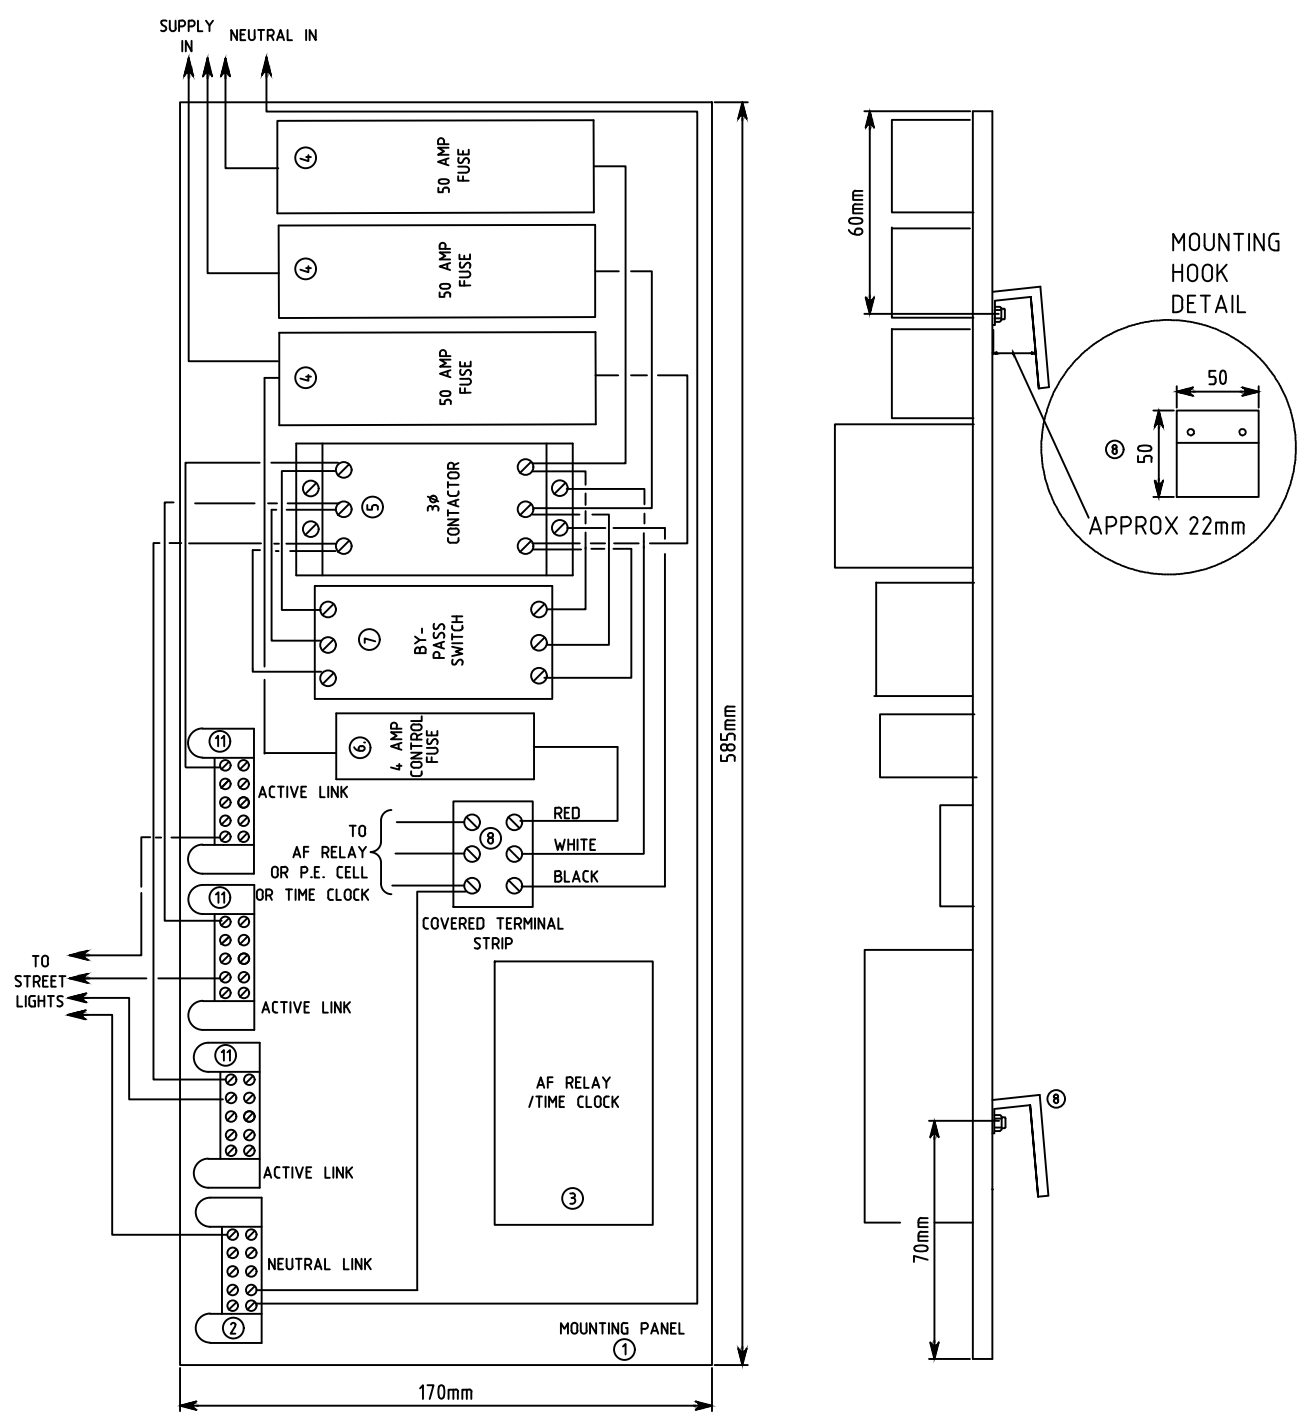

NOT TO BE USED FOR
NEW INSTALLATIONS

PART No.: SLCP3C, MATERIAL NO.: 1000005495

Endeavour Energy

DO NOT SCALE
DIMENSIONS
IN MILLIMETRES

REFERENCE DRAWINGS

AUTHORISED
W. ISLEY

ENGINEERING DELIVERY MANAGER

17.4.2009

STREETLIGHT CONTROL POINT
THREE PHASE COLUMN
EQUIPMENT LAYOUT

A4

287037

E

SHEET No 1 OF 1 SHEETS

ORIGINAL SCALE

APPROVED
S. TURKI

Drawn by B.J.H.

DATE 5.2.04

CHD B.Harrigan