


AMENDMENTS	
A	ORIGINAL ISSUE
B	DR'N VO/HA
	CH'D BH
	DATE 17.3.2009
	JR No - -
REDRAWN. CIRCUIT REMOVED. TITLE MODIFIED.	
C	M.A.E. W.I.
	DR'N BIP
	CH'D DH
	DATE 12.4.2010
	JR No - -
CHANGED FRAME AND LINEWEIGHTS.	
D	M.A.E. JP.
	DR'N BIP
	CH'D DH
	DATE 24.1.2011
	JR No - -
NOTE ADDED FOR NEW INSTALLATIONS.	
E	M.A.E. JP.
	DR'N SF
	CH'D EW
	DATE 27-05-25
	JR No - -
TIME CLOCK ADDED. TB UPDATED. STOCK CODE REPLACED BY MATERIAL NO	
EDM KS	

NOTES:

1). TO BE FITTED INSIDE ENLARGED BASE POLES ONLY. NOT TO BE FITTED IN IMPACT ABSORBANT POLES.

ITEM	DESCRIPTION	VOCAB No	QTY
1	PANEL BAKELITE		1
2	NEUTRAL LINK 7 HOLE		1
3	AF RELAY/TIME CLOCK		1
4	50A FUSE SIEMENS TYPE 3NWCM63F		1
5	3 PHASE CONTACTOR SIEMENS TYPE 3RT1036-1A		1
6	4A FUSE		1
7	80A CIRCUIT BREAKER TYPE ABB E271		1
8	COVERED TERMINAL STRIP HPM		1
9	METAL MOUNTING BRACKETS - 3mm THICK		2
10	MOUNTING SCREW		
11	ACTIVE LINK 7 HOLE		1
12	MOUNTING HOOK		2

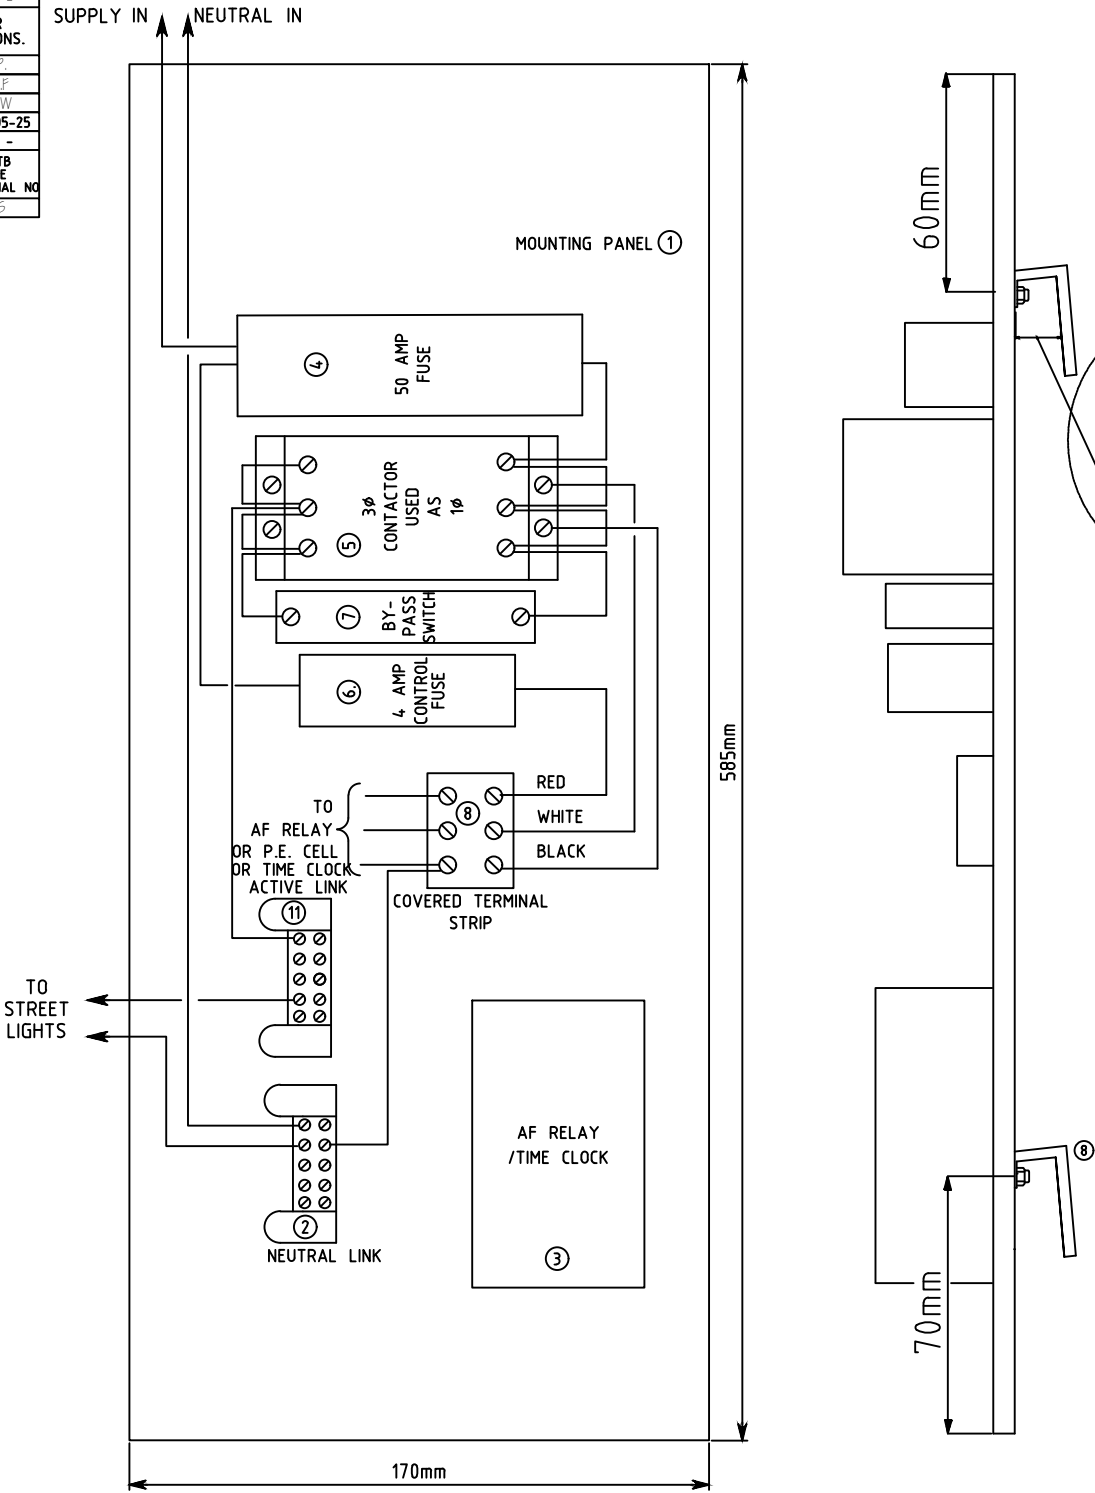

PART No.: SLCP1C, MATERIAL NO.: 1000007859

		This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.	
ORIGINAL SCALE	APPROVED S. TURKI		
DRAWN B.JH			
DATE 5.2.04			
CHD B.Harrigan			



STREETLIGHT CONTROL POINT
SINGLE PHASE COLUMN
EQUIPMENT LAYOUT

DO NOT SCALE DIMENSIONS IN MILLIMETRES		REFERENCE DRAWINGS	
		AUTHORISED W. ISLEY	
		ENGINEERING DELIVERY MANAGER	17.4.2009
A4	287038	Rev.	E
SHEET No 1 OF 1 SHEETS			