


AMENDMENTS		
A	ORIGINAL ISSUE	
	DR'N	VOTTA
	CH'D	B.H.
	DATE	17.3.2009
	JR No	- -
B	REDRAWN. CIRCUIT REMOVED. TITLE MODIFIED.	
	M.A.E.	W.I.
	DR'N	BIB
	CH'D	D.H.
	DATE	12.4.2010
	JR No	- -
C	CHANGED FRAME AND LINEWEIGHTS.	
	M.A.E.	J.P.
	DR'N	BIB
	CH'D	D.H.
	DATE	24.1.2011
	JR No	- -
D	NOTE ADDED FOR NEW INSTALLATIONS.	
	M.A.E.	J.P.
	DR'N	J.P.
	CH'D	E.W.
	DATE	27-05-2025
	JR No	N/A
E	TIME CLOCK ADDED.TB UPDATED. STOCK CODE REPLACED BY MATERIAL NO.	
	EDM	K.S

NOTES:
1.) MOUNTING POSITION OF SLCP DEPENDANT ON LV SWITCHGEAR USED. SLCP TO BE INCLUDED IN PACKAGE SUBSTATION.

ITEM	DESCRIPTION	VOCAB No	QTY
8	ACTIVE LINK 7 HOLE		2
7	80A CIRCUIT BREAKER TYPE ABB E271		1
6	4A FUSE		1
5	3 PHASE CONTACTOR SIEMENS TYPE 3RT1036-1A		1
4	50A FUSE SIEMENS TYPE 3NWCM63F		1
3	AF RELAY/TIME CLOCK		1
2	NEUTRAL LINK 7 HOLE		1
1	PANEL BAKELITE		1

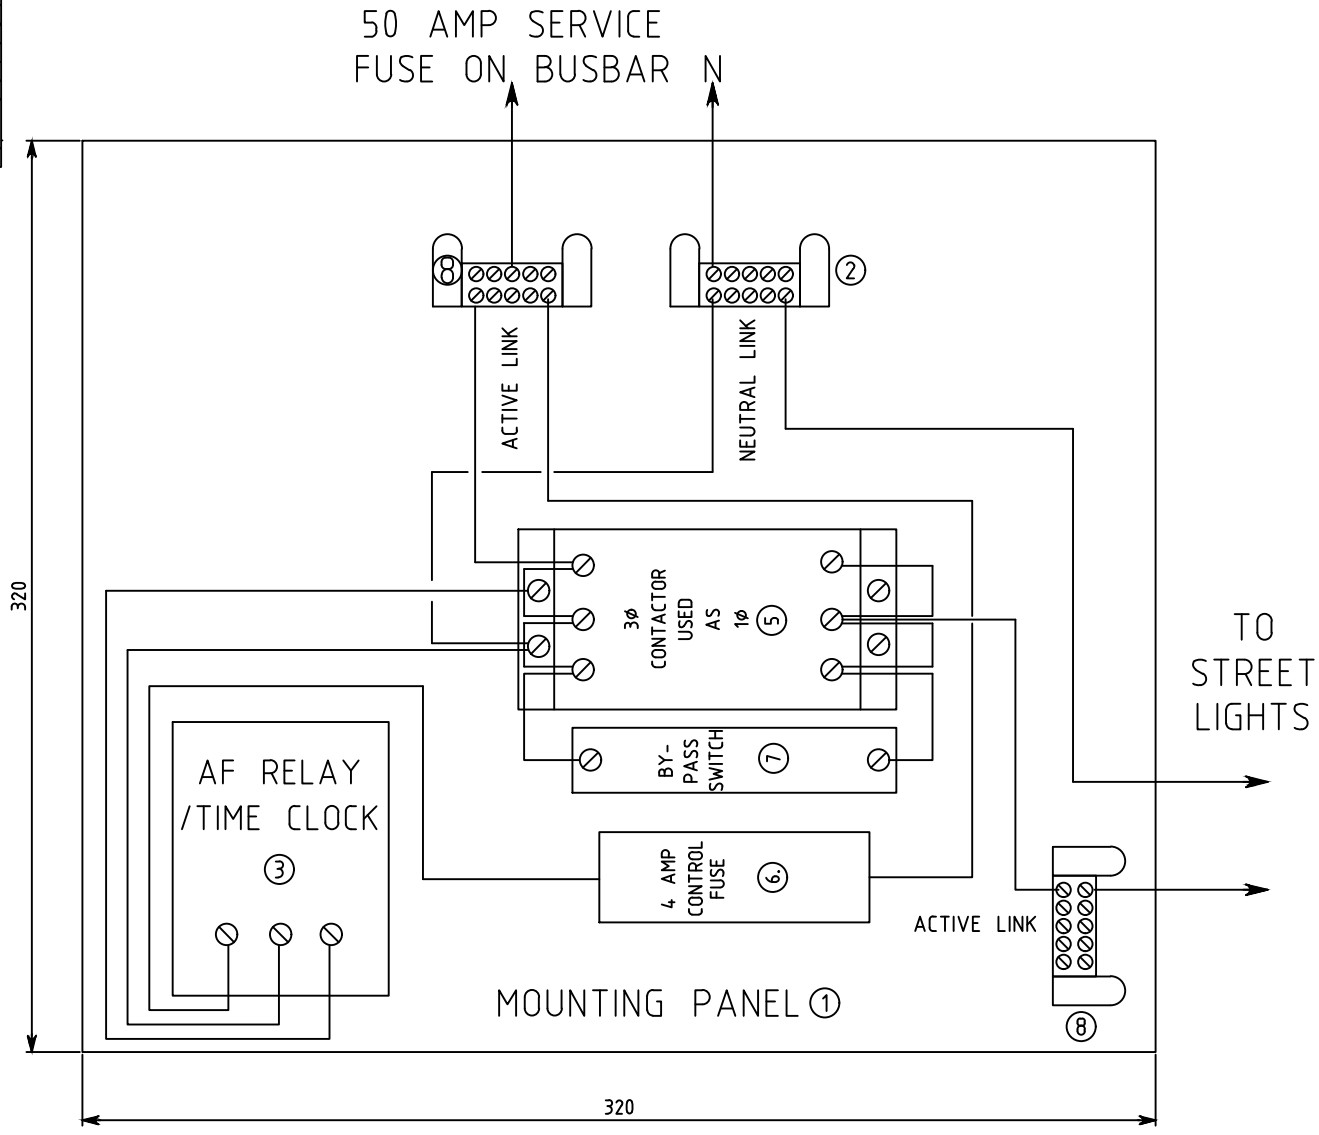

SINGLE PHASE STREETLIGHTS CONTROL POINT - EQUIPMENT LAYOUT

NOT TO BE USED FOR
NEW INSTALLATIONS

PART No.: SLCP1K, MATERIAL NO.: 1000007860

		This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.	
ORIGINAL SCALE	APPROVED S. TURKI	REFERENCE DRAWINGS	
DRAWN B.JH		DO NOT SCALE DIMENSIONS IN MILLIMETRES	AUTHORISED W. ISLEY
DATE 5.2.04		ENGINEERING DELIVERY MANAGER 17.4.2009	
CHD B.Harrigan		SHEET No 1 OF 1 SHEETS	

STREETLIGHT CONTROL POINT
PADMOUNT SUBSTATION SINGLE PHASE
EQUIPMENT LAYOUT

A4 287045 E