


AMENDMENTS	
A	ORIGINAL ISSUE
C	REDRAWN. CHANGED DRAWING FRAME.
D	NOTE ADDED FOR NEW INSTALLATIONS
E	TIME CLOCK ADDED TO STOCK CODE REPLACED BY MATERIAL NO.
M.A.E. J.P.	
DR'N	B.T.B
CH'D	D.H.
DATE	12.4.2010
JR No	- -
M.A.E. J.P.	
DR'N	B.T.B
CH'D	D.H.
DATE	24.1.2011
JR No	- -
M.A.E. J.P.	
DR'N	S.F
CH'D	E.W
DATE	27-05-25
JR No	N/A
EDM K.S	

NOTES:

1.) MOUNTING POSITION OF SLCP DEPENDANT ON LV SWITCHGEAR USED. SLCP TO BE INCLUDED IN PACKAGE SUBSTATION.

ITEM	DESCRIPTION	VOCAB No	QTY
1	PANEL BAKELITE		1
2	NEUTRAL LINK 7 HOLE		1
3	AF RELAY/TIME CLOCK		1
4	ACTIVE LINK 7 HOLE		6
5	3 PHASE CONTACTOR SIEMENS TYPE 3RT1036-1A		1
6	4A FUSE		1
7	80A CIRCUIT BREAKER TYPE ABB E273		1
8	MOUNTING SCREW		

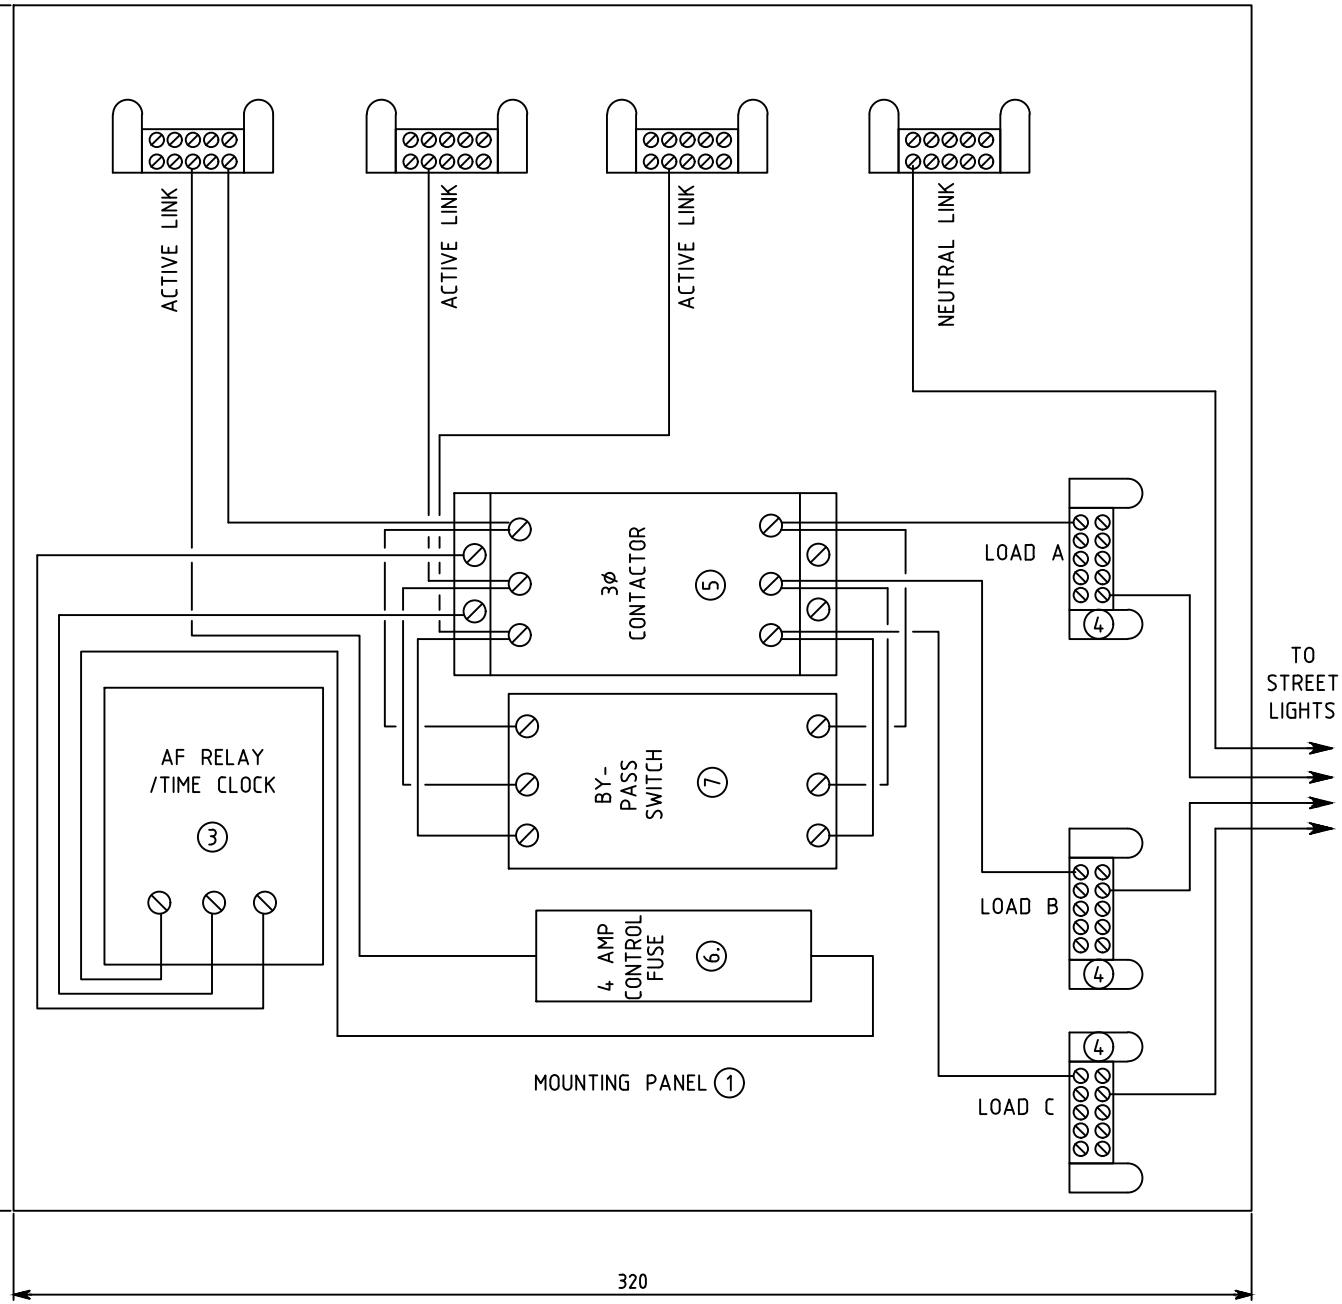

THREE PHASE STREETLIGHTS CONTROL POINT - EQUIPMENT LAYOUT

NOT TO BE USED FOR NEW INSTALLATIONS

PART No.: SLCP3K, MATERIAL NO.: 1000005297

STREETLIGHT CONTROL UNIT
PADMOUNT SUBSTATION THREE PHASE
EQUIPMENT LAYOUT

	DO NOT SCALE DIMENSIONS IN MILLIMETRES	REFERENCE DRAWINGS
APPROVED S. TURKI	ENGINEERING DELIVERY MANAGER 17.4.2009	REV. E
DRAWN B.H	DATE 5.2.04	SHEET No 1 OF 1 SHEETS
CHD B.Harrigan		