


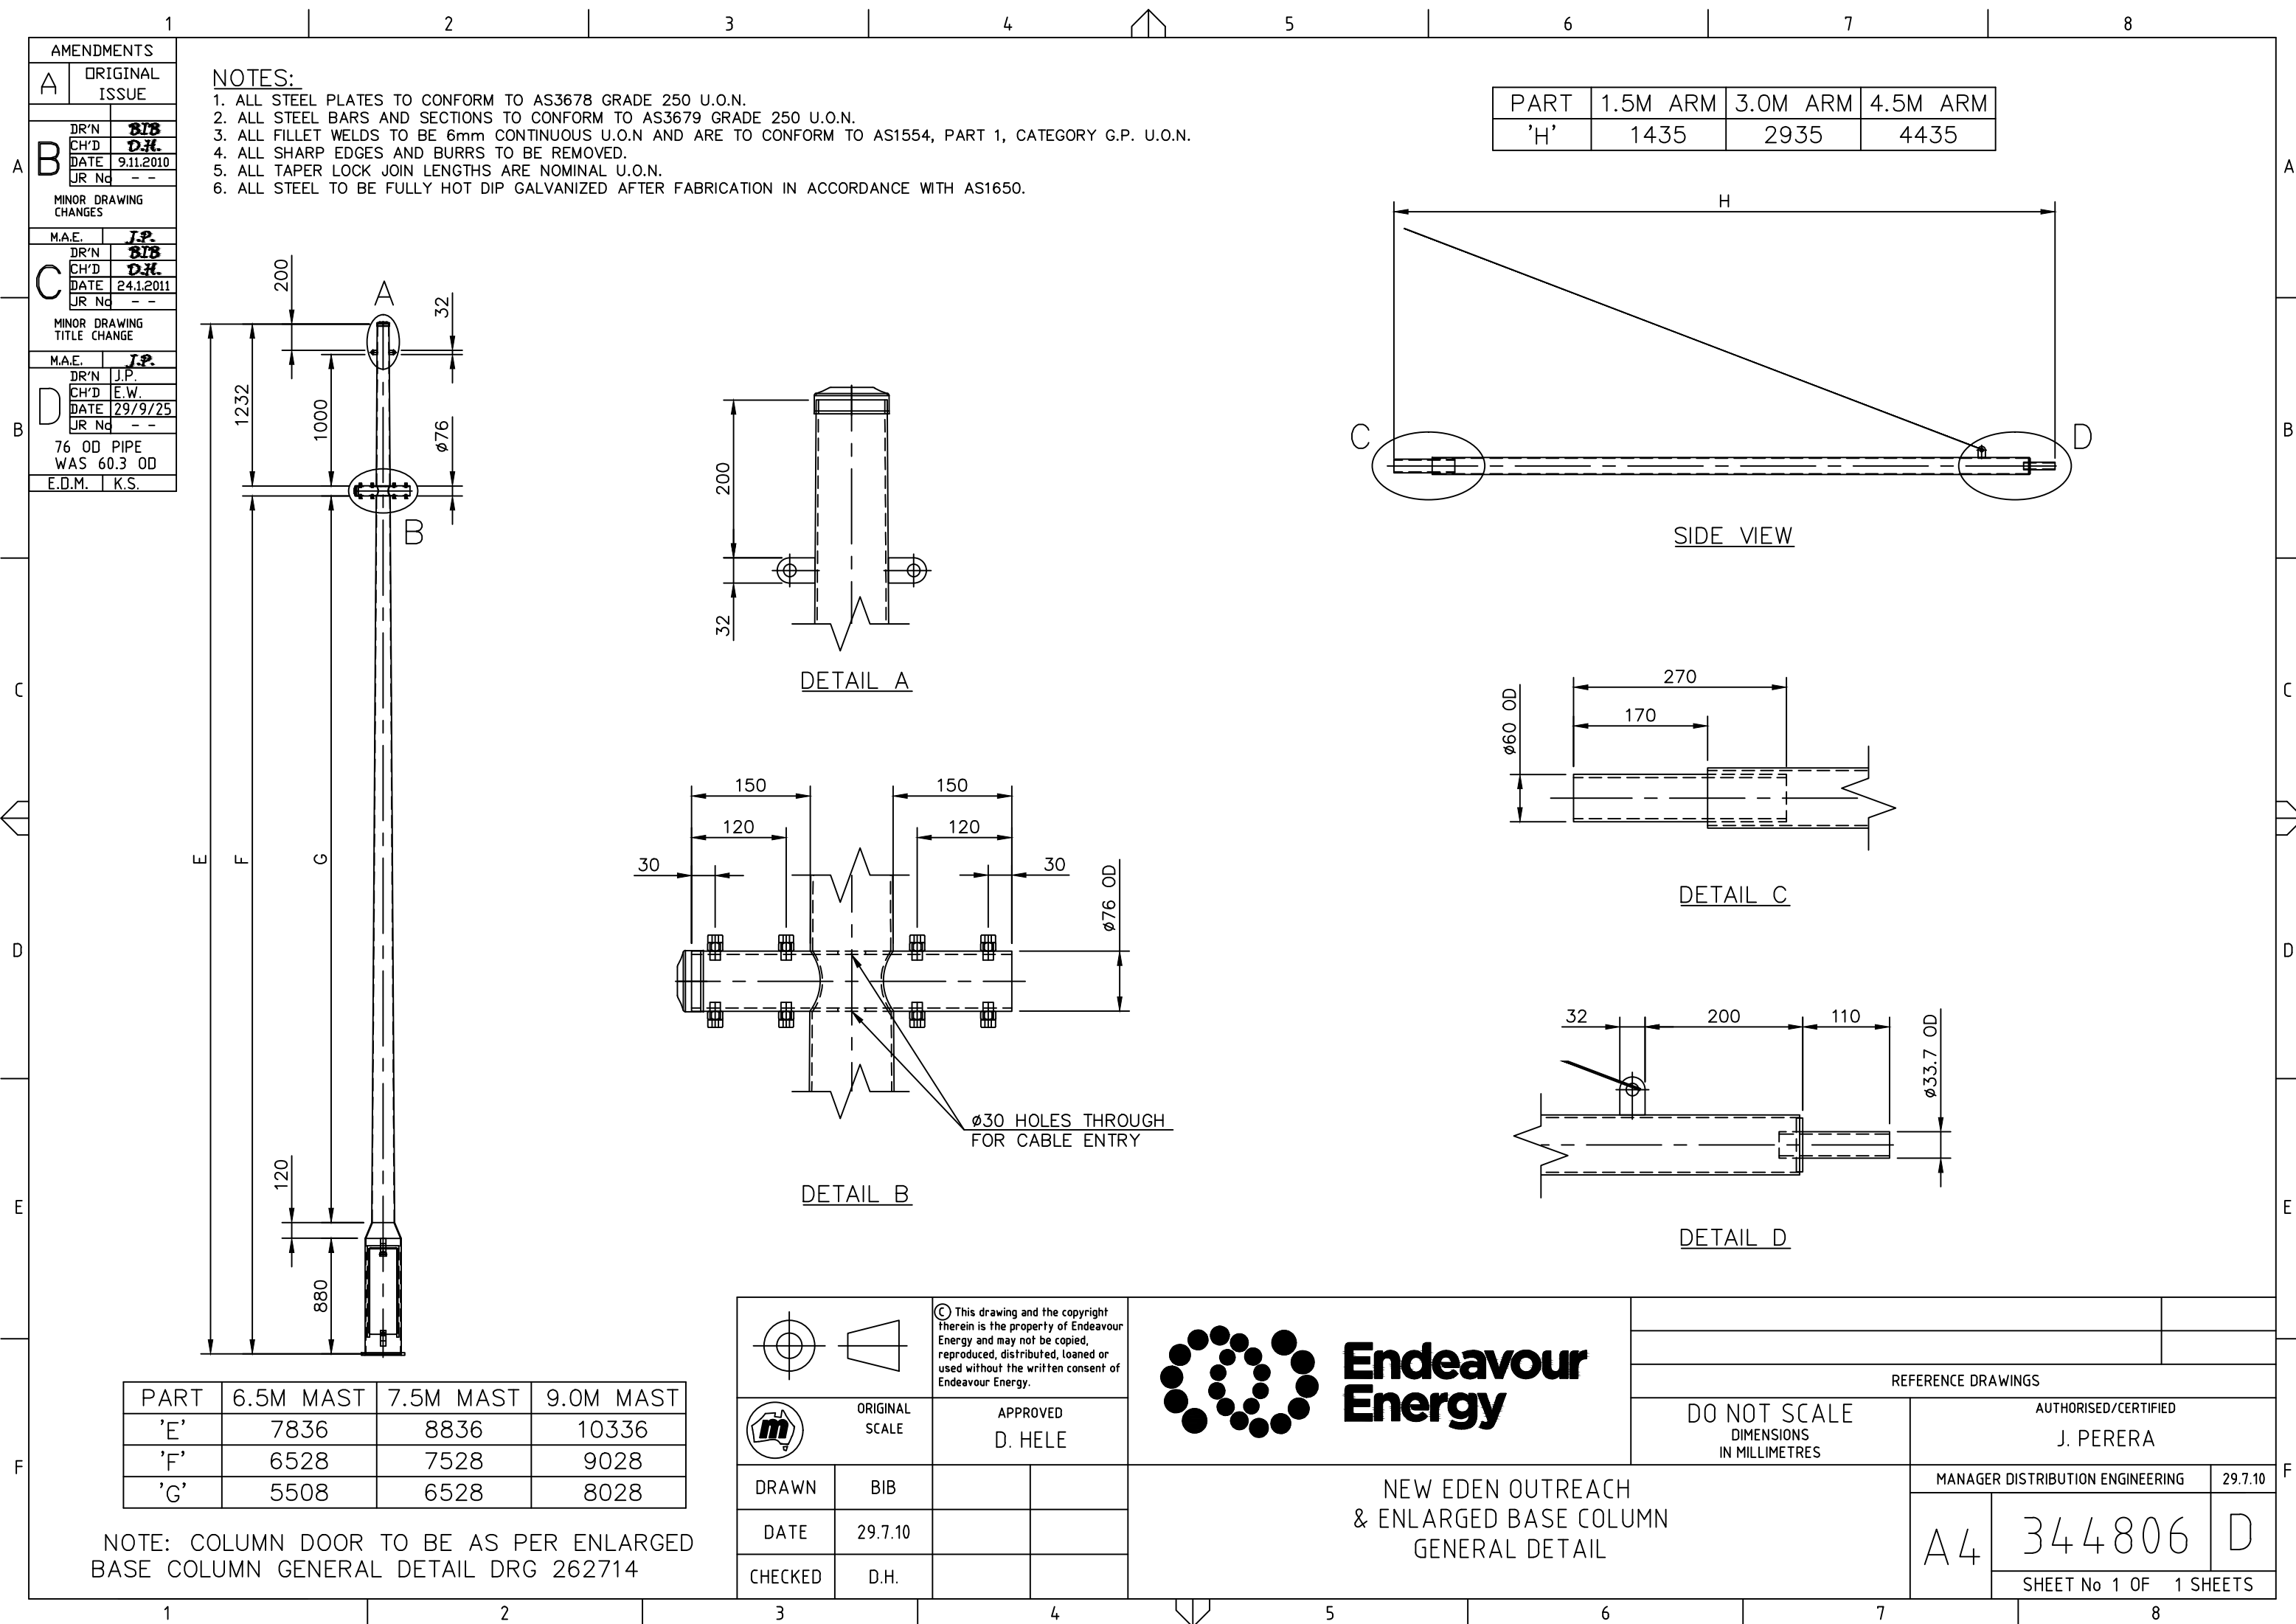



NOTES:


1. ALL STEEL PLATES TO CONFORM TO AS3678 GRADE 250 U.O.N.
2. ALL STEEL BARS AND SECTIONS TO CONFORM TO AS3679 GRADE 250 U.O.N.
3. ALL FILLET WELDS TO BE 6mm CONTINUOUS U.O.N AND ARE TO CONFORM TO AS1554, PART 1, CATEGORY G.P. U.O.N.
4. ALL SHARP EDGES AND BURRS TO BE REMOVED.
5. ALL TAPER LOCK JOIN LENGTHS ARE NOMINAL U.O.N.
6. ALL STEEL TO BE FULLY HOT DIP GALVANIZED AFTER FABRICATION IN ACCORDANCE WITH AS1650.

PART	1.5M ARM	3.0M ARM	4.5M ARM
'H'	1435	2935	4435

PART	6.5M MAST	7.5M MAST	9.0M MAST
'E'	7836	8836	10336
'F'	6528	7528	9028
'G'	5508	6528	8028

NOTE: COLUMN DOOR TO BE AS PER ENLARGED BASE COLUMN GENERAL DETAIL DRG 262714

		© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.	
	ORIGINAL SCALE	APPROVED D. HELE	
DRAWN	BIB		
DATE	29.7.10		
CHECKED	D.H.		



Endeavour Energy

NEW EDEN OUTREACH
& ENLARGED BASE COLUMN
GENERAL DETAIL

REFERENCE DRAWINGS

DO NOT SCALE
DIMENSIONS
IN MILLIMETRES

AUTHORISED/CERTIFIED
J. PERERA

MANAGER DISTRIBUTION ENGINEERING		29.7.10
A4	344806	D
SHEET No 1 OF 1 SHEETS		