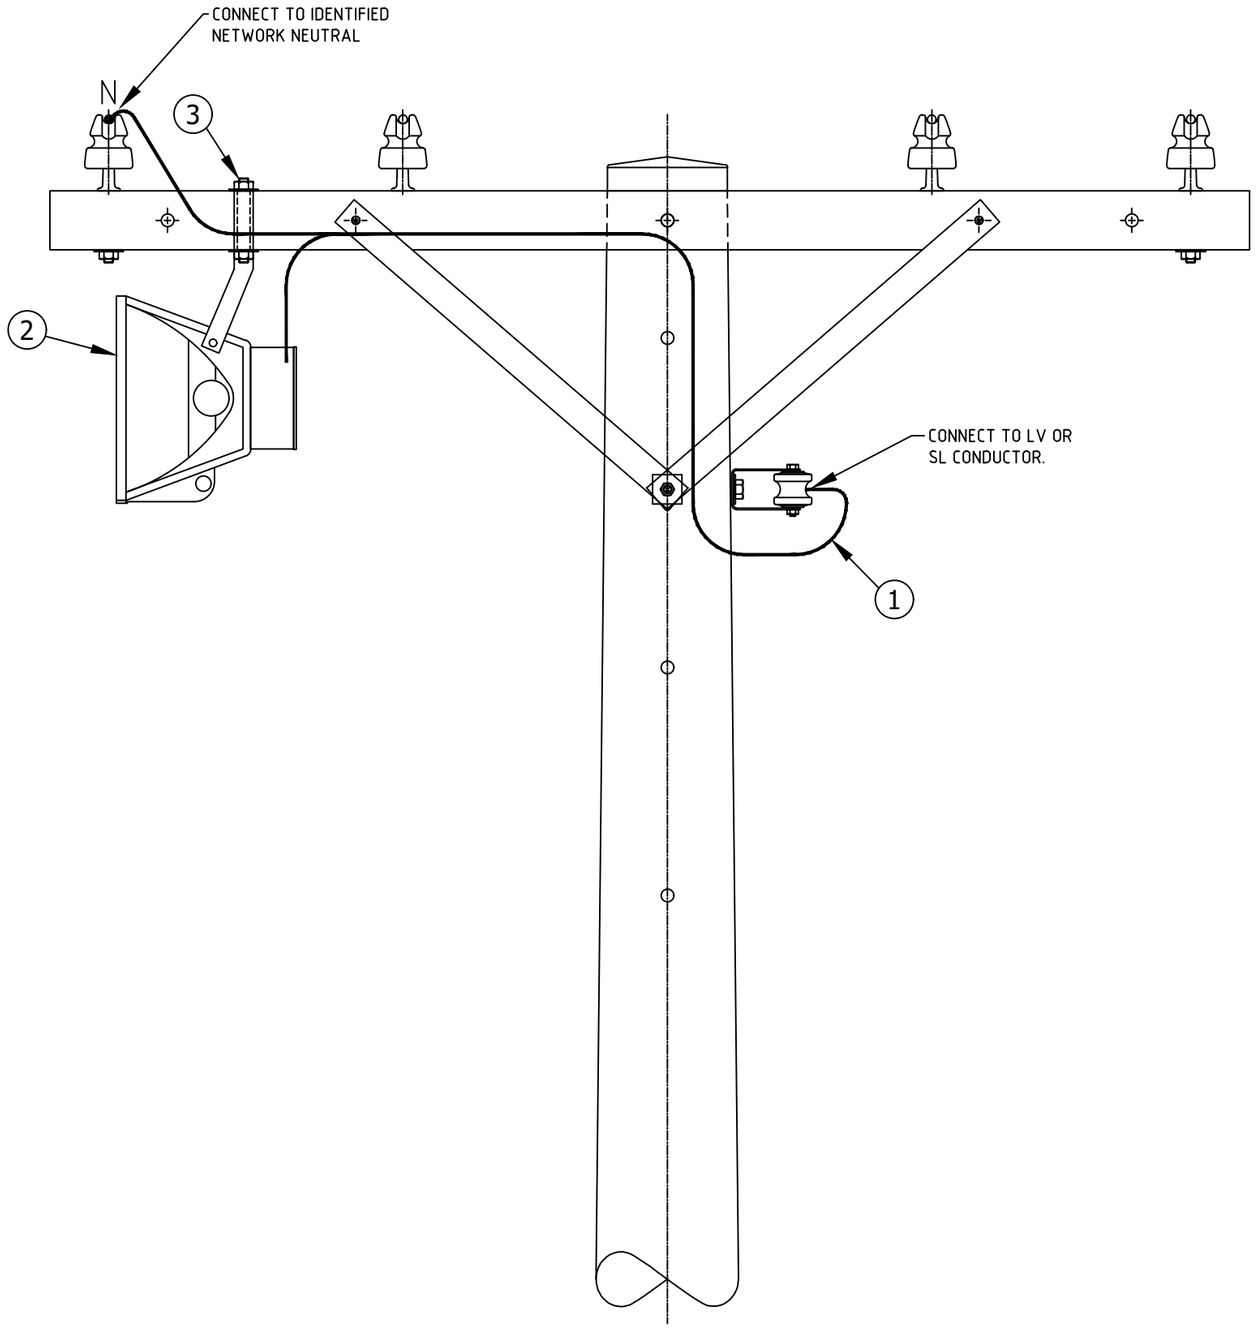

ITEM	QTY	DESCRIPTION	MATERIAL No.
1	A/R	2 CORE x 2.5 COPPER PVC/PVC CABLE 0.6/1kV BUNDLED	1000006070
2	1	FLOODLIGHT	
3	1	BOLT STEEL GALV. M12x125 COMPL. WITH NUT & WASHERS	

AMENDMENTS

JOB No	NA
DESIGN	Adrian G.
DR'N	KT
CH'D	Geof C.
DATE	29/01/26
APP'D	S.P.

E

HISTORY

REVISION A
ORIGINAL ISSUE

REVISION B
REDRAWN.
TITLE MODIFIED.

REVISION C
AMENDED DRAWING FRAME.

REVISION D
NOTE AMENDED. STOCK REFERENCES ADDED.

REVISION E
REDRAWN TO CAD.
DRAWING AMENDED TO REFLECT CONSTRUCTION METHOD AND STOCK.

© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

ORIGINAL SCALE NTS

APPROVED S.Turki

DESIGNED	B.Harrigan	DATE	12.12.96
DRAWN	Frank H.		
CHECKED	B.Harrigan		

Endeavour Energy

REFERENCE DRAWINGS

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

AUTHORISED/CERTIFIED
W.Isley
SUBSTATION DESIGN MANAGER 17.04.2009

FLOODLIGHT MOUNTED UNDER L.V CROSS ARM

A3

E03132

SHEET No 1 OF 1 SHEETS

FRAME_A3.DWG_v1.2