


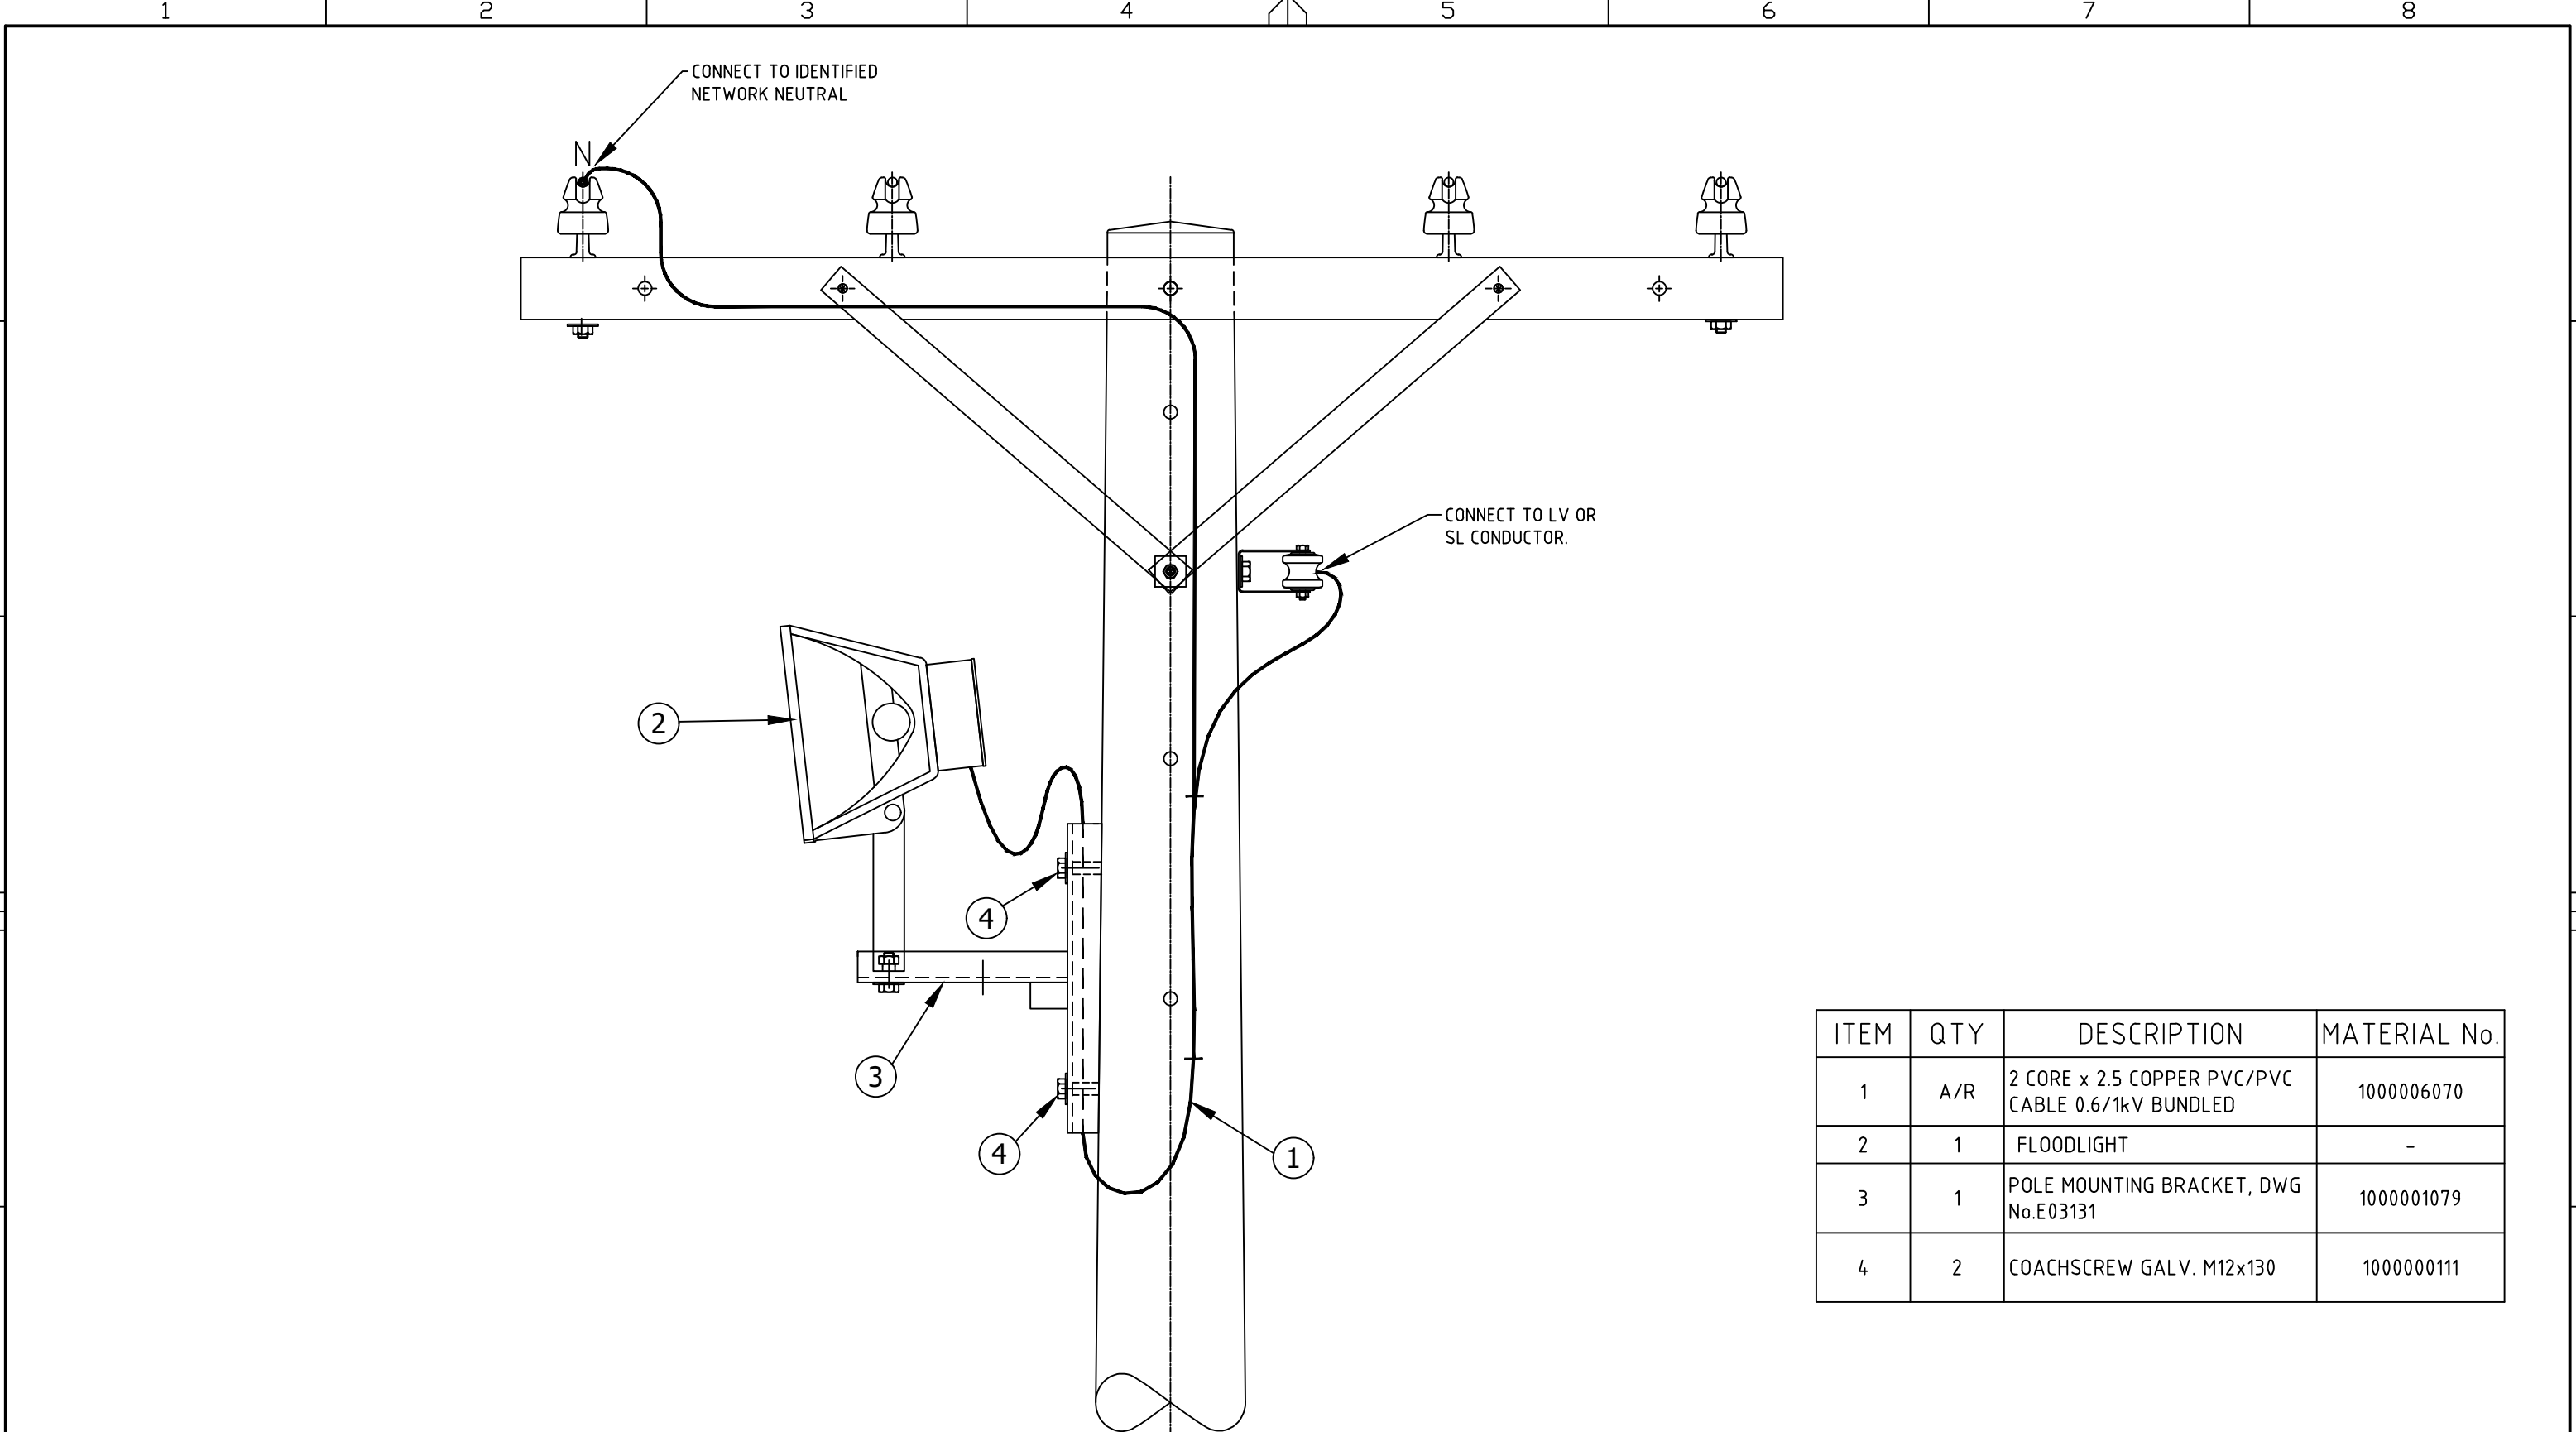

ITEM	QTY	DESCRIPTION	MATERIAL No.
1	A/R	2 CORE x 2.5 COPPER PVC/PVC CABLE 0.6/1kV BUNDLED	1000006070
2	1	FLOODLIGHT	-
3	1	POLE MOUNTING BRACKET, DWG No.E03131	1000001079
4	2	COACHSCREW GALV. M12x130	1000000111

AMENDMENTS

JOB No	NA
DESIGN	Adrian G.
DR'N	KT
CH'D	Geof C.
DATE	29/01/26
APP'D	ISP.
E	

HISTORY

REVISION A	ORIGINAL ISSUE
REVISION B	REDRAWN.
REVISION C	TITLE MODIFIED.
REVISION D	CHANGED CABLE SIZE TO 2.5mm.
REVISION E	NOTE DELETED. FLOODLIGHT WAS FL42.
REVISION F	DRAWING AMENDMENT TO REFLECT CONSTRUCTION METHOD & STOCK.




© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.



ORIGINAL SCALE
NTS

APPROVED
S.Turki

DESIGNED	B.Harrigan	DATE	12.12.96
DRAWN	Frank H.		
CHECKED	B.Harrigan		



Endeavour
Energy

FLOODLIGHT MOUNTED ON WOOD POLE

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

AUTHORISED/CERTIFIED
W.Isley

SUBSTATION DESIGN MANAGER

17.04.2009

A3

E03135

SHEET No 1 OF 1 SHEETS

FRAME_A3.DWG_v1.2

1

2

3

4

5

6

7

8