AMENDMENTS	
A	ORIGINAL ISSUE
J R No.	930208
B	DR'N C.R.T. / CH'D C.R.T. / DATE 08-2-96 / JR No 930208
BCC WAS BBCC.	
SEO	C.H.B.
C	DR'N C.R.T. / CH'D C.R.T. / DATE 11-3-97 / JR No 960080
'INSULATED' ADDED TO STREET LIGHT CONSTRUCTION.	
MPDO	CHB
D	DR'N KT / CH'D B.C / DATE 14.01.10 / JOB No
DA	Bruce Coxon
PLASTIC EARTH BATTEN WAS HARD WOOD, VOCAB No. & NOTE 1 REVISED.	
E	DR'N J.P. / CH'D M.A.S. / DATE 14-02-14 / JR No
DIMENSION "1200mm" ADDED TO LOCATE BCC AMPLIFER	
MPDO	CHB
F	DR'N SM / CH'D BH / DATE 25-01-18 / JR No
BCC RENAMED. NOTE 1 REMOVED. ADDED GND CLEARANCE	
MAM	B. Hellyer

NOTES

1. COMMUNICATION CABLE TO BE MOUNTED ON ROAD SIDE OF POLE EXCEPT BY SPECIFIC AGREEMENT, SUCH AS AT A POLE SUBSTATION.

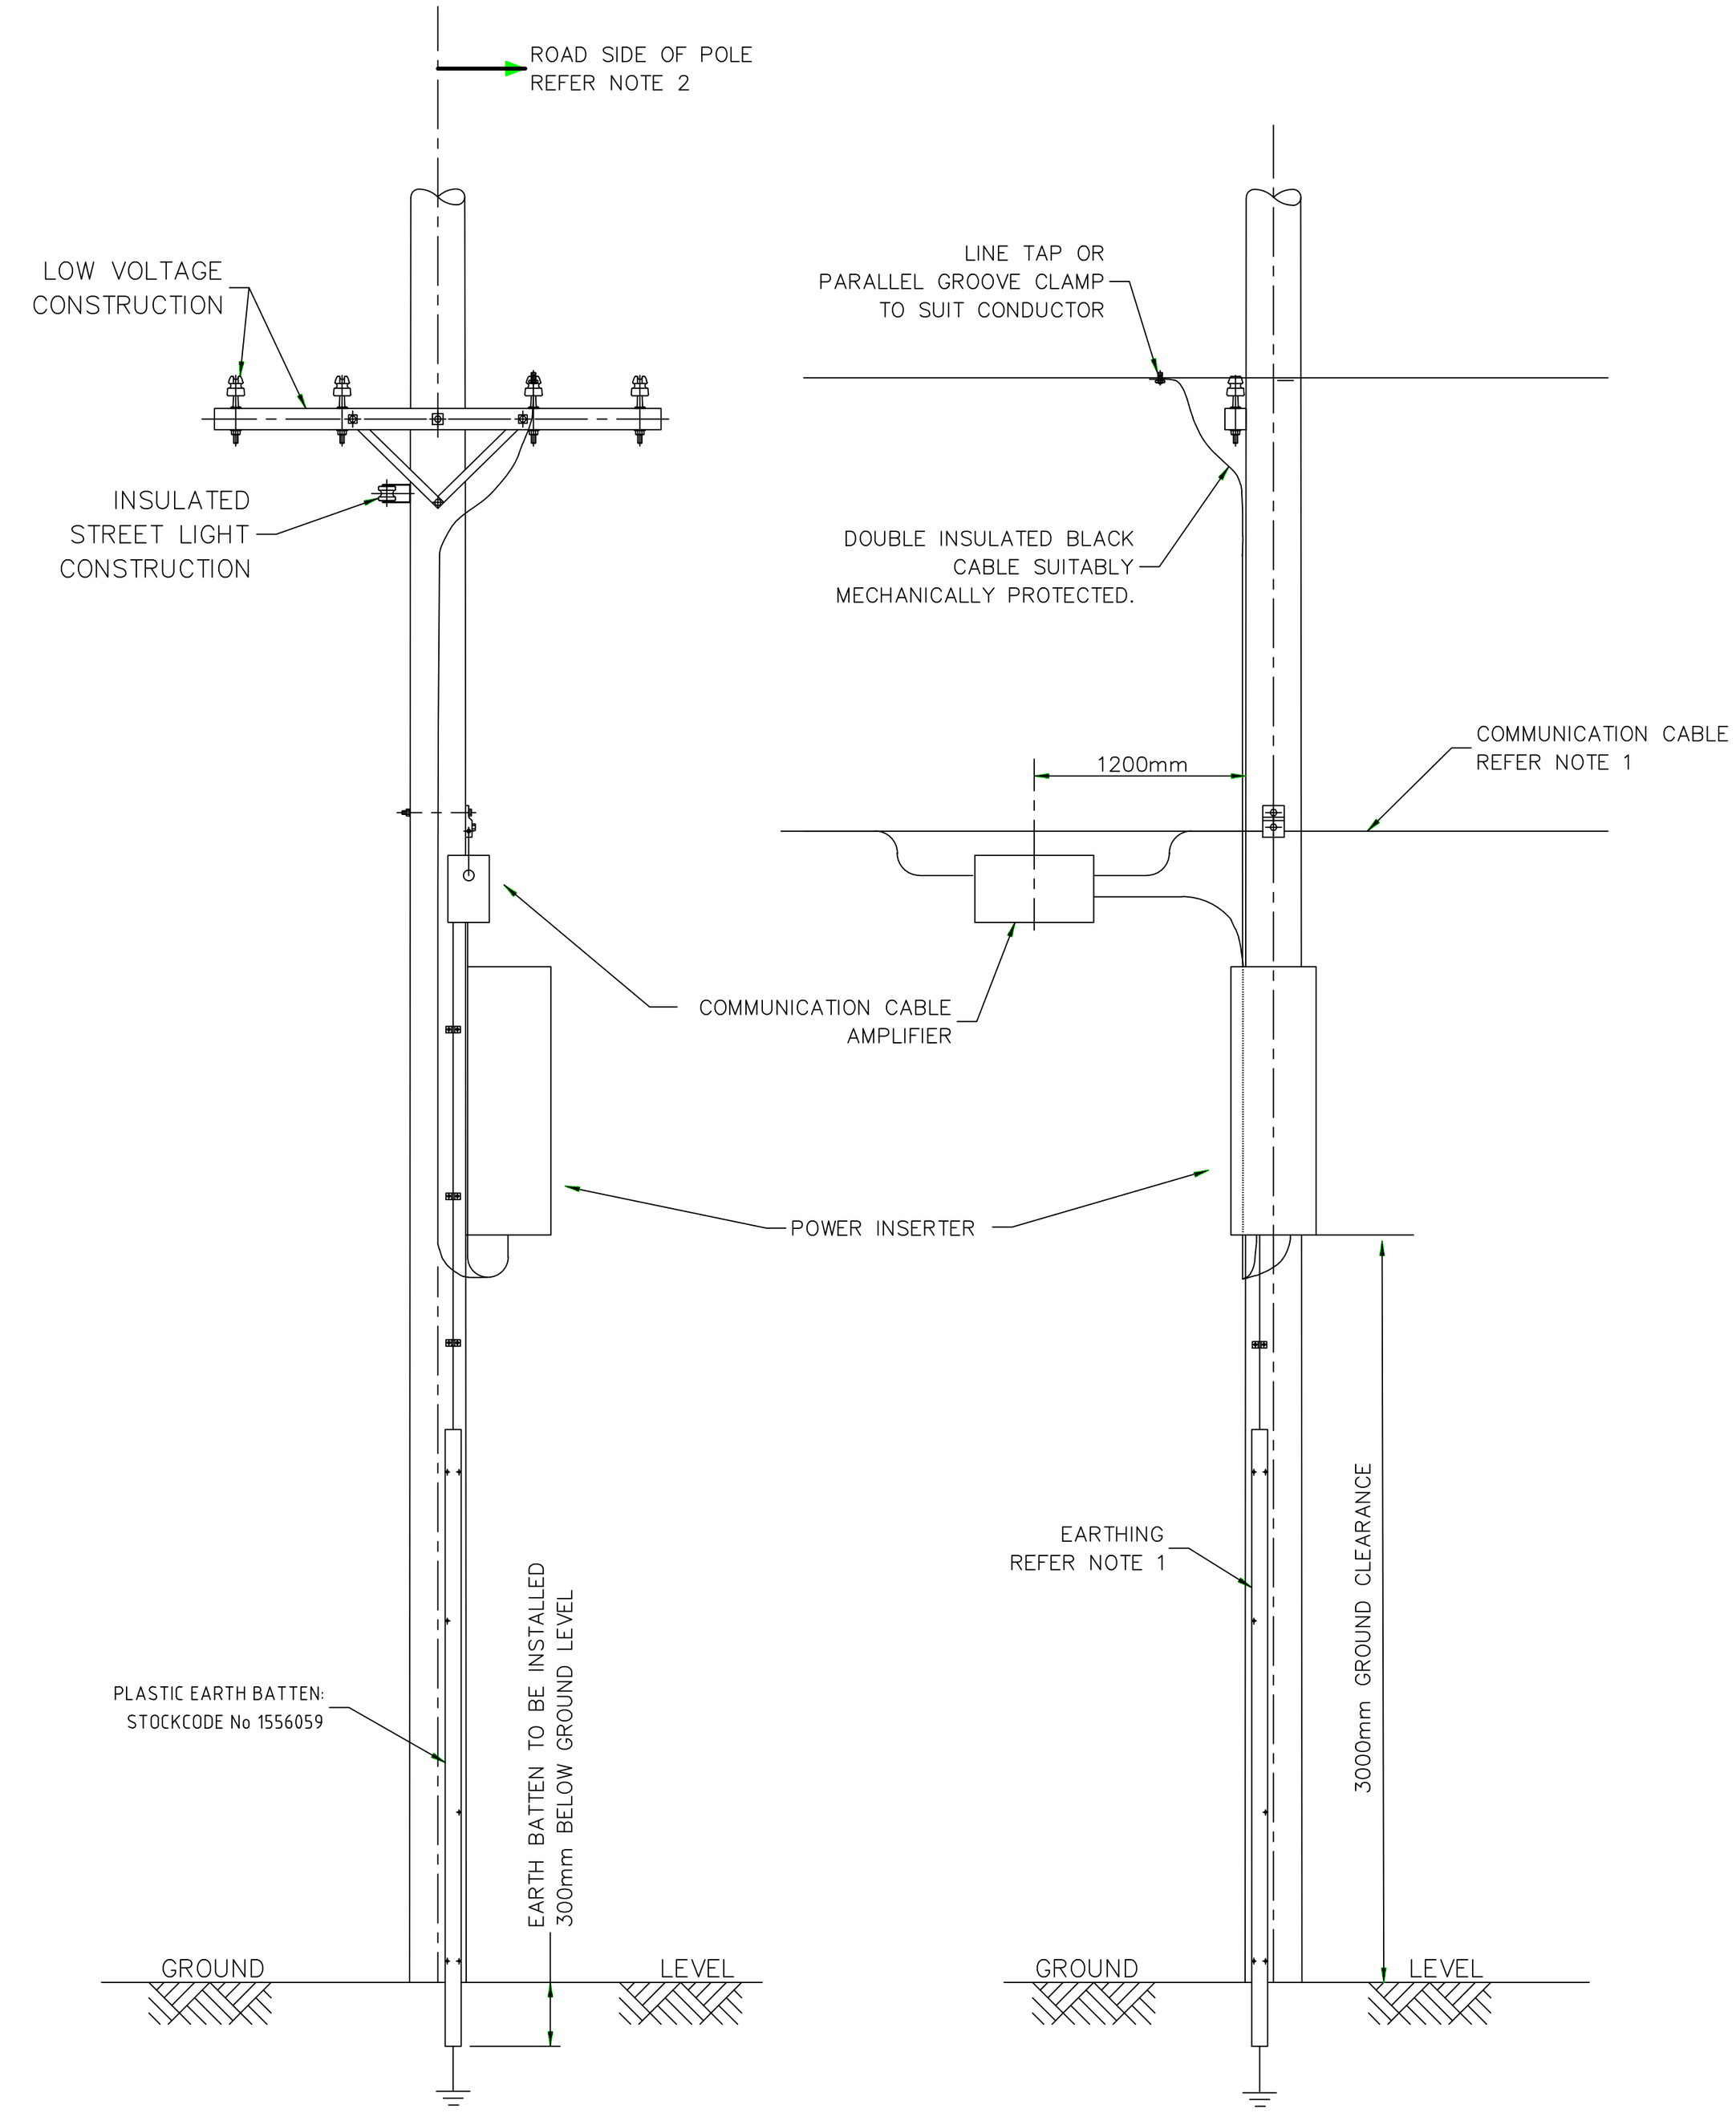

©This drawing and the copyright therin is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

Endeavour Energy

ORIGINAL SCALE	1:23
APPROVED	C.BROWN
DRAWN	C.R.T.
DATE	21-2-95
CH'D	C.R.T.

COMMUNICATION CABLE INSTALLATION (ABC MAINS)	078521
COMMUNICATION CABLE INSTALLATION (BARE MAINS)	078518
REFERENCE DRAWINGS	
DO NOT SCALE DIMENSIONS IN MILLIMETRES	AUTHORISED W.Isley
	MAINS DEVELOPMENT MANAGER 13-02-96

OVERHEAD CONSTRUCTION COMMUNICATION CABLE POWER INSERTER INSTALLATION DETAIL

A4 | 078522 | F

SHEET No 1 OF 1 SHEETS