
| AMENDMENTS | | |
|---|---|---|
| A | ORIGINAL ISSUE | |
| J R No. | 930208 | |
| B | DR'N | C.R.T. |
| | CH'D | C.R.T. |
| | DATE | 08–2–96 |
| | JR No | 930208 |
| BCC WAS BBCC. | | |
| SEO | C.H.B. | |
| C | DR'N | J.P. |
| | CH'D | M.A.S. |
| | DATE | 17–02–14 |
| | JR No | |
| CONNECTOR WAS SICAME | | |
| DSM | M.A.S. | |
| D | DR'N | SM |
| | CH'D | BH |
| | DATE | 25–01–18 |
| | JR No | |
| BCC CHANGED TO COMM CABLES | | |
| MAM | B.Hellyer | |

## NOTES

1. LOCATION OF NEUTRAL CONDUCTOR MUST BE PROVEN BEFORE CONNECTION IS MADE. THIS DRG IS INDICATIVE ONLY OF NEUTRAL LOCATION.

| ITM NO | DESCRIPTION | QTY | REFER |
|---|---|---|---|
| 1 | CABLE 16mm² COPPER BLACK SINGLE INSUL | A/R | – |
| 2 | CONDUIT FLEXIBLE 20mm | A/R | – |
| 3 | SADDLE CONDUIT GALV 25 | A/R | – |
| 4 | CLOUT GALV 2.6 X 25 LG | A/R | – |
| 5 | CONNECTOR – INSULATION PIERCING | A/R | – |

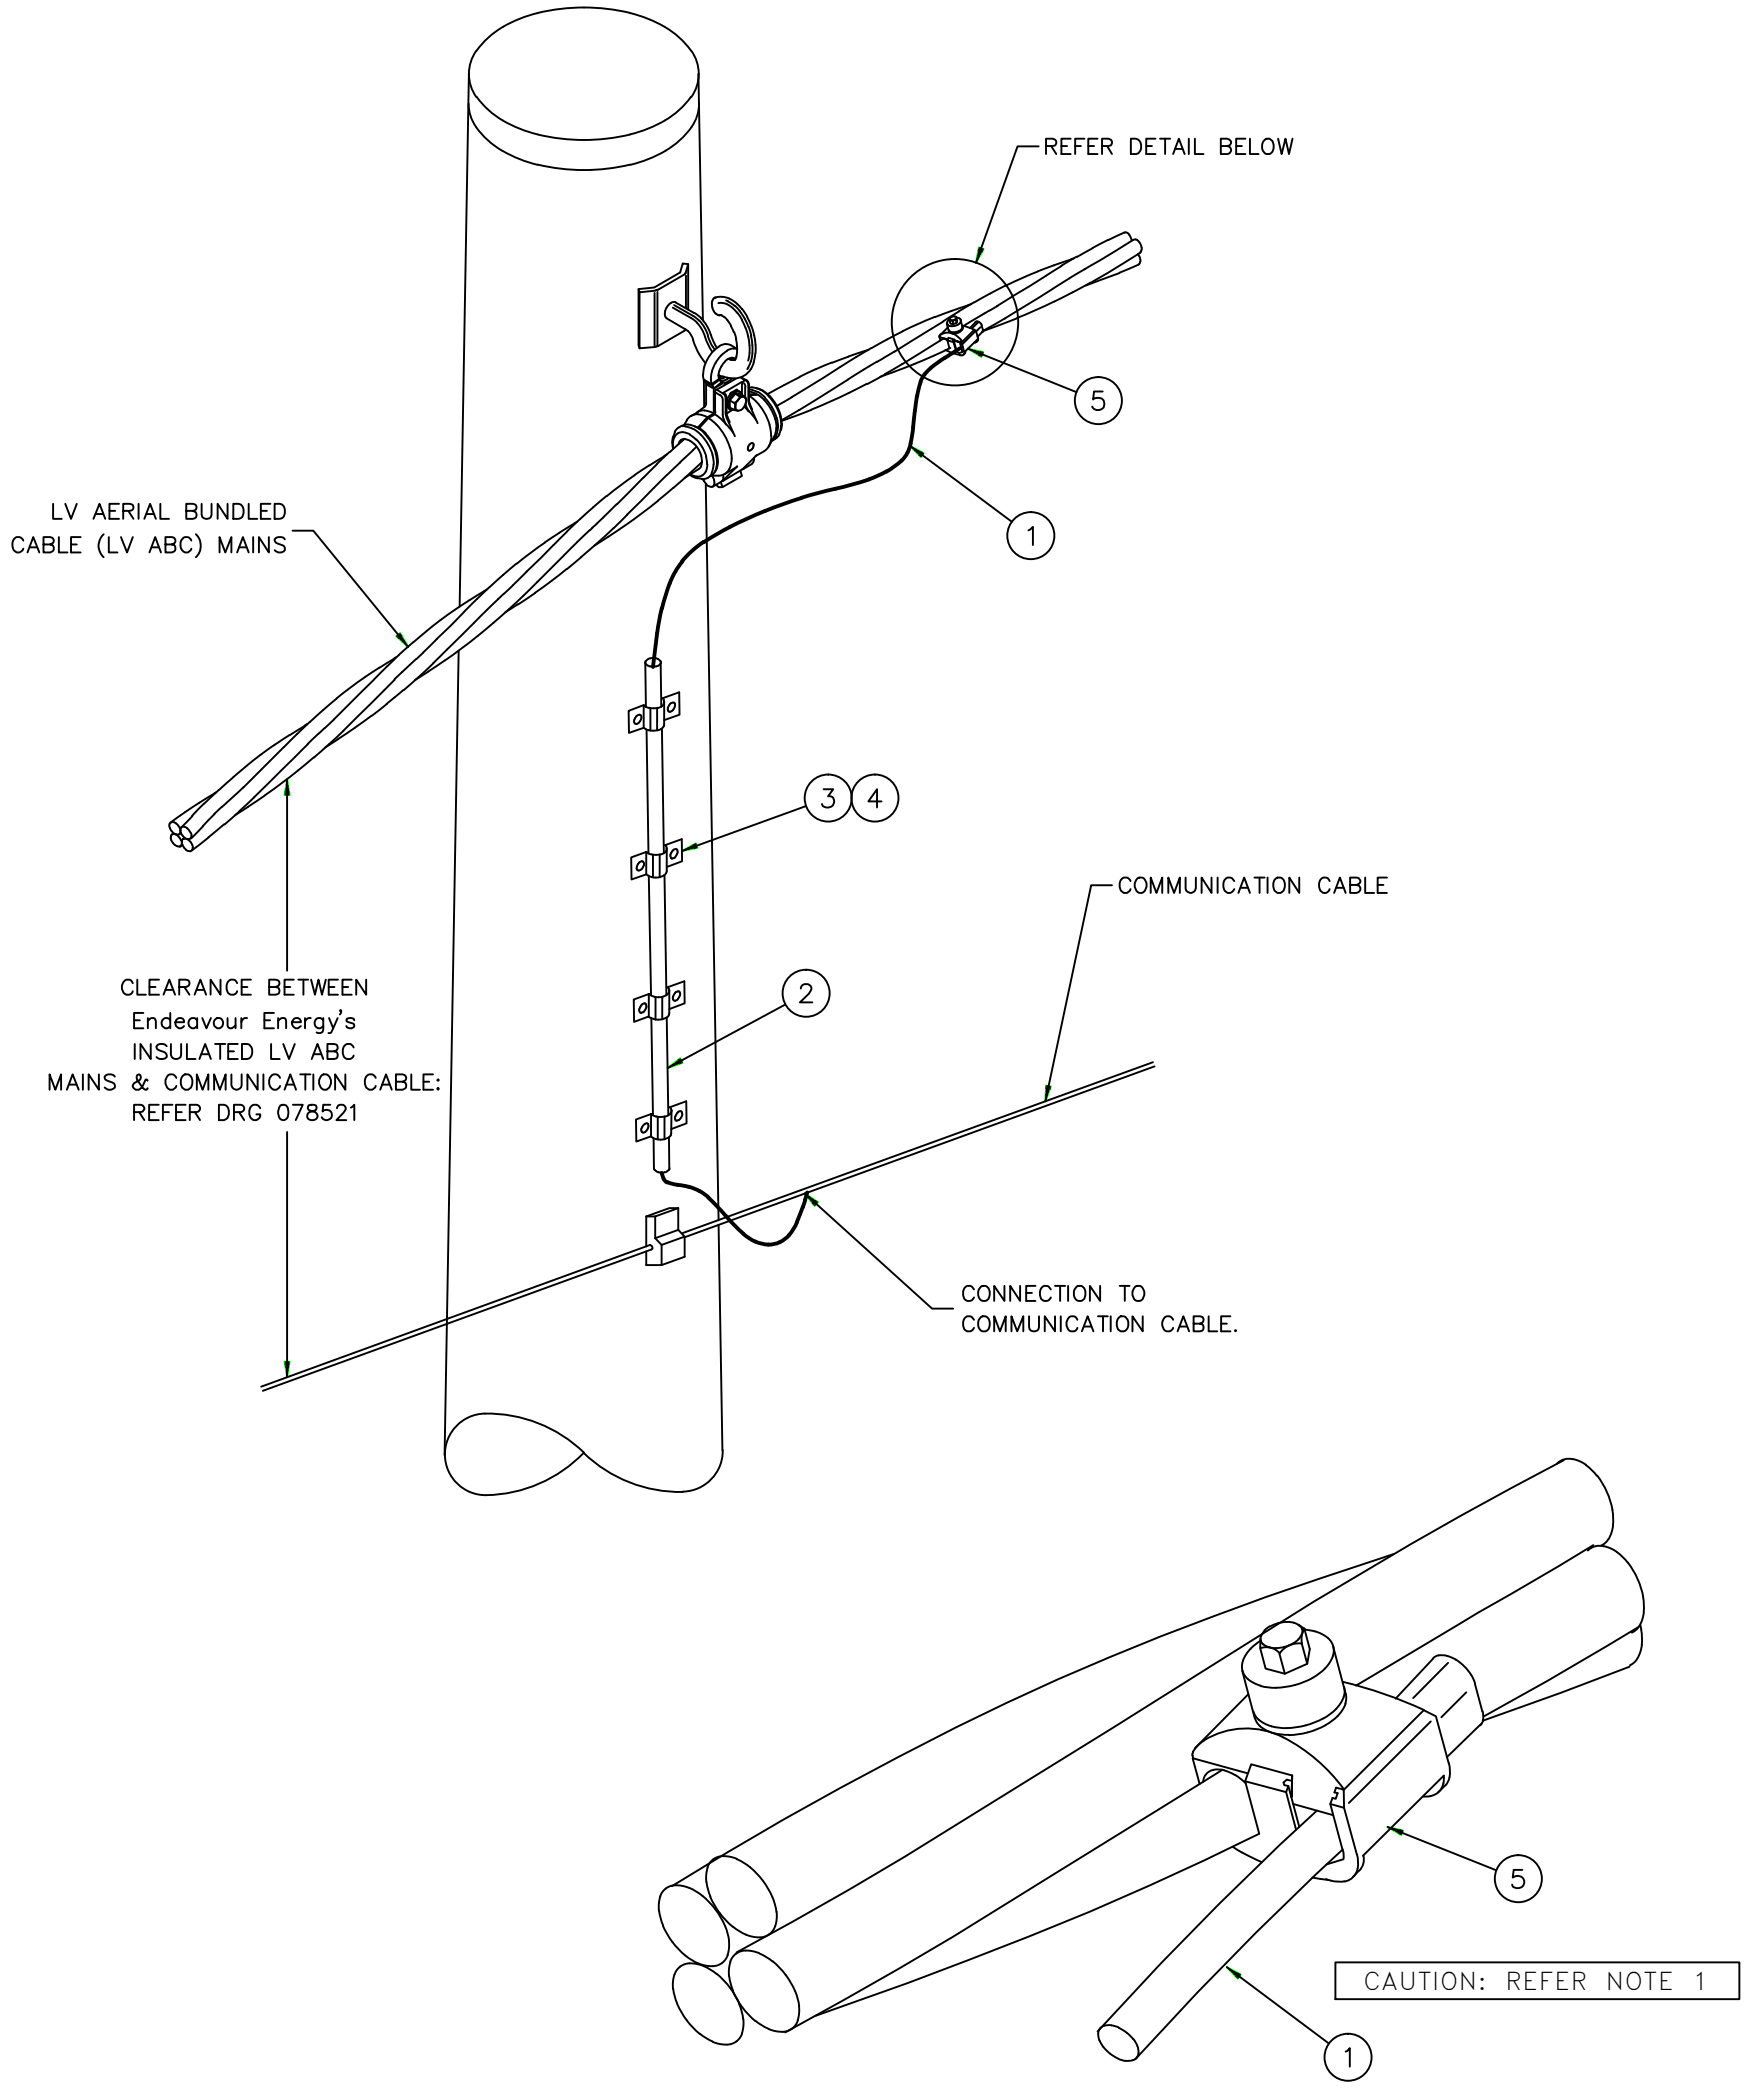


DETAIL OF CONNECTION TO NEUTRAL OF LV ABC MAINS

©This drawing and the copyright therin is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

| | | | |
|---|---|---|---|
| ORIGINAL SCALE NONE | | APPROVED C.BROWN | |
| DRAWN | C.R.T. | | |
| DATE | 05–5–95 | | |
| CH'D | C.R.T. | | |

Endeavour Energy

REFERENCE DRAWINGS

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

AUTHORISED W.Isley

MAINS DEVELOPMENT MANAGER 13–02–96

OVERHEAD CONSTRUCTION
COMMUNICATION CABLE
NEUTRAL CONNECTION TO ABC LV

A4 | 078617 | D

SHEET No 1 OF 1 SHEETS