AMENDMENTS	
A	ORIGINAL ISSUE
J R No.	NA
C — DR'N	C.R.T.
C — CH'D	C.R.T.
C — DATE	13–12–94
C — JR No	930208
STAY G1 ADDED.	
SEO	C.H.B.
D — DR'N	C.R.T.
D — CH'D	C.R.T.
D — DATE	01–8–95
D — JR No	950099
DRG SIZE WAS OH.	
SEO	C.H.B.
E — DR'N	C.R.T.
E — CH'D	C.R.T.
E — DATE	03–1–97
E — JR No	960080
SHEET WAS A2.	
MPDO	CHB

NOTES

1. USE STAY ANGLE OF 45 WHENEVER POSSIBLE.
2. DESAP NATURAL ROUND POLES AT STAY ATTACHMENT POINT. STAY WIRE TO BE WRAPPED ONE & ONE HALF TIMES AROUND POLE, RESTING OVER COACHSCREW.
3. STAY INSULATOR (ITEM 3) TO BE FITTED AT A MINIMUM OF 3000mm VERTICALLY ABOVE GROUND LEVEL & NORMALLY 2000mm TO 3000mm FROM POLE (MEASURED ALONG STAY WIRE).

ITEM	PART	DRG	DESCRIPTION	QTY	REMARK
1	SW10639	–	WIRE STAY 6 X 7 (6/1) WRC 12 DIA	A/R	–
2	SR10527	241003	ROD STAY GALV 20SR2300	1	–
3	SY10271	–	INSULATOR STAY GY3	1	NOTE 3
4	SS15330	–	STAYGUARD PVC	1	–
5	SC10430	–	CLAMP SPLIT BOLT BRASS B26	1	–
6	SC11186	241511	COACHSCREW STEEL GALV HEX HD 12 X 80 LG	1	–
7	SS10452	–	SPLICE STEEL PRESET GFS 120	1	–
8	SD10184	–	DEADEND STEEL PRESET GFG 120	3	–
9	–	011990	ANCHORAGE TO SUIT	1	–

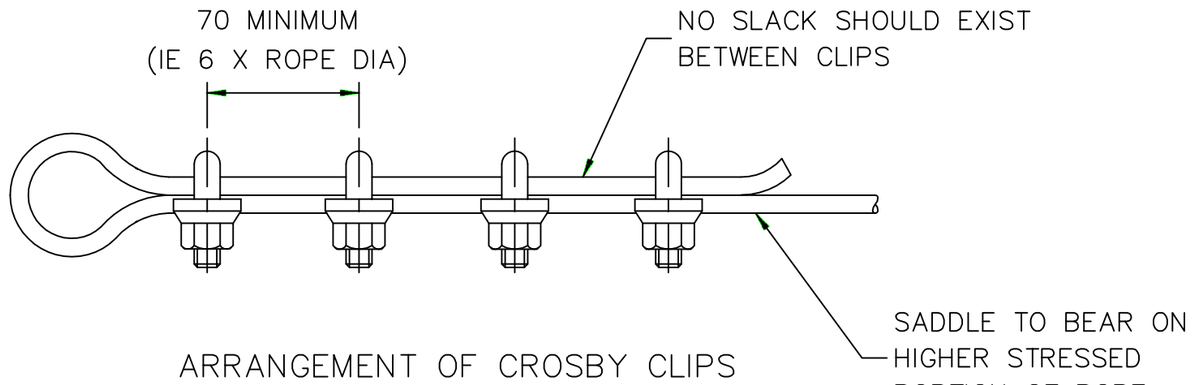

ARRANGEMENT OF CROSBY CLIPS
WHEN FITTED TO EXISTING STAY
(NOTE: QUANTITY 4 OFF MINIMUM
FOR THIS APPLICATION)

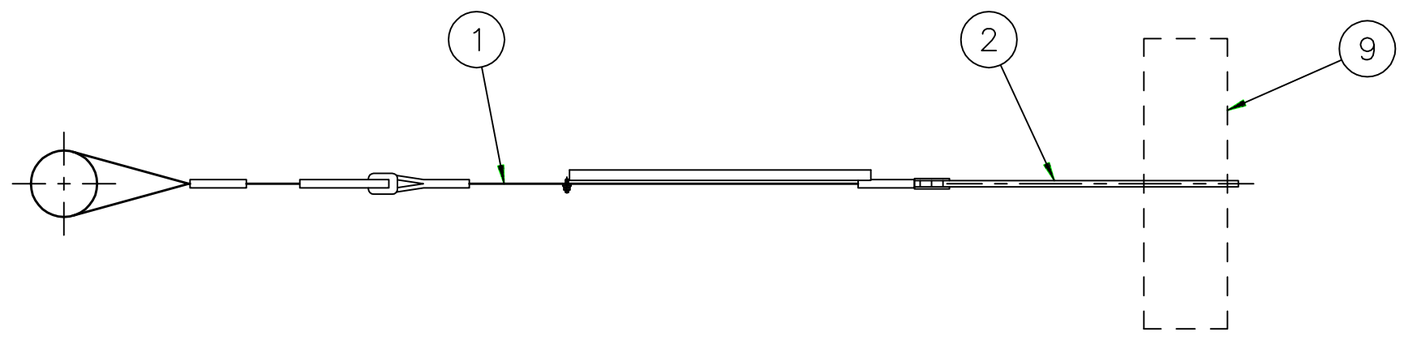

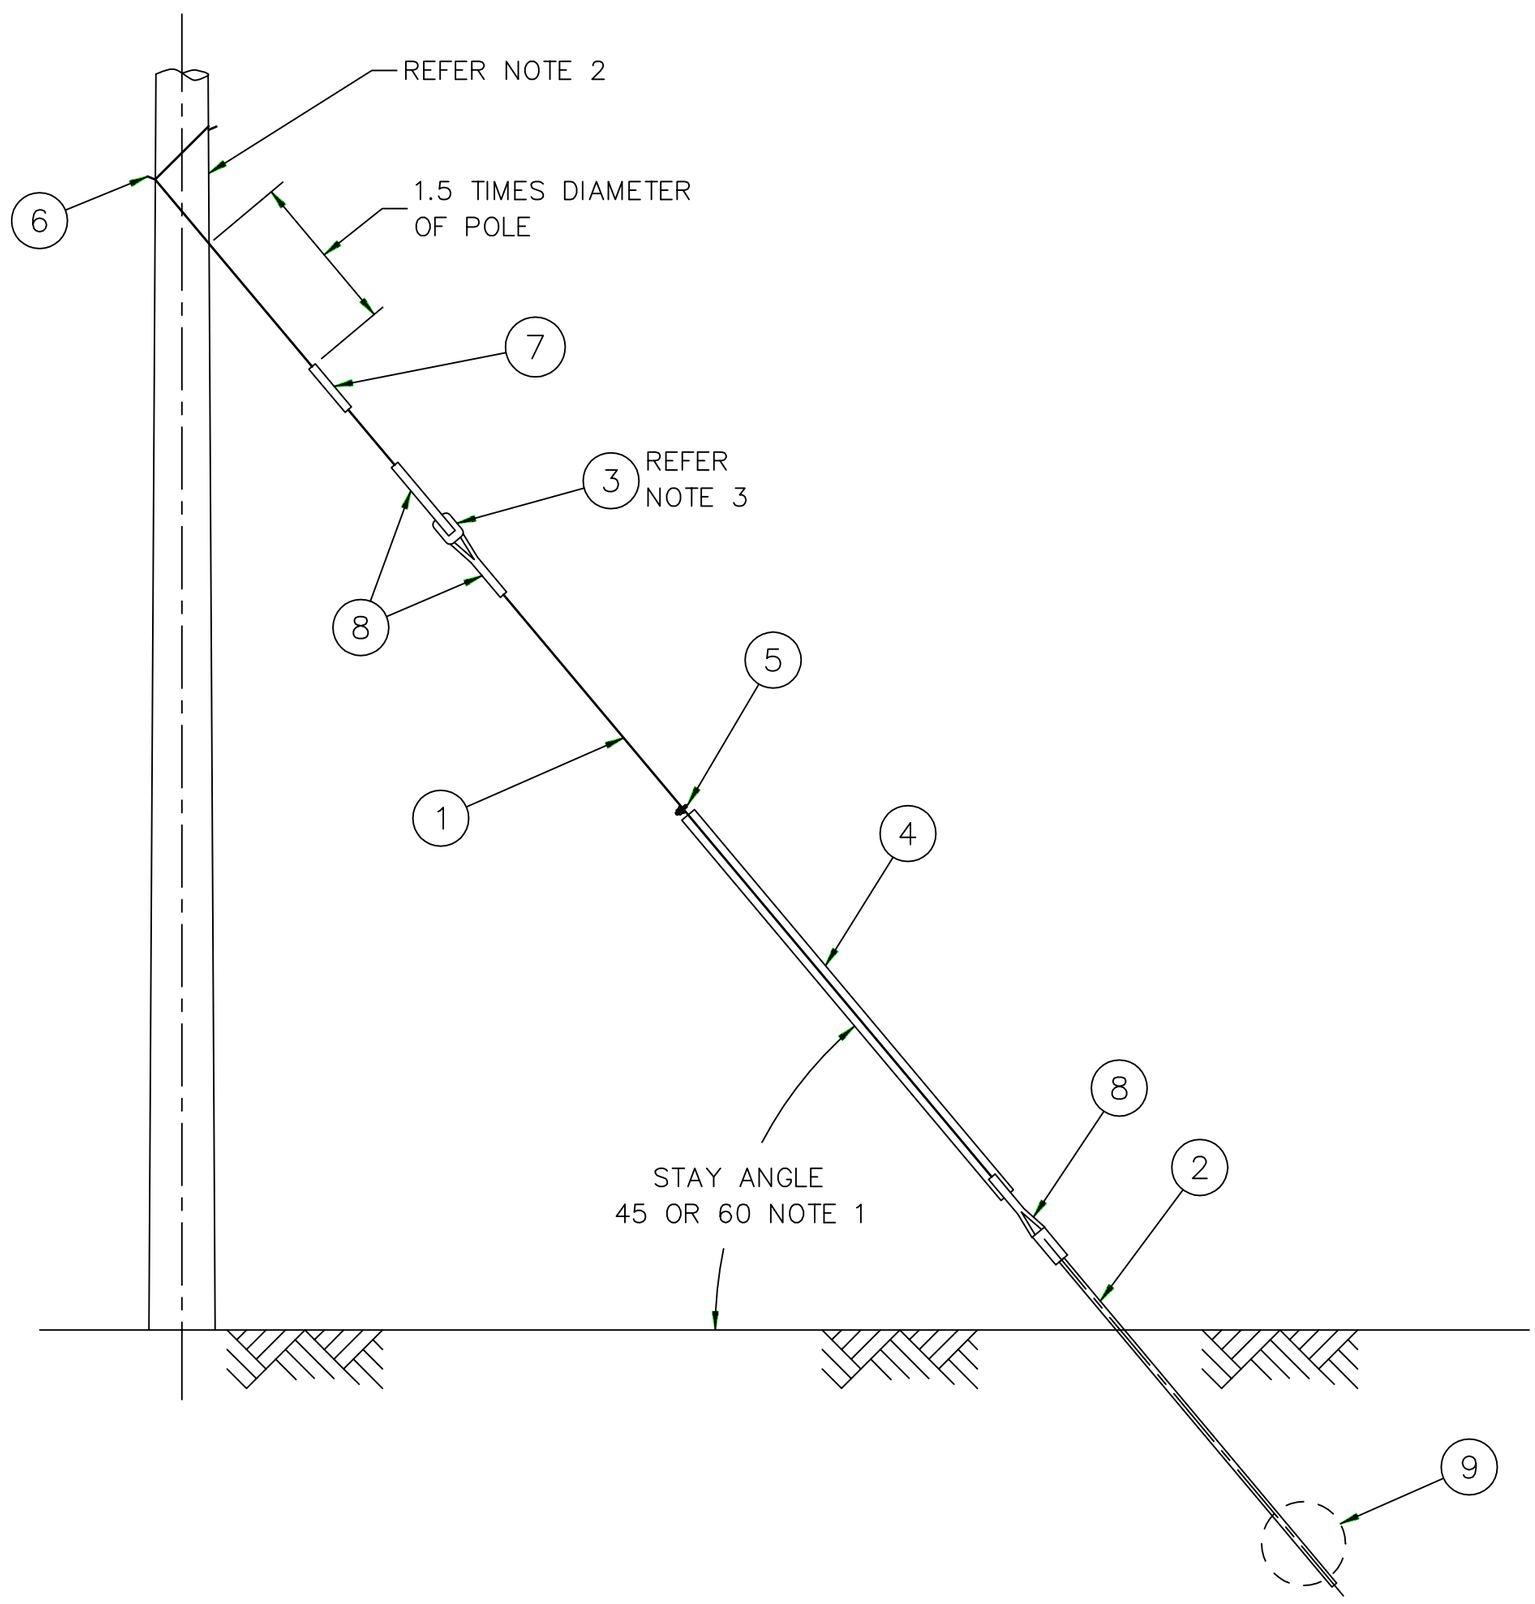

© This drawing and the copyright therin is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

ORIGINAL SCALE	NONE
APPROVED	C.BROWN
DRAWN	C.R.T.
DATE	13–12–94
CH'D	C.R.T.

Endeavour Energy

AERIAL & GROUND STAY DESIGN DET — 011976

REFERENCE DRAWINGS

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

AUTHORISED
W.Isley
ASSIST. G.M. ENG. 13–12–94

OVERHEAD CONSTRUCTION
GROUND STAY TYPE G1
DETAIL

A2P | 011987 | E

SHEET No 1 OF 1 SHEETS