



1. THE FOLLOWING LOADS ARE MINIMUM BREAKING LOAD:
- Fx: 30kN

Fy: 12.5kN
2. HOOKS ARE TO BE CIRCULAR OF MINIMUM RADIUS AS SHOWN. HOOK CENTRES ARE TO BE COAXIAL WITH THE BOLT OR POINT OF SUPPORT.
- A PIGTAIL TWIST IS TO BE PROVIDED.
3. MATERIAL: STRUCTURAL STEEL STRENGTH GRADE 250 TO AS/NZS 3629.1.
4. FINISH: HOT DIP GALVANISE AFTER FABRICATION.
5. TOLERANCE: $\leq 300\text{mm}$ – $\pm 1.0\text{mm}$
 $> 300\text{mm}$ AND $\leq 3000\text{mm}$ – $\pm 2.0\text{mm}$
6. THREAD TO CONFORM TO AS/NZS 1214 – HOT DIP GALVANISED COATINGS ON THREADED FASTENERS.
- HOOK BOLT TO CONFORM TO AS3766 – MECHANICAL FITTINGS FOR LOW VOLTAGE ABC.

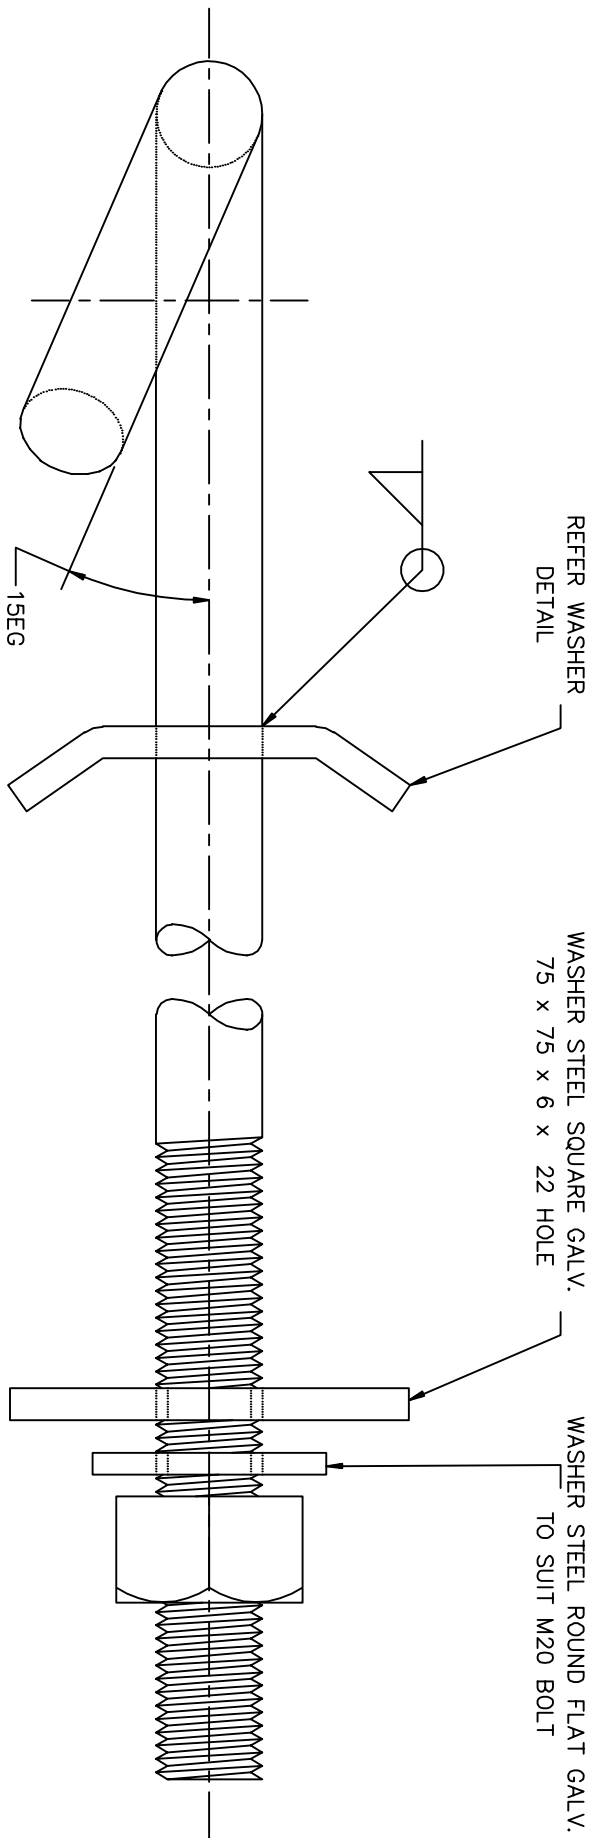


ITEM A: 250
ITEM B: 350
ITEM C: 450

M20 x 2.5 THREAD
REFER NOTE 6

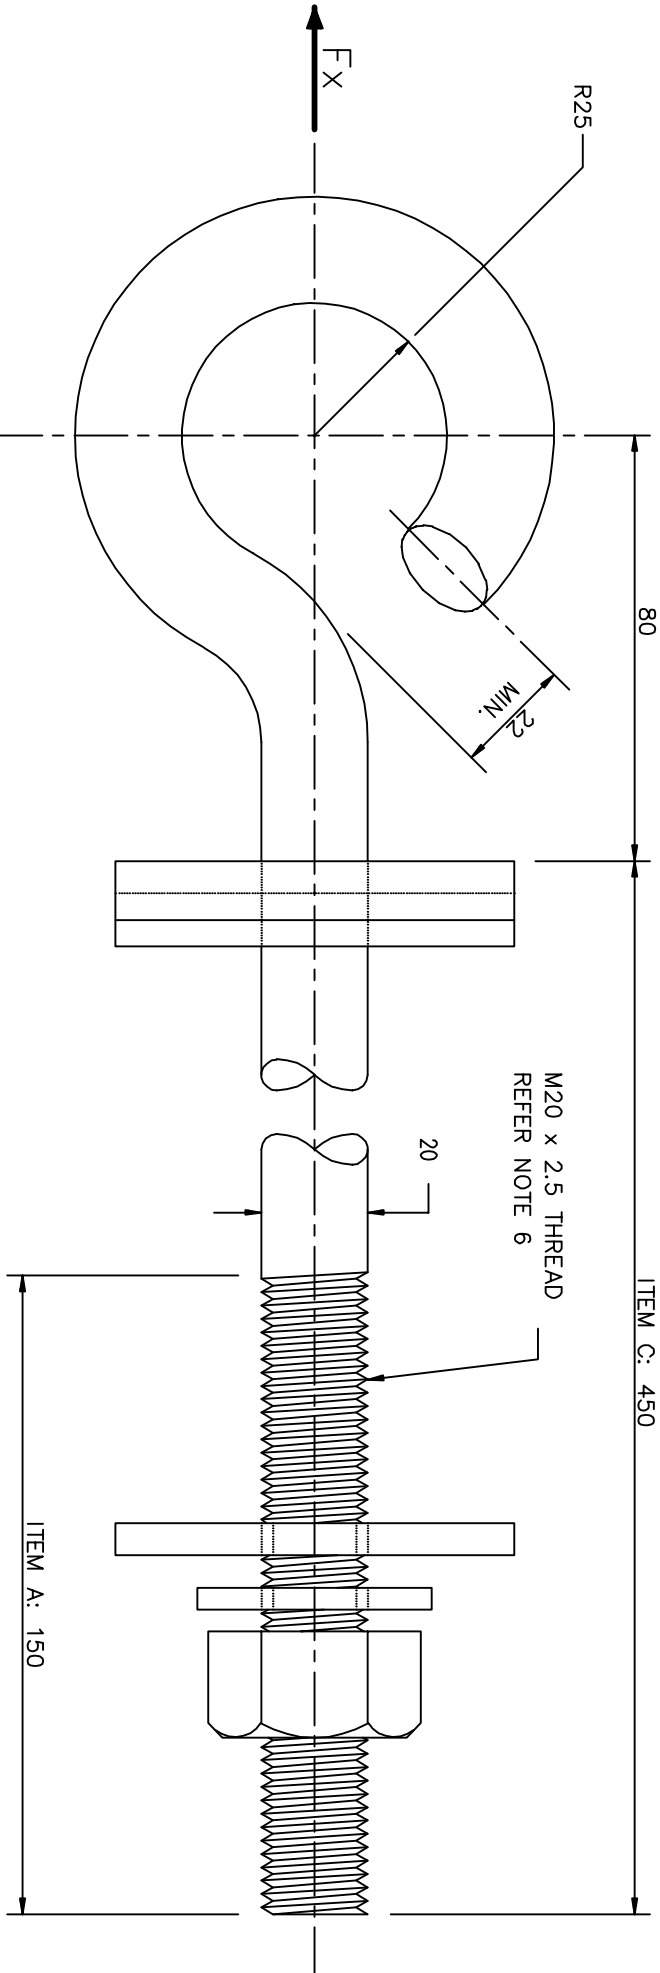

HOOK BOLT DETAIL
ITEM A: MATERIAL NO. 1000000909
ITEM B: MATERIAL NO. 1000000908
ITEM C: MATERIAL NO. 1000000910

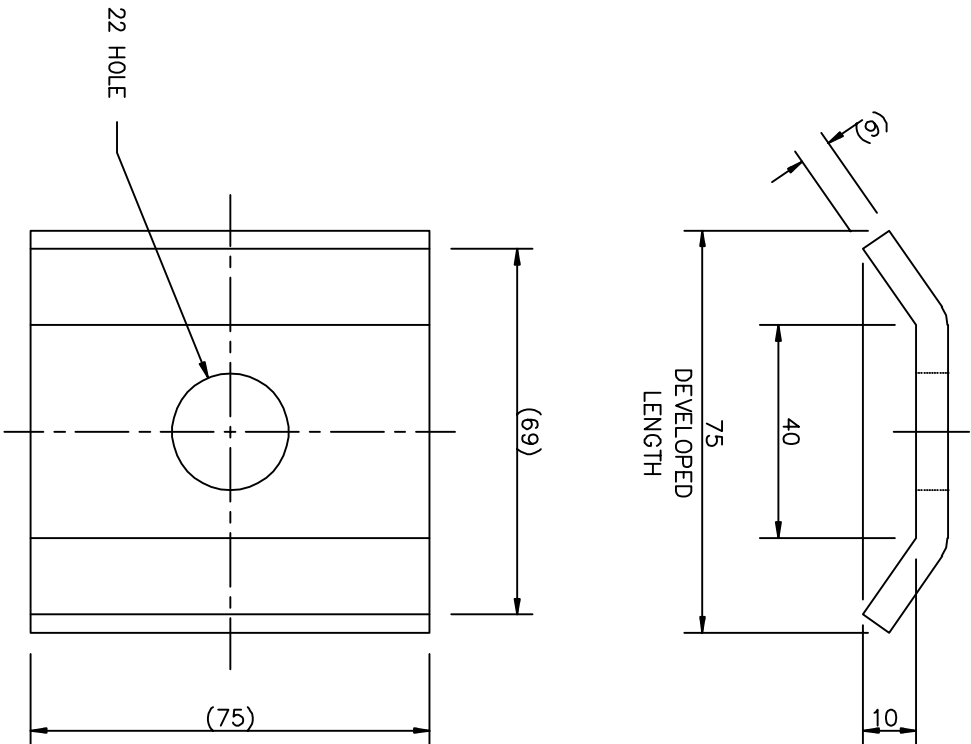

WASHER DETAIL
REFER HOOK BOLT DETAIL

AMENDMENTS			
A	ORIGINAL ISSUE		
	J R No.	NA	
B	DR'N	BQH	
	CH'D	*	
	DATE	06-11-96	
	JR No	960081	
ITEMS A & C ADDED. SQ. & RND WASHERS ADDED. HOOK NUT DELETED. ITEM B DIM 350 WAS 320, 80 WAS 70-100, 150 WAS 120, 22 WAS 12. NOTES 5 & 6 ADDED.			
C	*	*	
	DR'N	SF	
	CH'D	RD	
	DATE	21-10-24	
	JR No	N/A	
REPLACED STOCK CODE BY MATERIAL NO.			
	EDM	K5	

©This drawing and the copyright therein is the property of Endeavour Energy and may not be reproduced, stored in a retrieval system or used without the written consent of Endeavour Energy.

ORIGINAL SCALE 1:1

APPROVED



L.V. AERIAL BUNDLED CABLE
HOOK BOLT
DETAIL

DO NOT SCALE		REFERENCE DRAWINGS	
DIMENSIONS IN MILLIMETRES		AUTHORISED	
A2		059560	
SHEET 671 OF 1 SHEETS		C	