


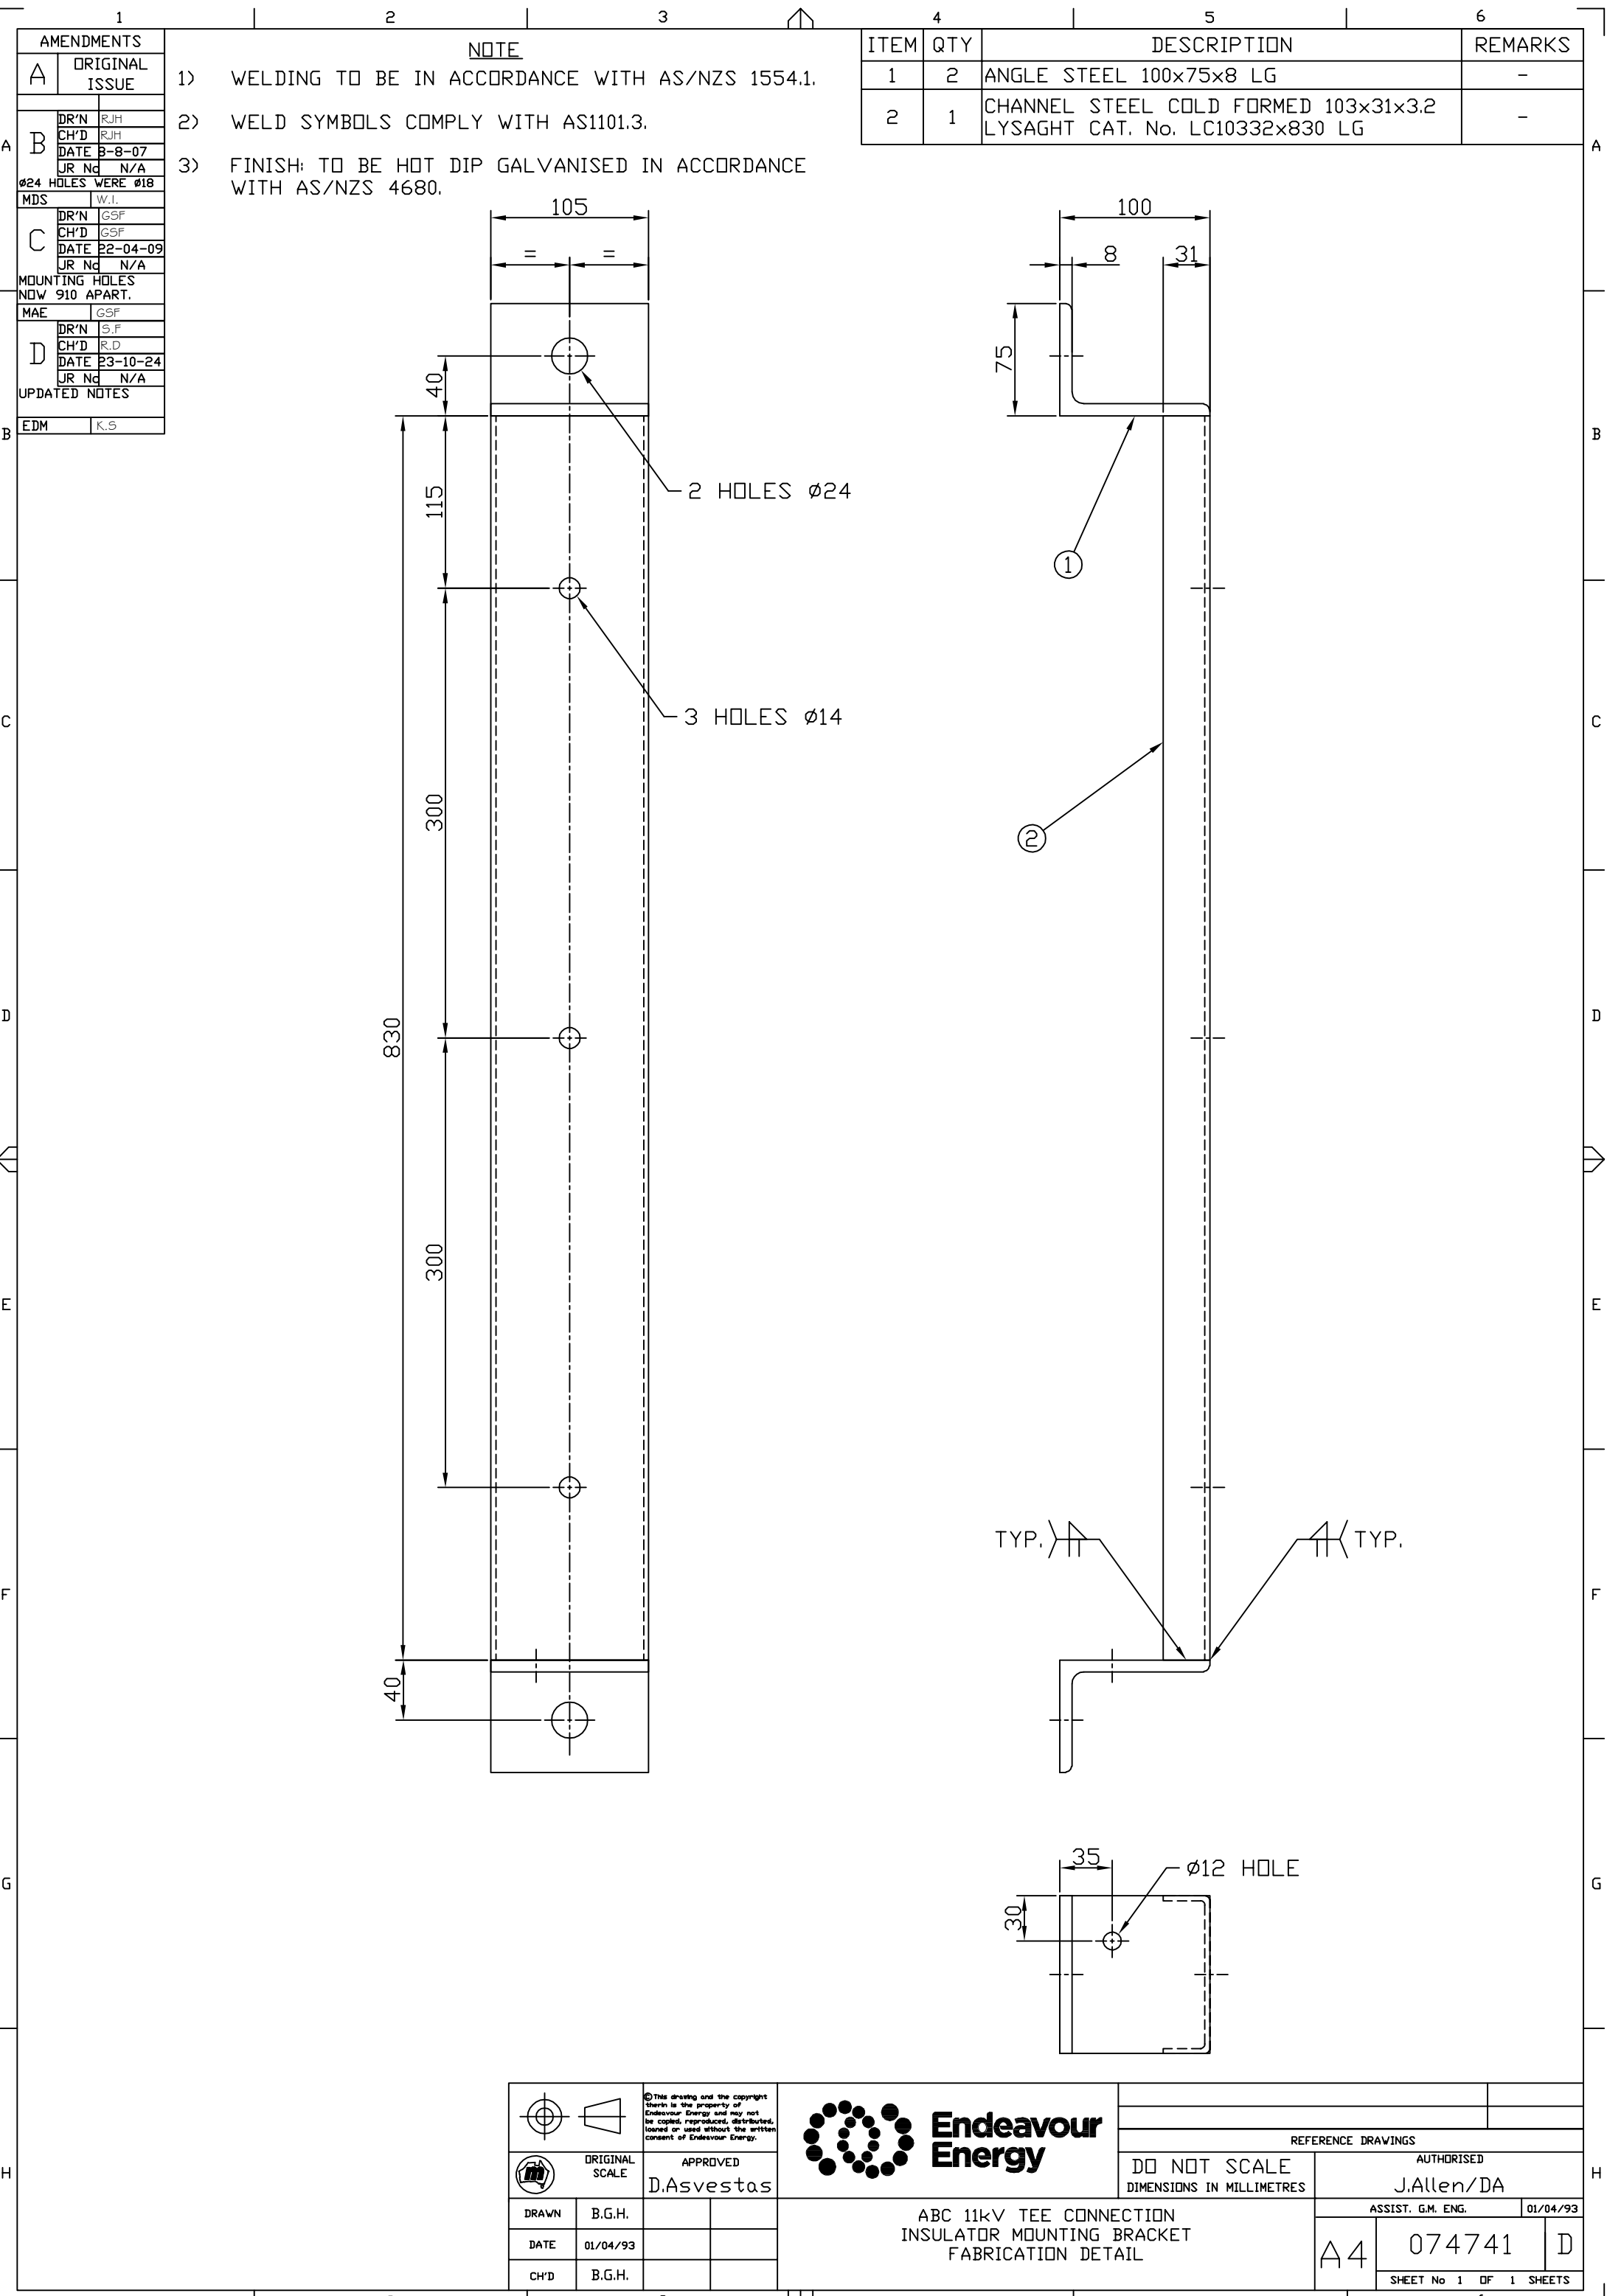


NOTE

- 1) WELDING TO BE IN ACCORDANCE WITH AS/NZS 1554.1.
- 2) WELD SYMBOLS COMPLY WITH AS1101.3.
- 3) FINISH: TO BE HOT DIP GALVANISED IN ACCORDANCE WITH AS/NZS 4680.

ITEM	QTY	DESCRIPTION	REMARKS
1	2	ANGLE STEEL 100x75x8 LG	-
2	1	CHANNEL STEEL COLD FORMED 103x31x3.2 LYSAGHT CAT. No. LC10332x830 LG	-

	ORIGINAL SCALE	APPROVED	D.Asvestas
DRAWN	B.G.H.		
DATE	01/04/93		
CH'D	B.G.H.		



Endeavour Energy

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

AUTHORISED
J.Allen/DA

ASSIST. G.M. ENG. 01/04/93

ABC 11kV TEE CONNECTION
INSULATOR MOUNTING BRACKET
FABRICATION DETAIL

A4

074741

D

SHEET No 1 OF 1 SHEETS