



AMENDMENTS	
A	ORIGINAL ISSUE
J R No.	970059
B	NOTE 2 AMENDED HEX PIN MODIFIED LONG ROD SHAFT DIA MODIFIED.
CHECKED	SD
DRAWN	DC
DATE	24-07-13
CHUNG MM	D.MATE

NOTES


1. INSULATOR MINIMUM REQUIREMENTS:
MINIMUM POWER FREQUENCY 1min WET VOLTAGE WITHSTAND: 70kV
MINIMUM IMPULSE WITHSTAND VOLTAGE: 150kV
MINIMUM TENSILE FAILING LOAD: 70kN
MINIMUM CREEPAGE DISTANCE: 500mm
MINIMUM DRY ARCHING DISTANCE: 310mm
2. INSULATOR GENERALLY IN ACCORDANCE WITH AS 4435.1.
END FITTINGS IN ACCORDANCE WITH AS1154

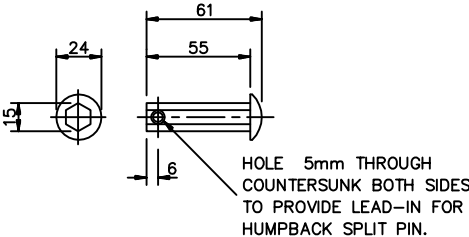

ROUND OR HEXAGONAL PIN

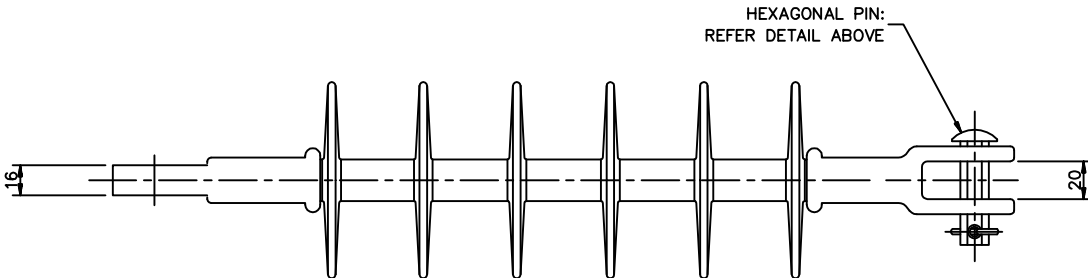

PLAN

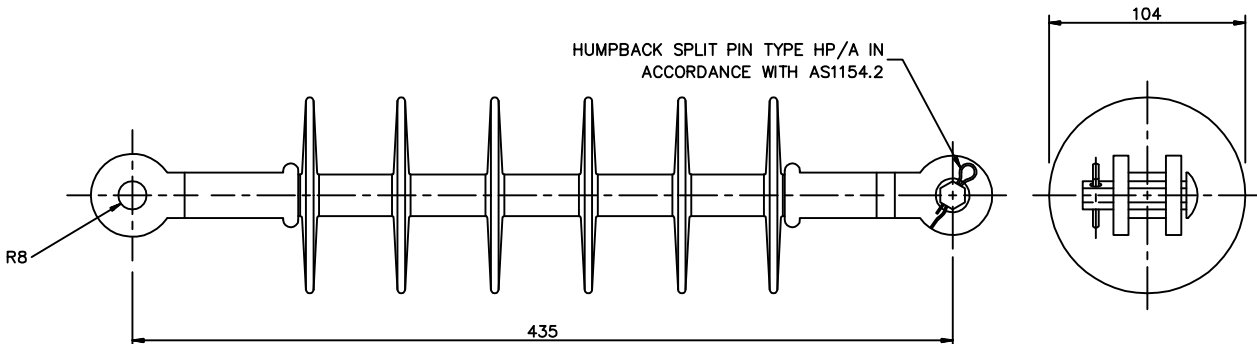

ELEVATION

PART No 1502871



© This drawing and the copy of it, therein is the property of Endeavour Energy and may not be copied, reproduced, distributed or used without the written consent of Endeavour Energy.

**Endeavour
Energy**

REFERENCE DRAWINGS			
DO NOT SCALE DIMENSIONS IN MILLIMETRES		AUTHORISED R. MOORE	
SECTION MULTIPLIER		06-04-98	
		A2P	B

OVERHEAD TRANSMISSION
22kV LONG ROD INSULATOR
DETAIL