



AMENDMENTS			
A	ORIGINAL ISSUE		
	DRN	GSF	
	CHD	GSF	
	DATE	24-06-10	
B	WASHER REMOVED FROM BA0001. BA0027 MODIFIED. NOTE 3 AMENDED.		
	MDEB	GSF	
	DRN	GSF	
	CHD	GSF	
C	NOTE 4 ADDED.		
	OH&UG MM	D.Mate	
	DRN	GSF	
	CHD	GSF	
D	REDRAWN		
	OH&UG MM	D.Mate	
	DRN	GSF	
	CHD	GSF	

- NOTES**
- 1) VOLUTE WASHERS ARE TO BE USED ON ALL HV CONNECTIONS. IF THERE IS NO GANG NAIL PLATE A FLAT WASHER IS REQUIRED ON BOTH SIDES OF THE VOLUTE WASHER. WHERE THERE IS NO WOOD IN THE JOINT A VOLUTE WASHER IS NOT REQUIRED BUT MAY STILL BE INSTALLED.
 - 2) ALL KING BOLTS THROUGH THE POLE ARE TO BE M20 MIN.
 - 3) -A = OPTION 'A' - NOTE: FOR ANGLE LOADS EYENUT REPLACES EXISTING NUT ON BOLT AND LOCKS HARD AGAINST WASHER.
-B = OPTION 'B' - LIDBURY RING.
 - 4) FOR MAINS TERM. USE BA030 FOR SERVICE TERM. BA034 CAN BE USED.

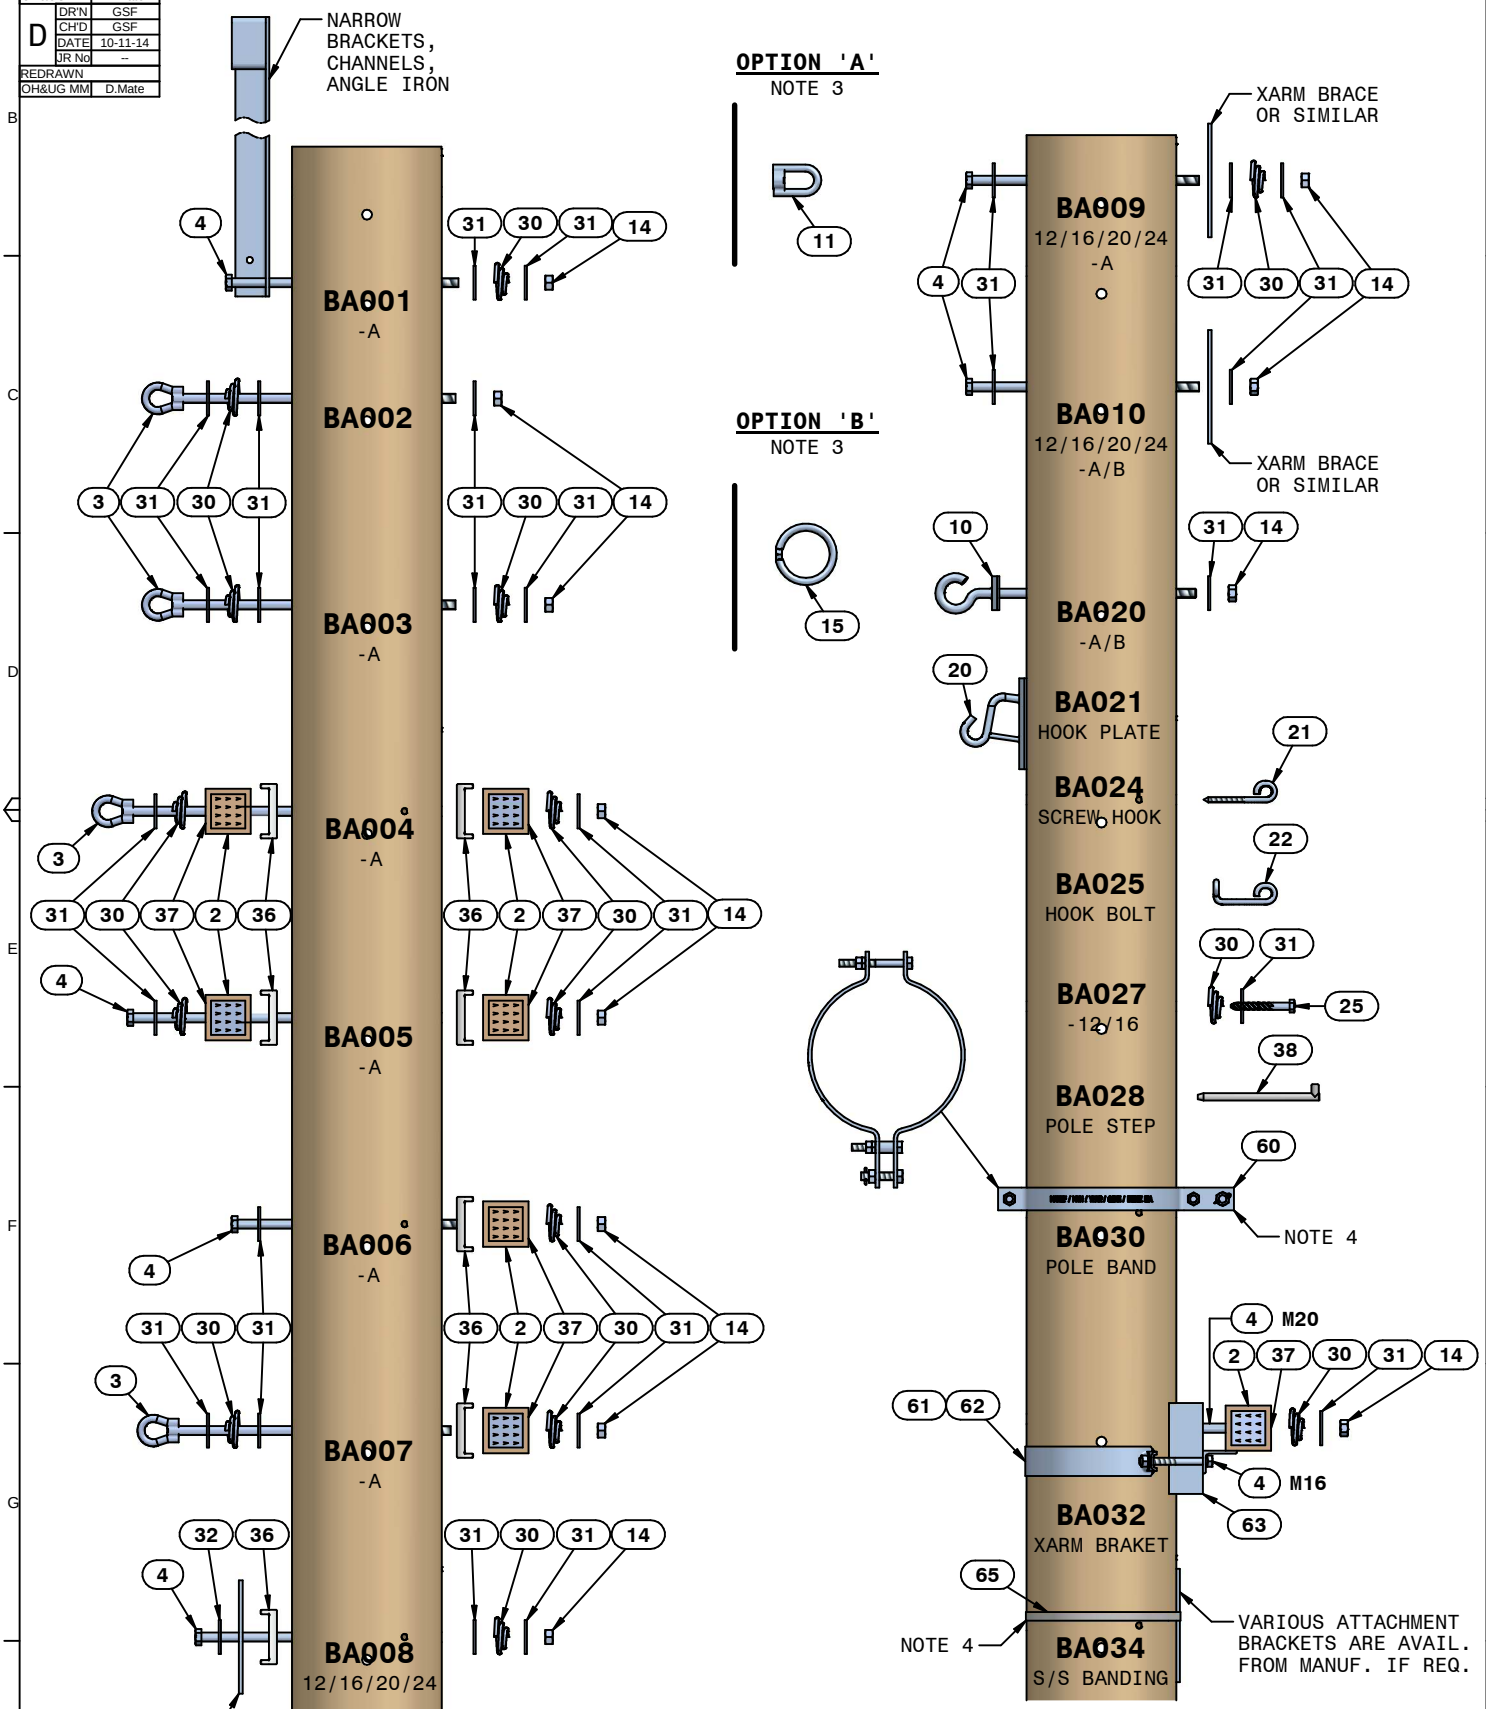

		(c) This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.									
		ORIGINAL SCALE		APPROVED G. Ford		DO NOT SCALE DIMENSIONS IN MILLIMETRES		REFERENCE DRAWINGS AUTHORISED W. Isley			
DRAWN G. Ford		DATE 22/04/09		CH'D G. Ford		REF. F003P		MANAGER ASSET ENGINEERING 22/04/09			
STANDARD ASSEMBLIES MISCELLANEOUS ITEMS BRACKETS - CONNECTORS								A4 332000 D			
								SHEET No. 1 OF 2			

