

AMENDMENTS
A ORIGINAL ISSUE

NOTE


- 1) SECOND CABLE ONLY REQUIRED IN SPECIAL CIRCUMSTANCES. IF SECOND CABLE IS INSTALLED BA020 AND MA100 QUANTITY WILL BE 2 OFF.
- 2) NON BREAK AWAY FITTING TO BE USED ON ROAD CROSSING AND BREAK AWAY FITTING (OPTION -B) TO BE USED IN OTHER AREAS.

ITEM	QTY	DESCRIPTION	REMARKS
BA020	1	HOOKBOLT 20MM (POLE)	NOTE 1
MA100(-B)	1	CLAMP SUSP. LV NON BREAK/BREAK	NOTE 1 & 2

LIMITS OF CONSTRUCTION


MAX. ANGLE OF LINE DEVIATION	MAXIMUM CONDUCTOR SIZE - STRINGING TABLE - SPAN LENGTH	
10°	-----	4x150 -LV20 -100
15°	4x95 -LV9 -100	-----
25°	4x95 -LV8 -60	4x150 -LV19 -60

MAXIMUM ANGLE OF LINE DEVIATION REFER TABLE

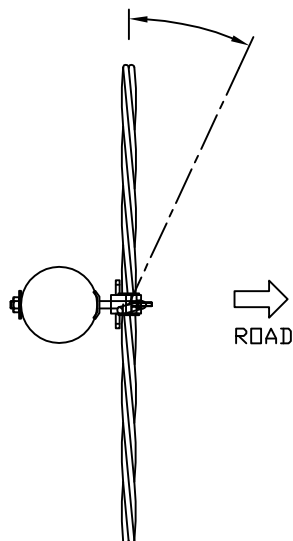

150
200



BA020



MA100(-B)

-B=BREAK AWAY

LOCATION OF SECOND CABLE IF REQUIRED

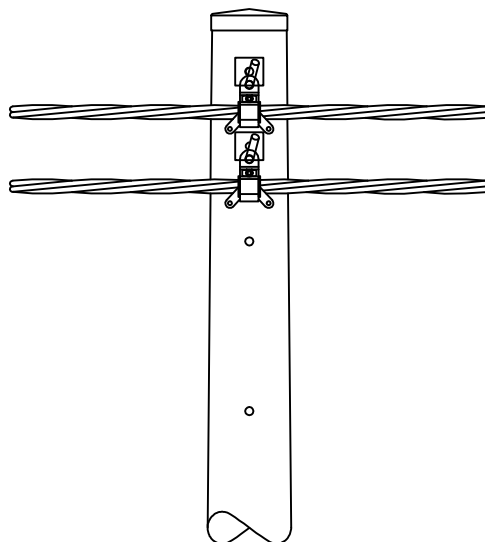

©This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, stored, or used without the written consent of Endeavour Energy.



Endeavour Energy

ORIGINAL SCALE	APPROVED
DRAWN G. Ford	G. Ford
DATE 22/04/09	
CHKD G. Ford	

OVERHEAD LV ABC CONST No. A01
THROUGH SUSPENSION MAINS
MAX 25 LINE DEVIATION

REFERENCE DRAWINGS	
DO NOT SCALE	AUTHORISED
DIMENSIONS IN MILLIMETRES	W. Isley
MANAGER ASSET ENGINEERING	22/04/09
A4	332006
SHEET No 1 OF 1 SHEETS	