


AMENDMENTS	
A	ORIGINAL ISSUE
B	BOND PG CLAMPS REPLACED WITH SLEEVES. BONDS IPC ADDED
CHECKED	SD
DRAWN	DC
DATE	27-02-13

NOTE



CONST. No C23-V

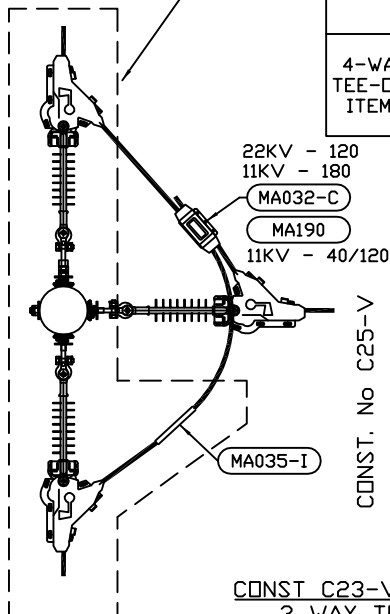




3-WAY
TEE-OFF
ITEMS

ITEM	QTY	DESCRIPTION	REMARKS
MA035-I	3	SLEEVE JOINT (I=INSULATED)	
MA190	3	IPC 11KV 40-120 sq mm	11/40-120
CONST C23-V	1	THROUGH STRAIN CCT (VERTICAL)	
CONST C25-V	1	TERMINATION CCT (VERTICAL)	
MA032-C	3	CLAMP PG 2 BOLT + COVER	22/120,11/180
MA035-I	3	SLEEVE JOINT (I=INSULATED)	
MA190	6	IPC 11KV 40-120 sq mm	11/40-120
CONST C23-V	2	THROUGH STRAIN CCT (VERTICAL)	
MA032-C	6	CLAMP PG 2 BOLT + COVER	22/120,11/180

CONST. No C21-V

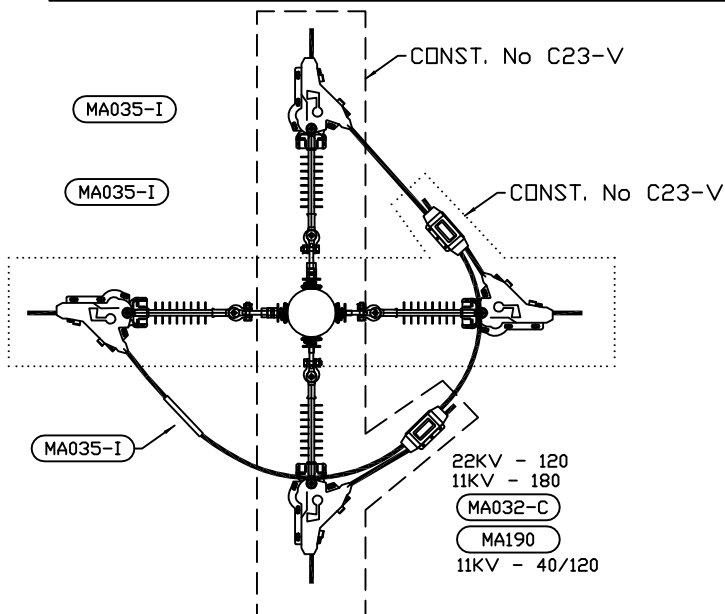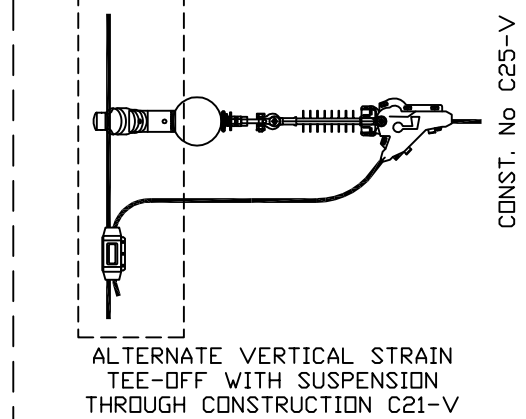

CONST. No C21-V

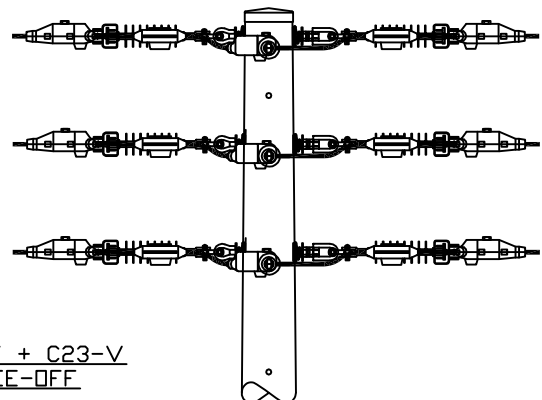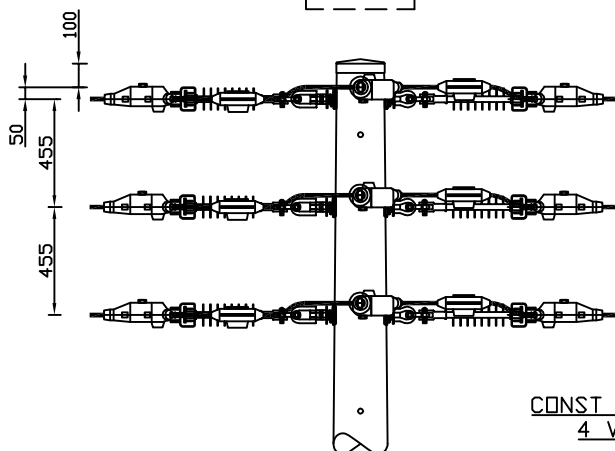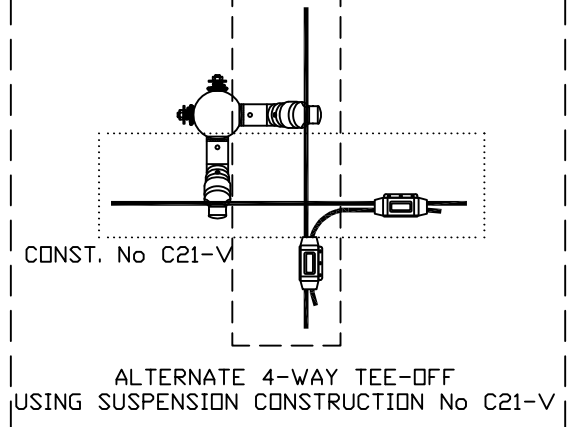

	© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.
ORIGINAL SCALE	APPROVED
DRAWN G. Ford	G. Ford
DATE 22/04/09	
CHD G. Ford	



OVERHEAD 11-22kV CCT COMBINATIONS
TEE-OFF FROM CCT STRAIN (VERTICAL)
3-WAY (C23-V+C25-V) & 4-WAY (C23-V+C23-V)

REFERENCE DRAWINGS	
DO NOT SCALE DIMENSIONS IN MILLIMETRES	AUTHORISED W. Isley MANAGER ASSET ENGINEERING 22/04/09
A4	332036 B
SHEET No 1 OF 1 SHEETS	