
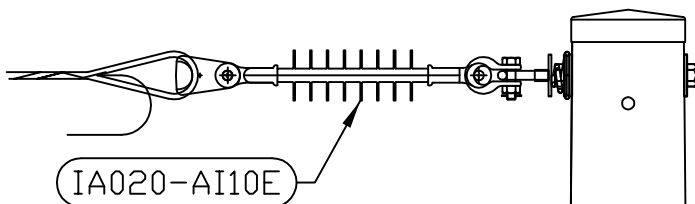
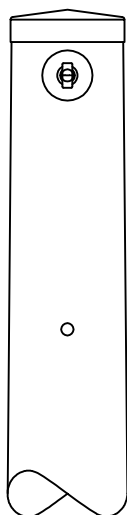



AMENDMENTS	
A	ORIGINAL ISSUE
1)	-

NOTE

ITEM	QTY	DESCRIPTION	REMARKS
BA002	1	EYEBOLT 20MM (POLE)	
IA020-AI10E	1	INS. LONGROD BOW/THIMBL 22KV	

LIMITS OF CONSTRUCTION			
MAX. ANGLE OF LINE DEVIATION	MAXIMUM CONDUCTOR SIZE - STRINGING TABLE - SPAN LENGTH		
	ACSR	AAAC	
60°	CHERRY -3A -320	7/2.50 -3B	-200
60°	-----	7/3.00 -3B	-200

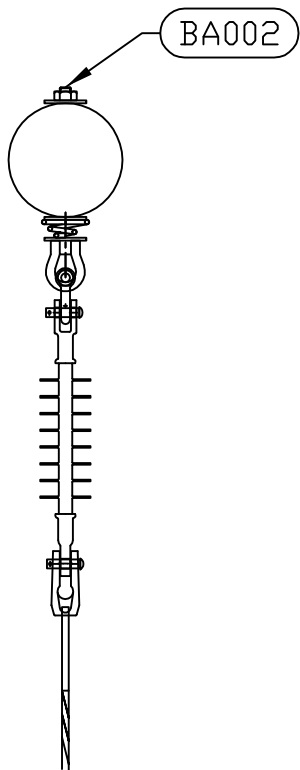

	This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written permission of Endeavour Energy.		
	ORIGINAL SCALE	APPROVED	G. Ford
DRAWN	G. Ford		
DATE	22/04/09		
CHEK	G. Ford		



Endeavour Energy

OVERHEAD S.W.E.R. 12.7KV CONST. No SW25
TERMINATION

REFERENCE DRAWINGS		AUTHORISED	
DO NOT SCALE DIMENSIONS IN MILLIMETRES		W. Isley	
		MANAGER ASSET ENGINEERING	22/04/09
A4	332052	A	
SHEET No 1 OF 1 SHEETS			