


AMENDMENTS
A ORIGINAL ISSUE

NOTE
1) IF CONDUCTOR CAN BE INSTALLED UNBROKEN BETWEEN SHACKLE POINTS, THEN ITEM MA032 CAN BE DELETED.

ITEM	QTY	DESCRIPTION	REMARKS
CONST SW25	2	TERMINATION SWER	
MA032	1	CLAMP PG 2 BOLT-SIZE TO SUIT	NOTE 1


LIMITS OF CONSTRUCTION		
MAX. ANGLE OF LINE DEVIATION	MAXIMUM CONDUCTOR SIZE - STRINGING TABLE - SPAN LENGTH	
	ACSR	AAAC
90°	CHERRY -3A -320	7/2.50 -3B -200
90°	-----	7/3.00 -3B -200

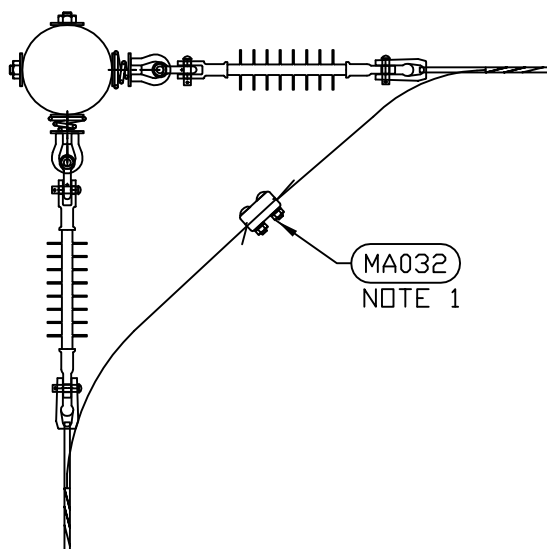

CONST No. SW25

CONST No. SW25

100
50

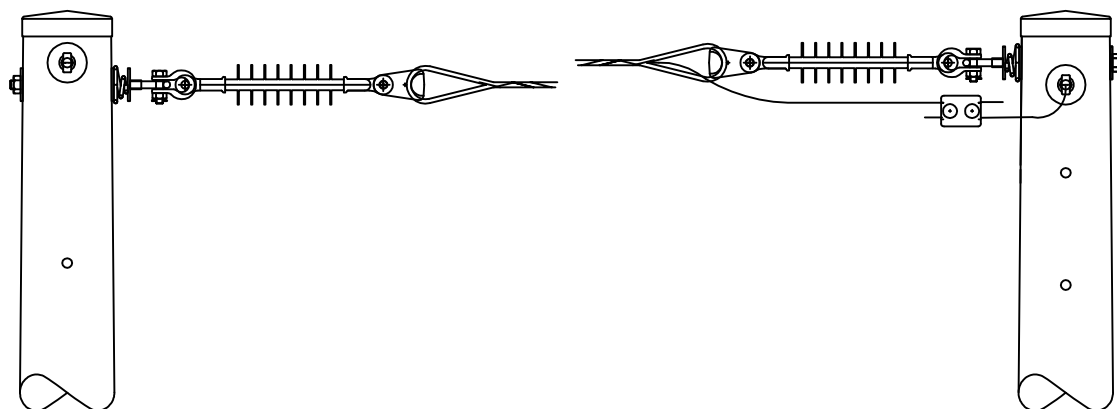

		REFERENCE DRAWINGS DO NOT SCALE DIMENSIONS IN MILLIMETRES		AUTHORISED W. Isley MANAGER ASSET ENGINEERING 22/04/09	
OVERHEAD S.W.E.R. 12.7KV COMBINATION ANGLE STRAIN 90° LINE DEVIATION CONST. SW25+SW25		A4 332053 SHEET No 1 OF 1 SHEETS		A	