


AMENDMENTS	
A	ORIGINAL ISSUE

- 1) IF CONDUCTOR CAN BE INSTALLED UNBROKEN BETWEEN SHACKLE POINTS, THEN ITEM MA032 CAN BE REDUCED TO ONE.


NOTE

ITEM	QTY	DESCRIPTION	REMARKS
CONST SW25	3	TERMINATION SWER	
MA032	2	CLAMP PG 2 BOLT-SIZE TO SUIT	NOTE 1

CONST No. SW25

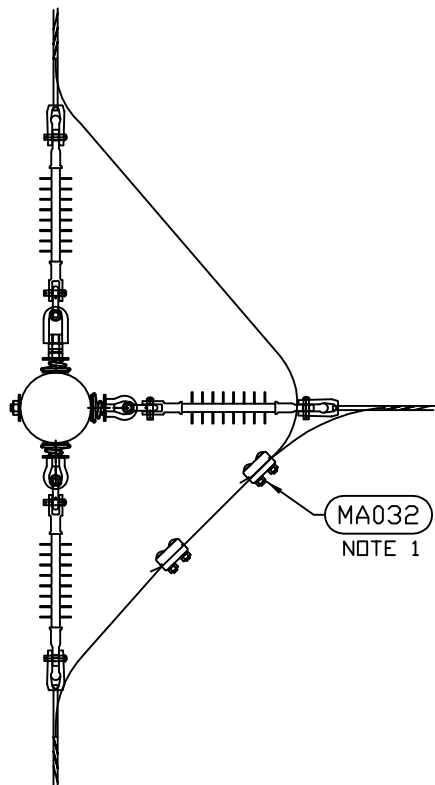

CONST No. SW21

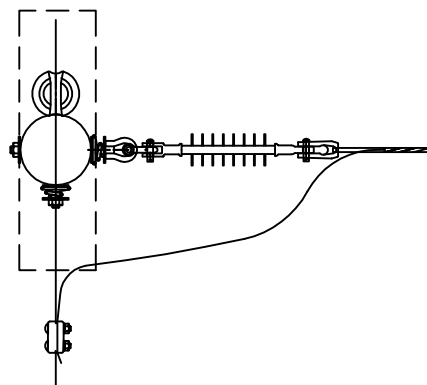


CONST No. SW25

ALTERNATE TEE-OFF WITH SUSPENSION THROUGH CONST No. SW01

CONST No. SW25

100
50

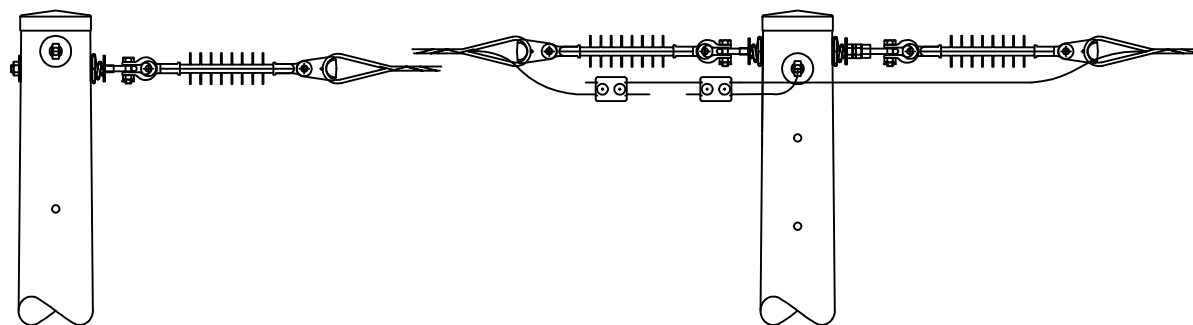

	ORIGINAL SCALE	APPROVED	G. Ford
	DRAWN	G. Ford	
	DATE	22/04/09	
	CHEK	G. Ford	



Endeavour Energy

OVERHEAD S.W.E.R. 12.7KV COMBINATION
STRAINED TEE-OFF
CONST. SW25+SW25+SW25

REFERENCE DRAWINGS		AUTHORISED	
DO NOT SCALE	DIMENSIONS IN MILLIMETRES	W. Isley	
MANAGER ASSET ENGINEERING	22/04/09	A4	332054
SHEET No 1 OF 1 SHEETS			A