
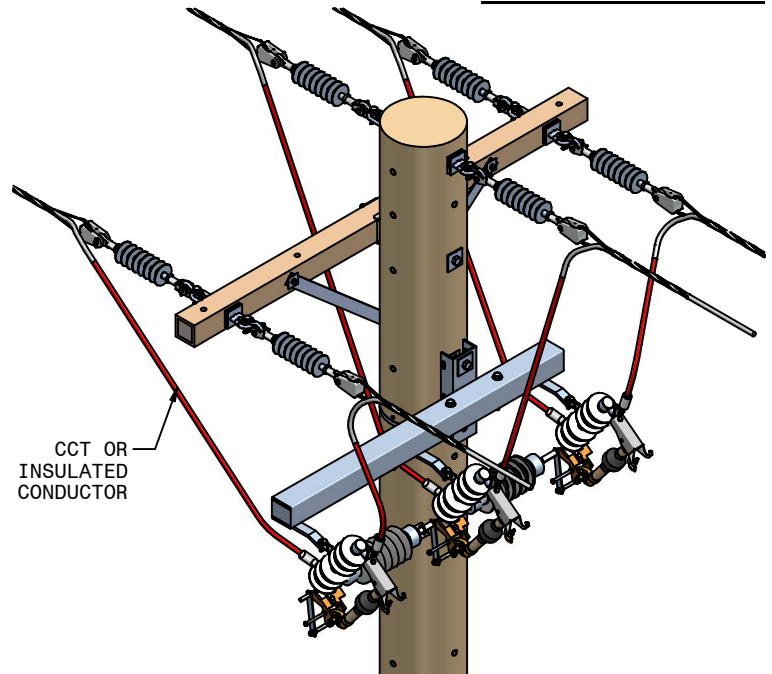


AMENDMENTS	
A	ORIGINAL ISSUE
B	DRN G.S.F. CHD G.S.F. DATE 03-06-14 JR No N/A NOTES 4 & 5 ADDED. MPS G.S.F.


NOTES

- 1) SECTIONALISER MAY BE 1, 2 OR 3PH DEPENDING ON PROJECT. MOUNTING BRACKET TO BE SUPPLIED WITH SECTIONALISER.
- 2) OVERHEAD MAINS CONSTRUCTION SHOWN ARE FOR INFORMATION ONLY AND MAY BE CHANGED TO SUIT DESIGN.
- 3) EARTHING TO BE IN ACCORDANCE WITH MC10005 & SDI100.
- 4) CROSSARM BRACE TO BE COVERED WITH HV HEATSHRINK TO IMPROVE INSULATION TO SECTIONALISER
- 5) ENSURE SECTIONALISER CONTROL SETTINGS (DIP SWITCHES) ARE SET CORRECTLY PRIOR TO ENERGISATION.

ITEM	QTY	DESCRIPTION	REMARKS
2 AND 3 PHASE SECTIONALISER			
BA009-16	1	BOLT M16 (POLE+BRACKET)	NOTE 1
BA034	1	BANDIT STRAP 19mm	
MA024	6	LUG 1 HOLE TO SUIT MAINS	
SECT	1	SECTIONALISER-DOF STYLE	NOTE 1&5
1 PHASE SECTIONALISER (SWER OH MAINS)			
BA060-750	1	BRACE CROSSARM STD 750	
SECT	1	SECTIONALISER-DOF STYLE	NOTE 1&5
XA020	1	CROSSARM HV STD 2100x100x100	

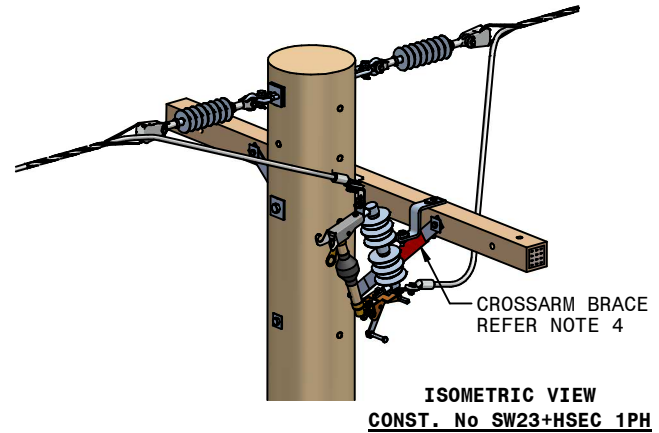

CONST. No B23
REFER NOTE 2

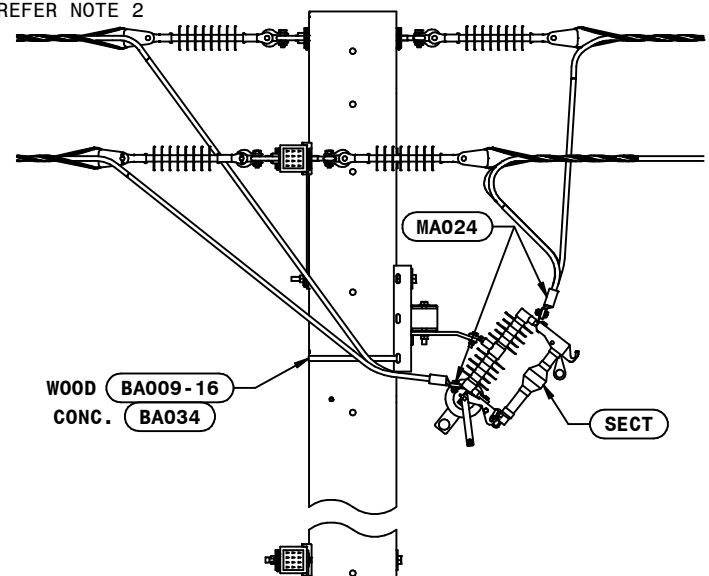


WOOD BA009-16
CONC. BA034

MA024

SECT

LV CONST. AS PER
PROJECT DRAWING

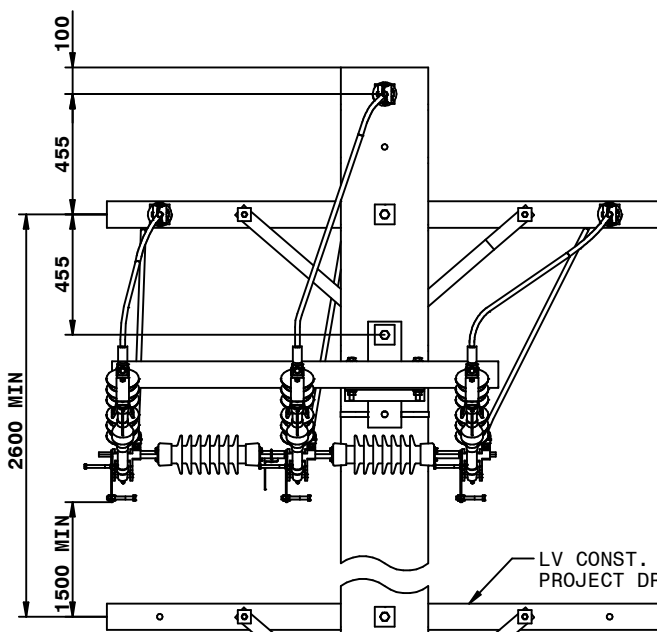

© This drawing and the copyright therein is the property of Integral Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Integral Energy.

ORIGINAL SCALE	APPROVED
DRAWN G. Ford	G. Ford
DATE 27/06/10	
CHD G. Ford	



DO NOT SCALE
DIMENSIONS
IN MILLIMETERS

INTEGRAL ENERGY

OVERHEAD 11-22KV CONST. No. HSEC
SECTIONALISER - DOF STYLE
MOUNTING ARRANGEMENT

REFERENCE DRAWINGS

AUTHORISED
J. Perera

MANAGER DIST. ENGINEERING 27/06/10

A4 332060 B
SHEET No. 1 OF 1