AMENDMENTS	
A	ORIGINAL ISSUE
Job No.	WTE1406
B	DESIGN: N/A
	DR'N: TV
	CH'D: MA/MB
	DATE: 24.10.25
A.E.M	S.P.
STOCK CODES UPDATED	

NOTES

1. POLE STEPS ARE REQUIRED TO BE INSTALLED FROM 8.3m ABOVE GROUND LEVEL. WHERE NORMAL VEHICLE ACCESS IS NOT AVAILABLE (OFF ROAD) POLE STEPS WILL BE REQUIRED FROM 6m ABOVE GROUND LEVEL. ALL CONCRETE AND STEEL POLES SHOULD HAVE FERRULES FROM 6m REGARDLESS.

ITEM	PART/ASSEMBLY NUMBER	DRG Nos.	DESCRIPTION	QTY
1	-	295702	POLE PRESTRESED CONCRETE	1
2	1000006147	370399	STEP,POLE,HEX,M16x180MM(L),50MM(T),+NUTS	A/R
3	ALR001	398038	INSULATOR LONG ROD ASSEMBLY	6
4	-	048761	POLE BAND 125kN DIAMETER TO SUIT	6
5	SEE TABLE	399844	SLEEVE NON TENSION TO SUIT CONDUCTOR	3
6	-	REFER PROJECT	OPGW ASSEMBLY (NOMINAL SHOWN)	1
7a	AEC-A	051125	EARTH CONNECTION AEC-A	1
7b	AEC-B	051125	EARTH CONNECTION AEC-B	3
7d	AEC-D	051125	EARTH CONNECTION AEC-D	6
7e	AEC-E	051125	EARTH CONNECTION AEC-E	1

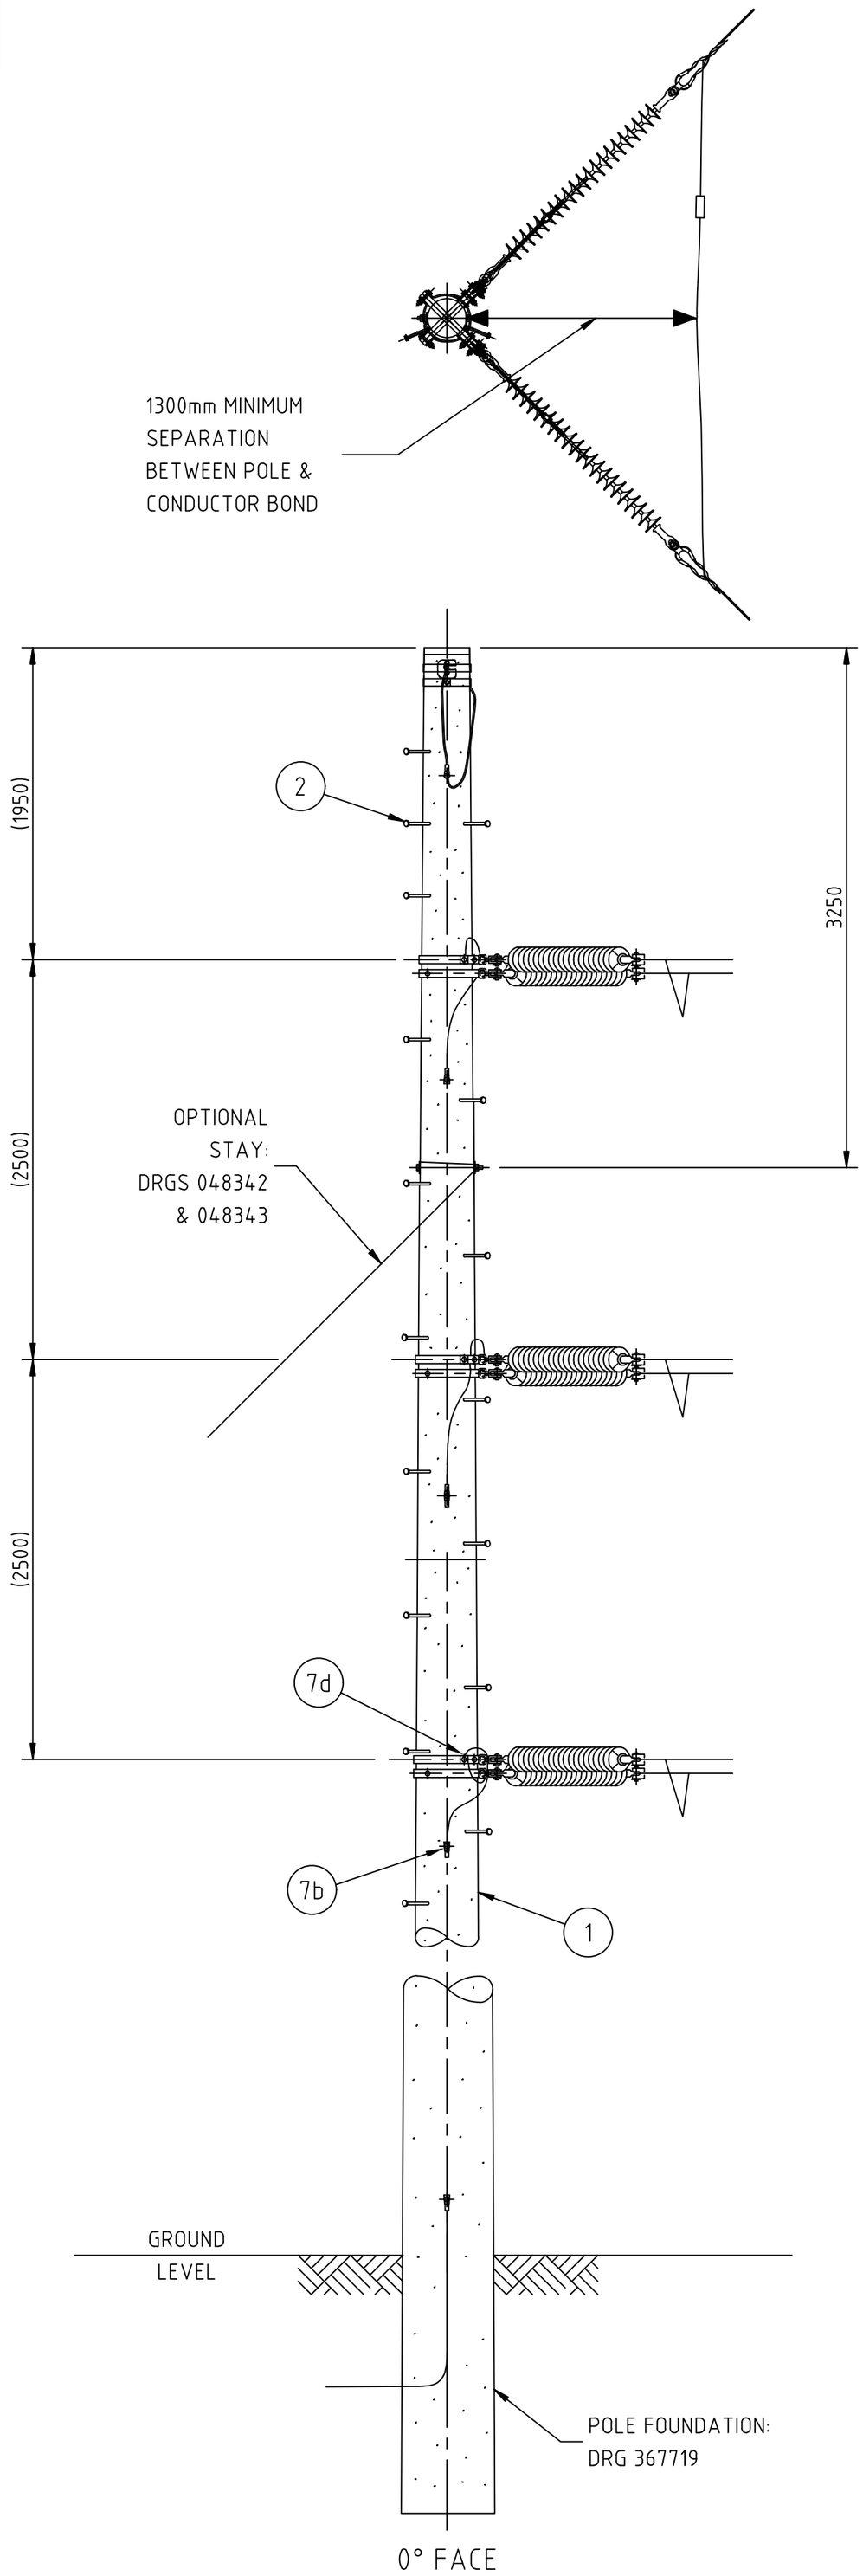

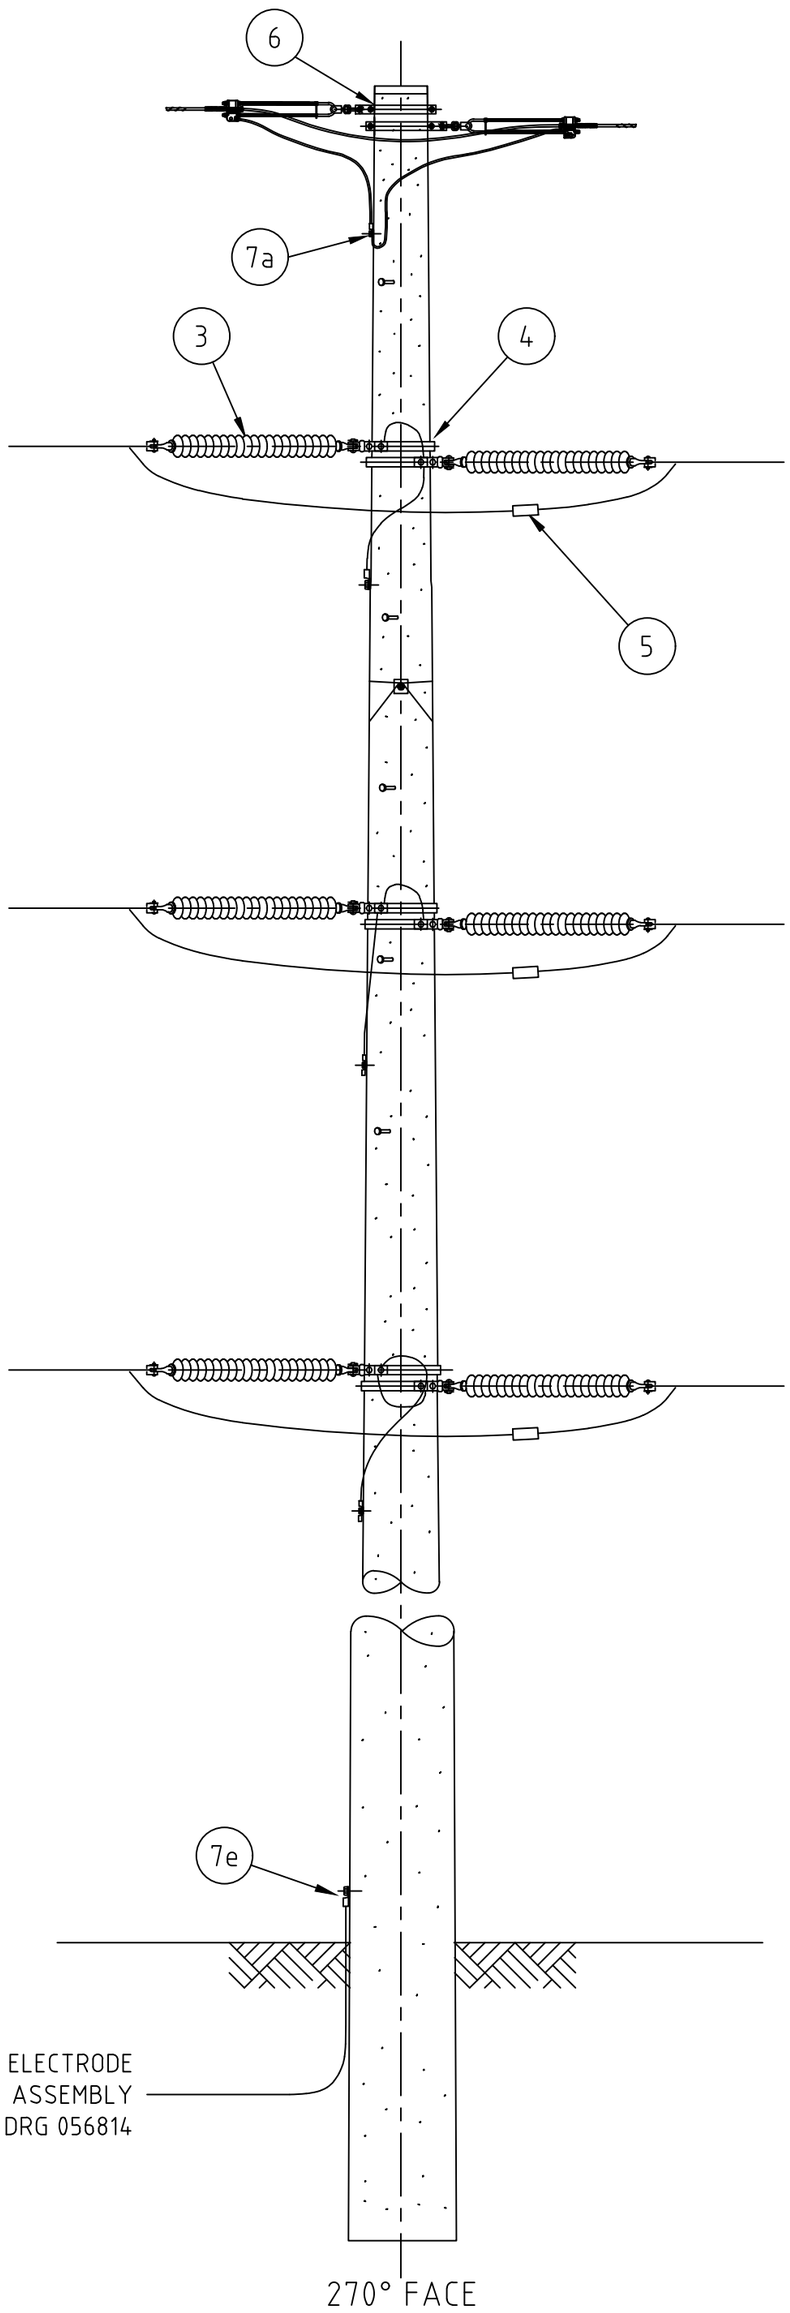

© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

ORIGINAL SCALE	APPROVED
NTS	S.F.Williams

DRAWN	KT		
DATE	02.06.14		
CH'D	J.B./R.L.		

Endeavour Energy

REFERENCE DRAWINGS

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

AUTHORISED
D.Mate
NETWORK MAINS MANAGER 31.10.14

OVERHEAD TRANSMISSION 132kV CONSTRUCTION No.84C VERTICLE THROUGH STRAIN DEVIATION 60-90 DEGREES

A2P 397794 Rev. B

SHEET No 1 OF 1 SHEETS