


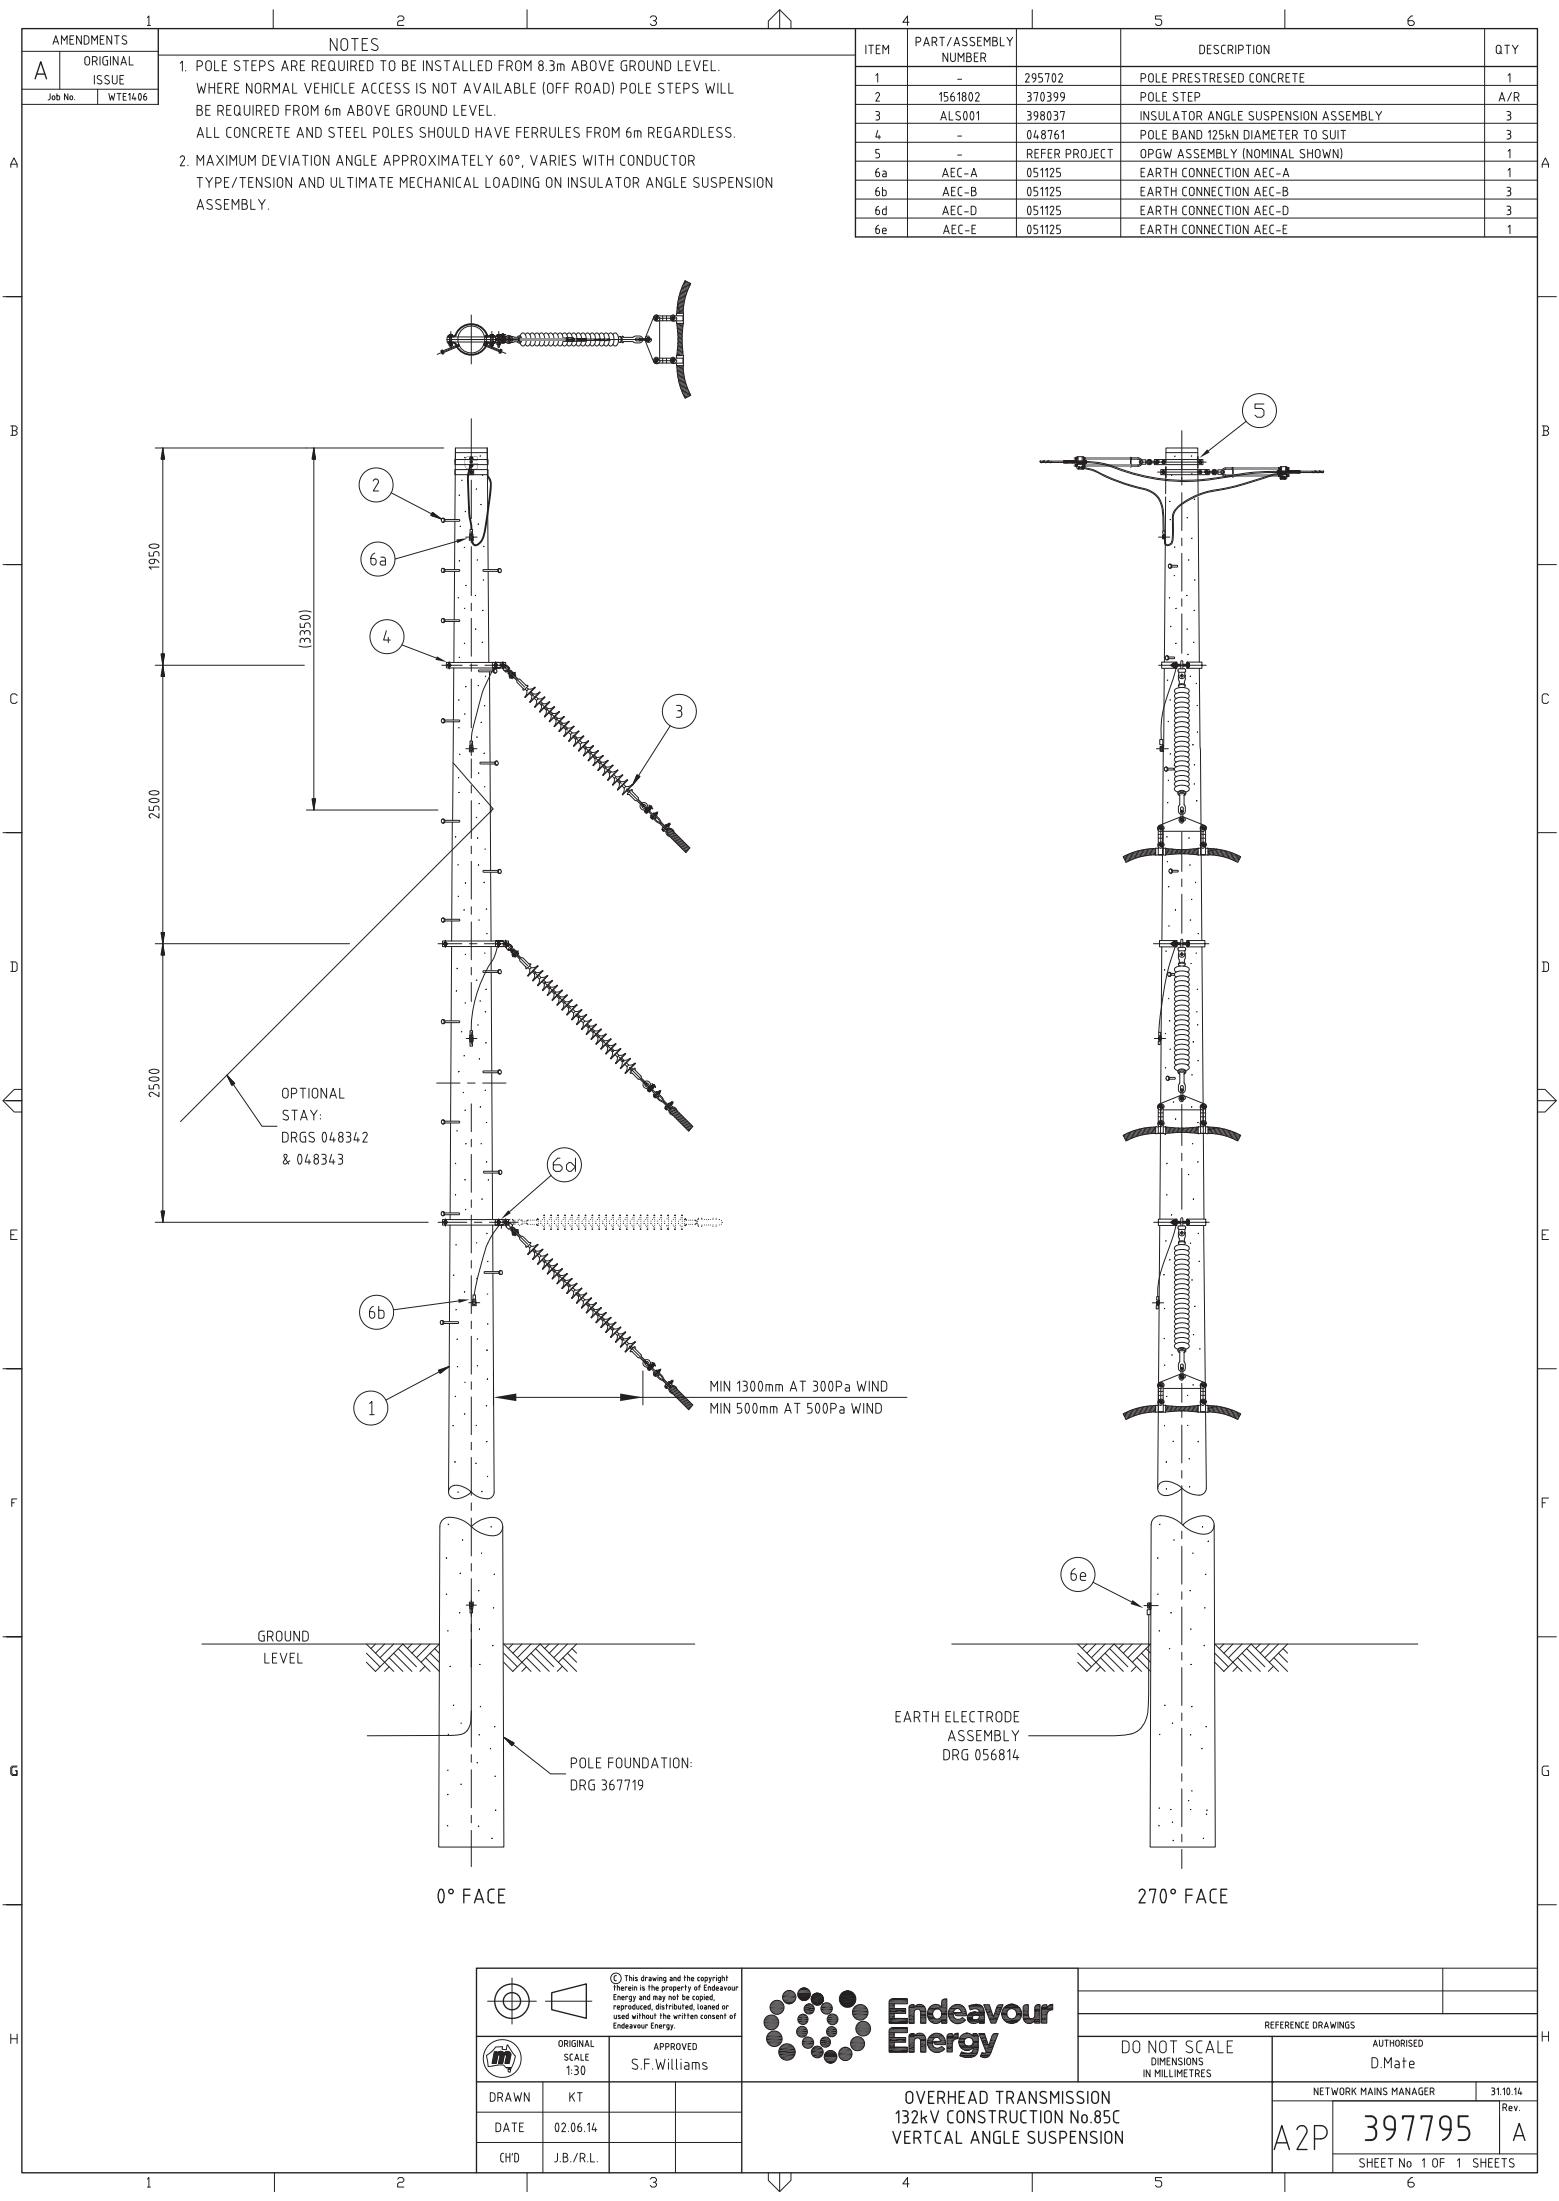


AMENDMENTS	
A	ORIGINAL ISSUE
Job No.	WTE14.06

NOTES

- POLE STEPS ARE REQUIRED TO BE INSTALLED FROM 8.3m ABOVE GROUND LEVEL. WHERE NORMAL VEHICLE ACCESS IS NOT AVAILABLE (OFF ROAD) POLE STEPS WILL BE REQUIRED FROM 6m ABOVE GROUND LEVEL. ALL CONCRETE AND STEEL POLES SHOULD HAVE FERRULES FROM 6m REGARDLESS.
- MAXIMUM DEVIATION ANGLE APPROXIMATELY 60°, VARIES WITH CONDUCTOR TYPE/TENSION AND ULTIMATE MECHANICAL LOADING ON INSULATOR ANGLE SUSPENSION ASSEMBLY.

ITEM	PART/ASSEMBLY NUMBER		DESCRIPTION	QTY
1	-	295702	POLE PRESTRESSED CONCRETE	1
2	1561802	370399	POLE STEP	A/R
3	ALS001	398037	INSULATOR ANGLE SUSPENSION ASSEMBLY	3
4	-	048761	POLE BAND 125kN DIAMETER TO SUIT	3
5	-	REFER PROJECT	OPGW ASSEMBLY (NOMINAL SHOWN)	1
6a	AEC-A	051125	EARTH CONNECTION AEC-A	1
6b	AEC-B	051125	EARTH CONNECTION AEC-B	3
6d	AEC-D	051125	EARTH CONNECTION AEC-D	3
6e	AEC-E	051125	EARTH CONNECTION AEC-E	1

		© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.	
ORIGINAL SCALE	1:30	APPROVED	S.F. Williams
DRAWN	KT		
DATE	02.06.14		
CHD	J.B./R.L.		



Endeavour Energy

OVERHEAD TRANSMISSION
132kV CONSTRUCTION No.85C
VERTICAL ANGLE SUSPENSION

DO NOT SCALE
DIMENSIONS
IN MILLIMETRES

REFERENCE DRAWINGS

AUTHORISED
D.Mate

NETWORK MAINS MANAGER

31.10.14

A2P

397795

Rev.
A

SHEET No 1 OF 1 SHEETS